



FILED


11/15/24

04:59 PM

A2411005

PACIFIC GAS AND ELECTRIC COMPANY

EXHIBIT A PROJECT OVERVIEW MAP

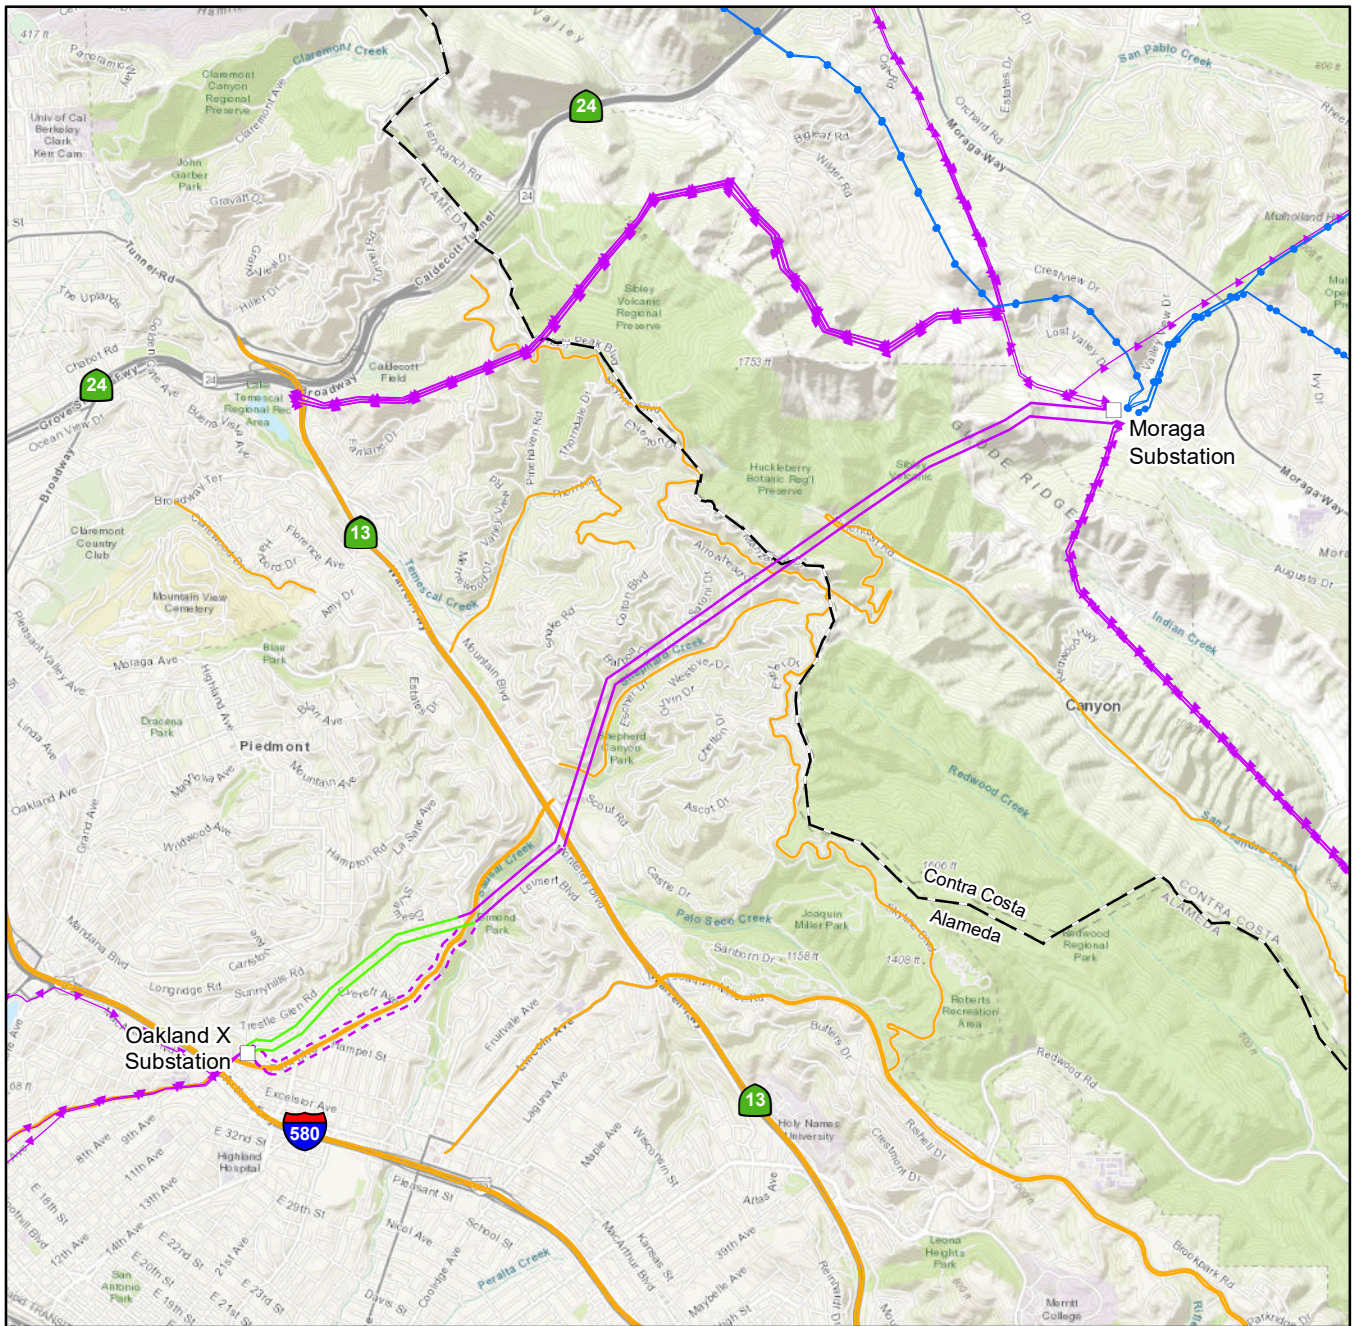

Preliminary and Subject to Change Based on
CPUC Requirements, Final Engineering, and Other Factors

Legend

- Substation
- County Boundary
- Scenic Roadway
- ▲ Existing 115 kV Power Line
- Existing 230 kV Transmission Line

Existing Moraga-Oakland X Double-Circuit 115 kV Line to be Rebuilt

- Existing Overhead Double-Circuit 115 kV Line to be Rebuilt in Same Overhead Configuration
- Double-Circuit 115 kV Line to be Rebuilt Underground
- Existing Overhead Double-Circuit 115 kV Line to be Removed




Exhibit A
Overview with Proposed Lines Rebuild
Moraga-Oakland X 115 kV Rebuild Project
Pacific Gas & Electric Company

Jacobs