


allowed in the work area

structure at all times

Minimum 36" in front of the panel board

Panel Board Structure Guide



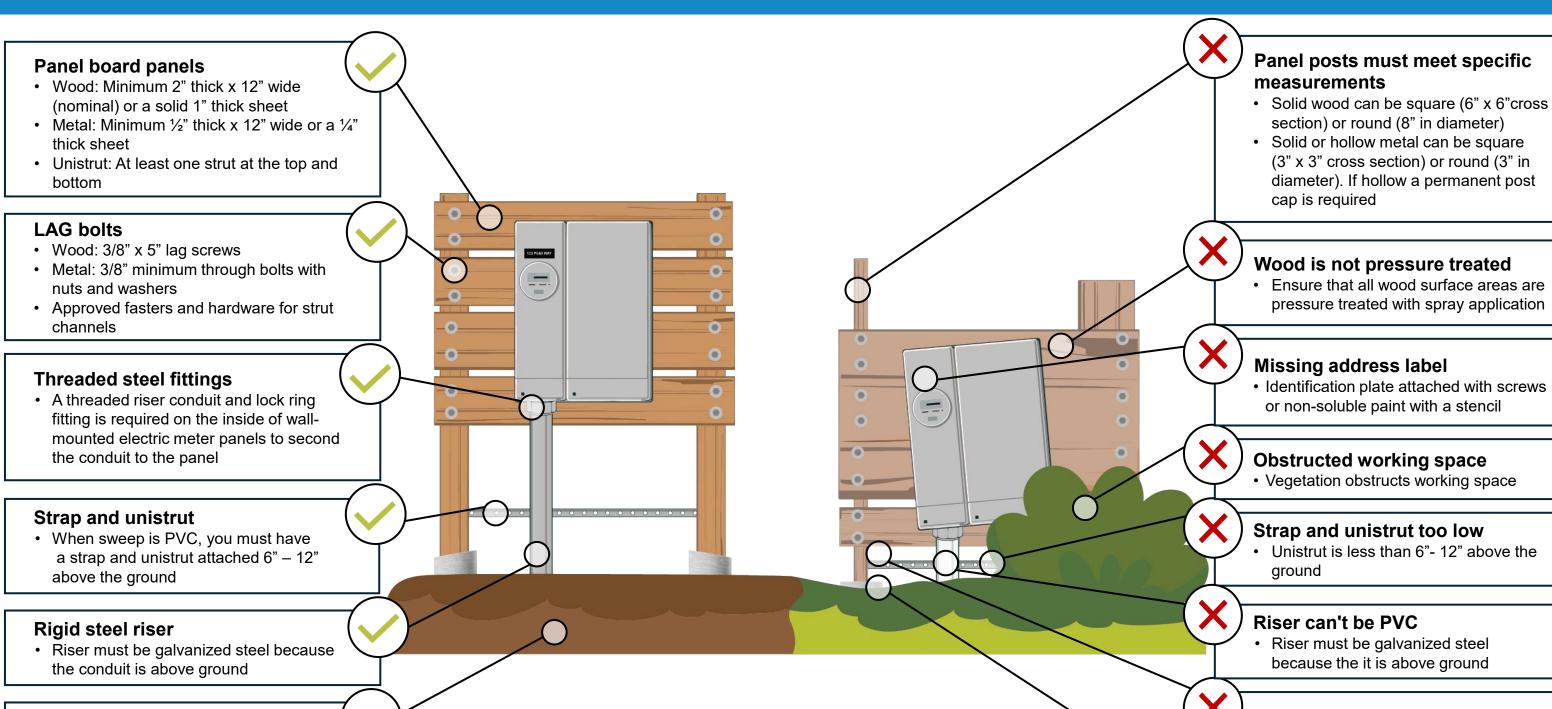

Clear and level working space

Minimum clearance is not met

Equipment is less than 6" above ground

• No obstructions or elevation changes

X Base is too short and flat

Must have 4" of concrete with a ½" slope

For more information and technical detail please refer to standard 065374, and Section 3.3.1, 5.4.4 and 5.5.1 of the PG&E Greenbook. Standards will be provided to you once you begin your application and sign an NDA, and the Greenbook Manual is available on the Project Resources page. If you're unsure how to access or use them, your PG&E Job Owner can help.

fic Gas and Electric Company All rights resenved