

**PACIFIC GAS AND ELECTRIC COMPANY**  
**Wildfire Mitigations Plans Discovery 2026-2028**  
**Data Response**

<b>PG&amp;E Data Request No.:</b>	SPD_004-Q016
<b>PG&amp;E File Name:</b>	WMP-Discovery2026-2028_DR_SPD_004-Q016
<b>Request Date:</b>	May 1, 2025
<b>Requester DR No.:</b>	CONF-SPD-PGE-WMP2026-004
<b>Requesting Party:</b>	Safety Policy Division
<b>Requester:</b>	Edwin Schmitt
<b>Date Sent:</b>	May 13, 2025


**SUBJECT: MITIGATION COST EFFICIENCY ASSESSMENT (SPD-PGE-WMP2026-004)**

**QUESTION 016**

Provide a copy of Figure 1-2 in PG&E-4 Chapter 1 of the PG&E 2024 RAMP without the scaling function (a neutral risk attitude).

- a. Explain any variances in the values displayed in the Figure 1-2 without the scaling function when compared with PG&E's response to WMP-Discovery2026-2028\_DR\_MGRA\_003- Q007.

**ANSWER 016**

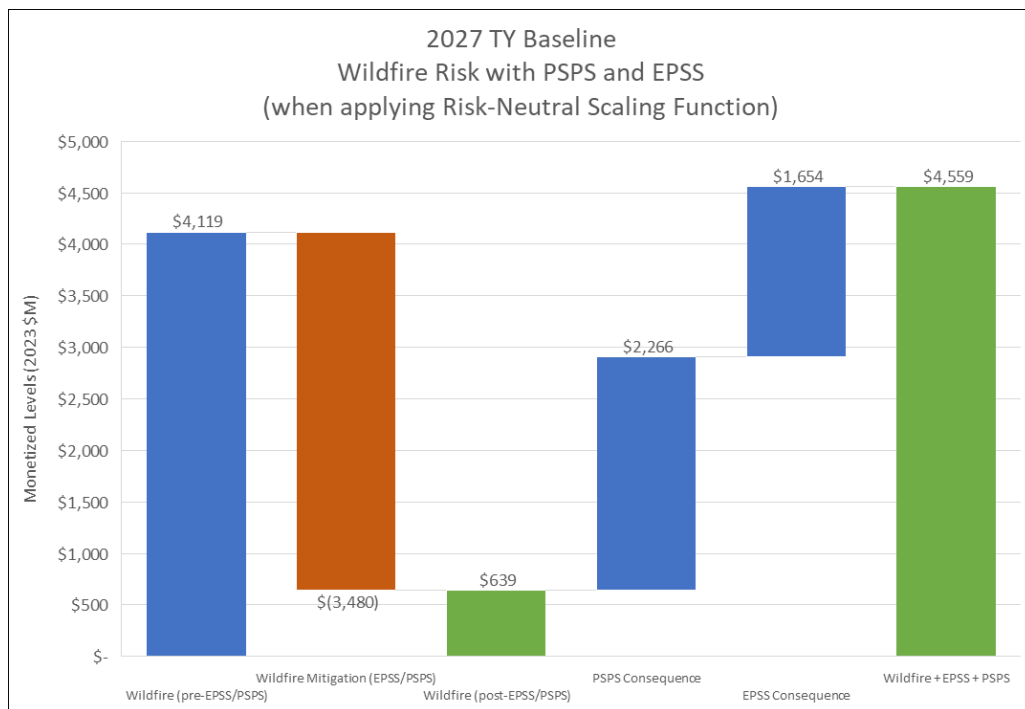

Please see the attachment “WMP-Discovery2026-2028\_DR\_SPD\_004-Q016Atch01.xlsx” for the requested information.

- a. The variances between the two charts are from 1) the differences in the year: RAMP chart shows the TY Baseline for 2027 while MGRA Discovery and WMP chart shows Baseline for 2026; and 2) the various updates made to the inputs to the risk models since RAMP filing. The table below outlines the key changes leading to variances between the two charts:

Category	Description of Updates
Wildfire (pre-EPSS/PSPS)	<ul style="list-style-type: none"><li>• WDRM v3 to WDRM v4</li><li>• Source data (e.g., ignition data) updated to include years 2023 and 2024</li></ul>
Wildfire Mitigation (EPSS/PSPS)	<ul style="list-style-type: none"><li>• Updated EPSS and PSPS effectiveness</li></ul>
EPSS Consequence	<ul style="list-style-type: none"><li>• Updated source data (e.g., outage data)</li></ul>
PSPS Consequence	<ul style="list-style-type: none"><li>• Updated PSPS lookback analysis using PSPS 5.0 Guidance</li><li>• Updated source data</li></ul>