



Contents

INTRODUCTION TO JOB AID: OVERHEAD ASSESSMENT	5
<i>Use of Priority X Tag.....</i>	<i>6</i>
<i>Overhead Job Aid Training</i>	<i>7</i>
<i>Target Audience</i>	<i>7</i>
<i>Before You Start</i>	<i>7</i>
DEFINITION OF MINOR WORK	8
<i>Examples of OH Inspection Minor Work</i>	<i>8</i>
<i>Requirements for Minor Work during Inspections.....</i>	<i>9</i>
<i>Requirements for Minor Work during Patrols.....</i>	<i>10</i>
<i>Minor Work Process</i>	<i>11</i>
<i>Recommended Work Flow Steps.....</i>	<i>12</i>
ACCESS AND CONFIRMATIONS	14
CLIMBING SPACE.....	17
<i>Climbing Space – Obstructed</i>	<i>17</i>
<i>Climbing Space – Obstructed by Vegetation</i>	<i>19</i>
AD HOC INSPECTION PROCESS.....	22
POLES/STRUCTURES	23
LEANING POLE.....	25
<i>Examples</i>	<i>26</i>
CROSS-SECTION OR HORIZONTAL CRACK.....	30
<i>Examples</i>	<i>31</i>
REDUCED CIRCUMFERENCE	34
<i>Examples</i>	<i>35</i>
SPLIT (VERTICAL SEPARATION).....	37
<i>Examples</i>	<i>37</i>
OVERLOAD (BENT)	43
<i>Examples</i>	<i>44</i>
DECAYED / ROTTEN	48
<i>Examples</i>	<i>48</i>
WOODPECKER	52
<i>Examples</i>	<i>54</i>
SOIL EXCESSIVELY ERODED OR WASHED AWAY AT BASE OF POLE	60
<i>Example.....</i>	<i>60</i>
TRANSMISSION POLES AND DISTRIBUTION UNDERBUILDS.....	61
<i>Example.....</i>	<i>61</i>
<i>Example 2.....</i>	<i>62</i>
<i>Example 3.....</i>	<i>64</i>
<i>Example 4.....</i>	<i>65</i>
SOLELY OWNED POLES WITH THIRD-PARTY UTILITY ATTACHMENTS	66
INTUMESCENT POLE COVERS	66
DISTRIBUTION TOWERS / STEEL LATTICE	68
TREE ATTACHMENTS.....	68
<i>Tree Attachments “Found in the Field” Procedure</i>	<i>69</i>
<i>Examples</i>	<i>77</i>



Job Aid: Overhead Assessment

TD- 2305M-JA02
WMP-Discovery2023-2025 DR SPD 024-Q003Atch02
Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

BUDDY POLE	78
<i>Example</i>	78
EQUIPMENT	79
OIL-FILLED EQUIPMENT	79
<i>Equipment Oil: Leaking/Weeping Stain</i>	79
CORROSION	83
<i>Examples</i>	84
<i>Example</i>	86
TRANSFORMER – PARALLEL	87
<i>Examples</i>	87
TRANSFORMER BUSHINGS.....	88
<i>Examples</i>	88
SMARTMETER / SCADA EQUIPMENT / OTHER EQUIPMENT ON POLES	89
<i>Broken/Damaged SmartMeter Relay/Access Point/Data Collector Unit or SCADA Equipment</i>	89
SWITCH HANDLE/CONTROL BOX IS NOT LOCKED.....	91
SURGE “LIGHTNING” ARRESTORS	91
<i>Broken or Flashed</i>	91
LOOSE HARDWARE	93
CONDUCTOR.....	94
BARE PRIMARY & SECONDARY CONDUCTOR.....	94
<i>Part 1</i>	94
VIBRATION DAMPER	98
WEDGE CONNECTORS.....	116
<i>Part 2</i>	122
SERVICE CONDUCTOR	143
<i>Category 1 – Exposed hot leg on the service</i>	143
<i>Category 2 – Broken Service Bob</i>	154
<i>Category 3 – Conductor Clearance</i>	156
CLEARANCE EVALUATION JOB AID	157
COVERED CONDUCTOR.....	174
<i>Category 1 – Exposed energized portions on covered conductor</i>	174
CROSSARM / INSULATORS / CUTOUTS	179
FRAMING.....	179
1. <i>Crossarm Broken/Deteriorated</i>	179
2. <i>Bonding Exists and Needs to be Repaired</i>	184
3. <i>Underarm Bus Not Securely Attached</i>	186
INSULATORS	189
1. <i>Damaged Insulators</i>	189
2. <i>Squatters – Primary or Secondary</i>	193
3. <i>Flying Bells</i>	195
4. <i>Cotter Key</i>	195
CUTOUTS / FUSES / SWITCHES.....	200
1. <i>Damaged Arcing Horns</i>	200
2. <i>Cutouts</i>	200
3. <i>Fuses</i>	202
a. <i>Liquid Filled Fuses</i>	202



Job Aid: Overhead Assessment

TD- 2305M-JA02
WMP-Discovery2023-2025 DR SPD 024-Q003Atch02
Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

b. Open Fuse Latches.....	203
CALIFORNIA POWER LINE FIRE PREVENTION FIELD GUIDE	207
CALIFORNIA POWER LINE FIRE PREVENTION FIELD GUIDE	207
MISCELLANEOUS OTHER COMPELLING ABNORMAL CONDITIONS	208
GUYS / ANCHORS.....	208
Down Guy Preform Buried	208
Visible Portion of Anchor Rod has Significant Corrosion	213
Guy Broken / Slack / Corroded	214
Guy Clearance Issue	215
Down Guy Grounded above Guy Insulator (vegetation or other)	222
Down Guy Marker Missing/Damaged	225
GROUNDS / GROUND MOLDING	229
Exposed Ground Below 8'	229
Exposed Ground above 8' to the Communication Level.....	233
Ground Molding Unsecured/Loose	235
Exposed Ground Rod.....	237
Broken Grounds	238
MARKINGS.....	240
High Voltage Sign Not Installed as Required.....	240
Operating Number Incorrect / Illegible / Missing	242
Damaged or Missing Visibility Strips on Poles / Guy Markers	245
STREETLIGHTS.....	251
Broken or Damaged Streetlight Pole.....	251
Day Burner	253
Missing Streetlight Head.....	253
WILDLIFE PROTECTION	254
Existing Migratory Bird Protection Damaged	254
Exiting Wildlife Protection Damaged	256
Bird protection.....	257
RISER MOLDING.....	258
Broken/Missing Riser Ground	258
U-Shape Riser Molding Broken/Damaged or Unsecured	258
POLE STEPS	260
DECLARATION ITEMS	261
TREES	261
Trees within 4 Feet of a Primary Line	261
Trees Causing Strain or Abrasion to a Secondary Conductor or Service.....	264
Trees Overgrown, NOT Causing Strain or Abrasion to a Secondary Conductor or Service	267
IDLE FACILITIES	269
Identifying and Documenting Idle Facilities.....	269
Energized Electric Line Facility No Longer Used to Serve Customer Load	273
De-Energized Electric Line Facility Already Identified on a Pending EC Notification but Not Mapped	274
Idle Hardware	274
Abandoned Pole Butt	274
3 RD PARTY NOTIFICATION.....	277
Utility – Cable, Phone, and other Electric Utility Partners.....	277



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

<i>Antennas - Third Party Communication</i>	<i>281</i>
<i>Non - Utility</i>	<i>282</i>
FDA - DISTRIBUTION OH FACILITY DAMAGE ACTION TABLE	285
TABLE 1	285



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

Introduction to Job Aid: Overhead Assessment

This job aid is designed to assist Electric Distribution Compliance Inspectors, PG&E Employees, and Contractors in assessing and prioritizing compelling **abnormal conditions** on overhead facilities, including but not limited to GO 165 Inspections. Compelling Abnormal Condition is defined as any electric distribution pole, equipment, component, conductors, vegetation, or third-party condition that causes a safety or fire ignition risk that, in the judgment of the field employee, may adversely impact public safety and/or service reliability.

The field employee's primary responsibility when inspecting an overhead electric facility is to **examine and record any compelling abnormal conditions** and per GO95 Rule 18 level 3 conditions that can be completed as opportunity work. This job aid provides guidance on issues that field employees may encounter most frequently in the field but is not intended to be an all-inclusive listing of all abnormal conditions or corrective actions.

During any inspection or field assessment, the field employee may change the priority of any EC Tag based on the current field conditions, which should be included in the long text supporting the EC Tag.

PG&E Prioritization				
	PG&E Priority	Tier 3	Tier 2/HFRA	Non-HFTD
Level 1: Immediate risk of high potential impact to safety and reliability	A	Within 24 hours	Within 24 hours	Within 24 hours
Level 2: at least moderate potential impact	X	Up to 7 days	Up to 7 days	Up to 7 days
	B	Up to 6 months	Up to 6 months	Up to 6 months
	E	Up to 6 months	Up to 12 months	Up to 36 months
Level 3: low potential impact	F	60 months	60 months	60 months

Field personnel will continue to have the ability to set deadlines shorter than the default deadlines for B and E tags based on specific location/consequence potential.



Job Aid: Overhead Assessment

Use of Priority X Tag

The new Priority X is a GO 95 Rule 18 Level 2 emergency notification for conditions that pose a high potential impact to safety or reliability but do not present an immediate risk to public safety. The table below provides some very general guidance on when A tag (standby) vs. X tag vs. B tag is appropriate. However, in all conditions field personnel should exercise their judgment, considering factors including but not limited to the severity of the condition, whether or not the asset has already failed, local environment and conditions, and upcoming weather conditions when judging the immediacy of the condition. The X tag should not be used during storms and outages.

Facility	Priority A	Priority X	Priority B
Pole	<ul style="list-style-type: none"> Broken Poles 	<ul style="list-style-type: none"> Damaged or severely deteriorated poles that has not failed but has a high probability/consequence of failure 	<ul style="list-style-type: none"> Damaged or severely deteriorated poles that could potentially fail within 180 days.
Fuses and Cutouts	<ul style="list-style-type: none"> Fuses blown and power is out Insulator part of cutout is broken and held up by connector only 	<ul style="list-style-type: none"> Deteriorated cutouts that has not failed but has a high probability/consequences of failure 	<ul style="list-style-type: none"> Low oil conditions in HFTD
Cross Arm	<ul style="list-style-type: none"> Broken cross arm 	<ul style="list-style-type: none"> Deteriorated cross arm that has not failed but has a high probability/consequence of failure 	<ul style="list-style-type: none"> Level 2 condition that has been identified as urgent which has a high or moderate probability of failure in area of high impact. Inspector would assign priority based on severity of condition and impact of equipment failure.
Conductor	<ul style="list-style-type: none"> Broken conductor Conductor that has separated/floating from the insulator and cross arm and presents an immediate shock or ignition risk to the public Wires down 	<ul style="list-style-type: none"> Deteriorated conductor or tie wire that has not failed but has high probability/consequence of failure Floating conductor without an immediate shock or ignition risk to the public Severely deteriorated grey service drops with exposed energized cable 	
Transformer	<ul style="list-style-type: none"> Leaking oil Failed with no power 	<ul style="list-style-type: none"> Deteriorated transformer that has not failed but integrity is breached due to heavy corrosion 	<ul style="list-style-type: none"> Metal is damaged if severity or impact was high.

The statement “Minor Work” referenced in this document is specific to compliance inspectors.

When in the field, if a compliance inspector completes minor work, the work must be completed to current construction standards, with the exception of make-safe situations.

The FDA (Facility Type / Damage / Action) located in [Table 1](#) at the bottom of this document provides general guidance on EC tag notification for the specific scenario.



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

Overhead Job Aid Training



- Refresher Training
 - TECH-0020
- The Annual Refresher Training program is designed for PG&E's Compliance Inspectors who conducted detailed inspections in the previous year. Content includes explanations of changes to the annual inspection program, mobile applications, and the checklist. A review of this Job Aid is included in this course.
- New Inspector Training
 - ELEC-1000
- The New Inspector Training program is a 3-day training program designed for new Compliance Inspectors and Canus contractors who may be assigned Electric Distribution GO165 Overhead/Underground inspection and patrol work. A review of this Job Aid is included in this course.
- New Contractor Training
 - ELEC-0340, 0341, 0342
- The New Contractor Training program is a 3-day training program, followed by an assessment day plus a 2 day in-the-field-training. It is designed for new contractors who will be assigned Electric Distribution GO165 Overhead inspection work. A review of this Job Aid is included in this course.

Target Audience

- Qualified Electrical Workers (QEW)

Before You Start

- Follow all applicable safety rules, procedures, and protocols.
- Wear appropriate personal protective equipment (PPE) for specific tasks and work area.

Uniform Symbols for Job Aid	
Symbol	Definition
	Ground
	Aerial+

Definition of Minor Work

Minor Work is maintenance work and/or repair activities that can be accomplished safely and efficiently at the site of the electric distribution facility by the Inspector.

Minor Work is recorded using your approved electronic device.

Within the mix of supporting PG&E's OH and UG Electric Distribution system, Minor Work is a highly effective process that immediately improves reliability, operational safety, and public safety. It is also the most cost-effective preventive maintenance model used by M&C.

Examples of OH Inspection Minor Work

Examples of OH Minor Work are grouped **below 8 feet** for Inspectors who do not have bucket trucks and **above 8 feet** for those who do have bucket trucks.

- **Below 8 feet**
 - (1) Anchor - Adjust/Repair
 - (2) Ground - Repair/Replace
 - (3) Guy - Adjust/Repair/Trim
 - (4) Marking - Install/Replace
 - (5) Molding -Install/Repair/Replace
 - (6) Pole Step - Install/Remove
 - (7) Tree – Trim
 - (8) Unauthorized Attachments – Remove
- **Above 8 feet**
 - (1) Conductor - Adjust/Repair/Replace
 - (2) Connector – Replace
 - (3) Crossarm – Repair
 - (4) Ground - Repair/Replace
 - (5) Guy - Adjust/Repair/Replace
 - (6) Guy - Install/Trim Veg.





- (7) Hardware - Repair/Replace
- (8) High Sign - Install
- (9) Marking - Install/Replace
- (10) Molding -Install/Repair/Replace
- (11) Pole – Repair
- (12) Streetlight - Install/Repair/Replace
- (13) Tie Wire - Replace
- (14) Tree – Trim
- (15) Unauthorized Attachment – Remove

Requirements for Minor Work during Inspections

The Compliance Inspector performs Minor Work during Inspections when the following conditions **are met**:

- It is **safe** to do so.
- You have appropriate tools.
- The facility has no Pending EC Notification, or you **can** complete all FDAs as minor work.

There are three (3) scenarios when clearing excessive vegetation as Minor Work is **not appropriate**.

Scenario: OH Inspection

IF there is **too much** vegetation to be cleared safely,

THEN Use an EC Form to identify that you cannot complete the OH Inspection until the vegetation is removed. In this case you would use these FDAs:

- FDA 1: OH Facility, Limited Access, Inspect
- FDA 2: Tree/Vine, Clearance, Remove
- Default Priority 'B' Tag, **not to exceed the CPUC Due Date** for the Map



Requirements for Minor Work during Patrols

Generally, Minor Work is **not** performed during a patrol.

The Compliance Inspector performs Minor Work during Patrols when the following conditions **are** met:

1. It is **safe** to do so.
2. You have appropriate tools.
3. There **is** a safety hazard.

During Patrols, there are only two (2) scenarios when Minor Work should be performed by the Compliance Inspector.

Scenario 1: Safety Hazard / Pending EC Notification

IF a Pending EC Notification FDA is a safety hazard

THEN Use the Pending EC Notification shop paper to record the minor work completed by you.

- (a) Check the boxes titled 'Completed'
- (b) Date and sign the Pending EC Notification

Scenario 2: Safety Hazard / Able to make safe.

IF a safety hazard can be fixed with Minor Work,

THEN Use the OH/UG Minor Work Form to record the minor work.



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

Minor Work Process

1. Preparing For Daily Work

- Make sure you have safety equipment, tools, and materials so you can perform **Minor Work** while performing inspections.

2. During an Inspection

- After you have determined that Minor Work can be done **safely**, complete all Minor Work repairs for the facility.

- For each facility, you may perform Minor Work

Note: Be sure to confirm with your PS&R office to confirm how many hours you are authorized to perform Minor Work.

4. After an Inspection

- Use your Timecard to record the time worked on this map.



Recommended Work Flow Steps

1. While working your map, do so in accordance with safety practices
2. Inspect the facility
3. Determine if Minor Work is appropriate
4. Observations may include one of these **six (6) scenarios**:

Scenario 1: Minor Work Not Required IF there are **no** compelling abnormal conditions or regulatory conditions,

- THEN** (1) Complete in Inspection App
(2) Move to next facility

Scenario 2: Minor Work Required / No Pending EC Notification

IF you **can resolve all** compelling abnormal conditions and/or regulatory conditions

- THEN** (1) Perform Minor Work
(2) Use the appropriate Minor Work Form to record your work
(3) Complete in Inspection App
(4) Move to next facility

Scenario 3: Complete Pending EC Notification

IF you **can resolve all** compelling abnormal conditions and/or regulatory conditions by completing all FDAs on a Pending EC Notification as Minor Work

- THEN** (1) Perform maintenance repairs as Minor Work
(2) Complete FDAs on Pending EC Notification
(3) Complete in Inspection App
(4) Move to next facility

Scenario 4: Update Pending EC Notification

IF there are new Minor Work activities identified by you, but they are **not** listed on the Pending EC Notification

- THEN** (1) **Do not** perform any Minor Work
(2) Add new FDAs to the Pending EC Notification
(3) Complete in Inspection App
(4) Move to next facility



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

Note 1: If the minor work is an immediate safety hazard, then perform the repair to make safe (for example, exposed ground in the first 8 feet with access to the public).

If the FDA you repaired is on the Pending EC, then complete the FDA on the EC and write “**Minor Work completed to make safe**” in the comment section.

Note 2: The crew, responding to the EC Notification, will perform the Minor Work. In this case, an FDA for the Minor Work is included in the Pending EC Notification.

Scenario 5: Write New EC Form

IF Minor Work **cannot resolve all** abnormal conditions and/or regulatory conditions that require an EC Notification

THEN (1) **Do not** perform any Minor Work

- (2) Use the EC Notification to document conditions
- (3) Complete in Inspection App
- (4) Move to next facility

Note 1: If the minor work is an immediate safety hazard, then perform the repair to make safe (for example, exposed ground in the first 8 feet with access to the public). Use the appropriate Minor Work Form to document the make safe repair work.

Note 2: The crew, responding to the EC Notification, will perform the Minor Work. In this case, an FDA for the Minor Work is included in the EC Form.

Scenario 6: New EC Work Form for Capital Minor Work

IF you completed Capital Minor Work (OH Full-Service Replacement)

THEN (1) Indicate the Location on your map.

- (2) Use the EC Notification to document conditions and complete the EC Notification
- (3) Complete in Inspection App
- (4) Move to next facility



Access and Confirmations

This section outlines the requirements for an inspection to occur on a pole. If any of the following are not possible, please answer the question “Were you able to complete an Inspection” “NO” and follow prompts in App to record the reason.

Determine if structure and associated conductor is accessible.

OH Inspections: Inspection Requirements

- You must be at the structure, achieve a 360-degree view of the entire structure from bottom to the top.
- You are required to view all conductor(s) to mid-span or to the weather-head or to the termination point –
- If you are unable to perform the two tasks above, you will be required to create a CGI notification in the Inspect App

Determine if the structure is an inspectable or not inspectable structure type.

1. Inspectable Structures: (Answer Yes to were you able to complete an inspection)
 - a. Distribution Pole/Tower: Includes Push Pole (Non-Haloed Push Poles perform Ad-Hoc process)
 - b. Transmission Pole with Distribution Underbuilds (Steel or Wood)
 - c. Idle Pole
 - d. Streetlight on Distribution Pole
 - e. Tree-Connect

Note: 2 Photos of ENTIRE structure are required for each of the above types (including trees and transmission underbuilds). It is acceptable to not be able to see the entire structure top to bottom in the photos as long as inspector is able to inspect the structure top to bottom.

Likewise, when taking photos of top third/ Middle Third/ and Bottom Third. Consider the thirds of the ENTIRE structure as well (including top of transmission pole or tree)

2. Not inspectable (Follow Asset Discrepancy Steps)
 - a. Structure does not exist in the field.
 - b. Structure is in the field; Structure is Customer-Owned. It is inspected by the Customer.
 - c. Structure is in the field; Pole is a streetlight-only pole. It is inspected by another program.
 - d. Structure is in the field; Pole is a Communication-only pole. It is inspected by another program.
 - e. Structure is in the field; Pole is a Transmission-only pole. It is inspected by another program.



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atrch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

A detailed inspection includes the following:

- Perform field inspection
- Assess field conditions
- Identify and record compelling abnormal conditions, regulatory conditions, and third-party caused infractions that negatively impact safety or reliability.
- Take photos of field conditions and PG&E assets
- Complete and document your inspection results, observations, findings, & photos
- Validate Pending EC Notifications when required

Note: A structure is accessible as long as inspector is able to get a visual 360 of the structure and full view of its conductors midspan in all direction and connection to the termination. It is understandable that photos of the structure and conductors may include vegetation obstructing the view of part of the pole or conductor; this is not a CGI.



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14





Climbing Space

Climbing Space – Obstructed

General Guidance: Evaluate pole to determine whether there is an obstruction caused by PG&E facilities or by third party facilities that is causing a compelling safety issue – based on the location of the pole and exposure to the worker - that needs to be addressed in 5 years.

Example: Equipment pole that cannot be accessed in a bucket truck.

Example: Pole in rear easement with secondary or service connection failures.

Example: where the climbing space **is not** a compelling condition: Equipment pole that is accessible 100% of the time in a bucket.

For PG&E obstructions: Create an EC notification.

For third party obstructions: Create a third-party notification if they pose a significant safety hazard.

If a third-party obstruction is causing an emergency safety or reliability issue, contact your supervisor for instructions.

Minor Work: No

EC Notification: Yes, if not able to perform minor work

Third Party Notification: Yes, if obstructed by third party

Select the Priority and Due Date based upon compelling abnormal condition that may adversely impact public safety and/or service reliability.

Related Documents: [066210](#)



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

Examples

COMMUNICATION IN CLIMBING SPACE




At this Location:

Obstructed climbing space, access via bucket truck from street below. Also, look for clearance issues between communications facilities and the PG&E down guys.

**Perform Minor Work:** No**Write 3rd Party Notification:** No**Write EC Notification:** No

CLIMBING SPACE OBSTRUCTED

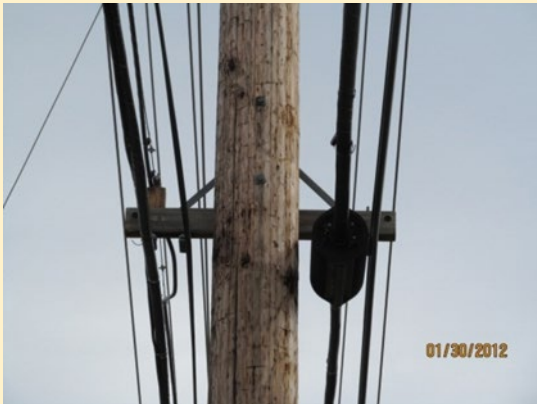

At this Location:

Climbing space obstruction by communication facilities on pole with equipment. Communication messengers are too close. No bucket truck access.

**Perform Minor Work:** No**Write 3rd Party Notification:** Yes**Write EC Notification:** No



Climbing Space – Obstructed by Vegetation

General Guidance: For incidental vegetation in climbing space that can be moved when climbing, or quickly cleared prior to climbing, no action is required.

For major vegetation that cannot be quickly cleared or moved prior to climbing, evaluate the pole:

- Is there supply equipment on the pole that may need to be operated during emergency conditions?
- Should the obstruction be cleared for any other safety or reliability reason?

If the answer is yes to any of these questions, the inspector will need to create an EC Notification to clear vegetation unless it can be addressed as minor work.

Minor Work: Yes

EC Notification: Yes, if not able to perform minor work

Select the Priority and Due Date based upon compelling abnormal condition that may adversely impact public safety and/or service reliability.

Related Documents: [066210](#)



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

Examples

OBSTRUCTED CLIMBING SPACE	CLIMBING SPACE OBSTRUCTED
	
<p>At this Location: Obstructed climbing space. Inspector cannot see enough of the pole to complete Inspection (heavy vegetation, cannot see through). No equipment on pole. The only reason to address is to complete the inspection.</p> 	<p>At this Location: Climbing space obstruction, able to perform inspection, no equipment on pole (able to see guys, able to see up the pole under tree)</p> 
Perform Minor Work: No	Perform Minor Work: No
Write 3rd Party Notification: No, only need clearing to perform inspection	Write 3rd Party Notification: No
<p>Write EC Notification: Yes</p> <p>FDA = OH Facility / Limited Access/Obstruct / Inspect (Primary)</p> <p>FDA= OH Facility / Limited Access/Obstruct / Remove</p> <p>Priority = B tag, 0-3 months depending upon exposure; must complete before CPUC due date for map</p>	<p>Write EC Notification: No</p>









Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

POLE WITH VEGETATION	IVY COVERED POLE
	
At this Location: 360° pole inspection not possible  	At this Location: 360° pole inspection not possible  
Perform Minor Work: No	Perform Minor Work: No
Write 3rd Party Notification: No	Write 3rd Party Notification: No
Write EC Notification: Yes FDA = OH Facility / Limited Access/Obstruct / Inspect (Primary) FDA = OH Facility / Limited Access/Obstruct / Remove Priority = B Tag, depending upon exposure; must complete before CPUC due date for map	Write EC Notification: Yes FDA = OH Facility / Limited Access/Obstruct / Inspect (Primary) FDA = OH Facility / Limited Access/Obstruct / Remove Priority = B Tag, depending upon exposure; must complete before CPUC due date for map



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

Ad hoc Inspection Process

General Guidance: The Ad hoc Inspection Process can be used for any unmapped distribution structure i.e., a structure without an SAP number.

Warning: Once Ad hoc inspection process is submitted, there is **NOT** a process to cancel if a mistake is made. The cancellation must be done manually by a distribution asset strategist by emailing DistributionAssetStrategist@pge.com.

In the Inspect App:

Come across a Distribution Structure / Tree Connect that is unmapped within the map and have already started the work order:

1. Investigate to ensure that the structure is not located somewhere else on the map.
 - a) If mapped but in the wrong location:
 - Perform the inspection on the map structure and create a map change to move the structure to the correct location.
 - b) If confirmed unmapped
 - On map screen long touch screen at the exact location that the structure exists to drop a pin.
 - Actions Button
 - Start Ad hoc Inspections Button
 - Complete "Add-Pole" Map correction form.
 - Complete Inspection Form

Note: Customer owned pole should only be selected when the pole being inspected is customer owned with PG&E equipment.



Poles/Structures

General Guidance: Is the pole damaged, broken, rotten, cracked outside what would be considered normal, leaning beyond 10%, or needing to be identified for any other reason? If yes, create EC notification.

Observations in the field may include the following situations:

- Leaning Pole
- Reduced Circumference
- Split (Vertical Separation)
- Overload (Bent)
- Decayed / Rotten
- Woodpecker
- Cross-section or Horizontal Crack
- Soil Excessively Eroded or Washed Away at Base of Pole
- Transmission Poles with Distribution Underbuilds
- Solely Owned Poles with Third-Party Utility Attachments
- Intumescent Pole Covers

The following guidance is to ensure adherence to G.O. 95 Rule 44.3 and 47.3:

Pole Damage– At any attachment level on the pole, evaluate the below conditions to determine if the criteria are met for an EC tag:

- Multiple vertical cracks in the same proximity to each other
- Pole twist causing spiral cracks.
- Checks causing an un-natural taper to the exterior diameter of the pole (checks being forced opened).
- Hardware sinking into the pole, e.g., not naturally sitting on the outside of the pole.
- Multiple issues existing on a single structure, e.g., Pole degradation, insect/woodpecker damage, and/or any other abnormal compelling conditions.

X Tag - Details on these conditions are described in tables and flowcharts below

1. Bent or overloaded horizontal break condition. Refer to flow chart in Overload (Bent) section.
2. Loss of circumference >30%
3. Pole is leaning >20%
4. Vertical Cracks, splits, or damage that are impacting the structural integrity on any attachment points where hardware has moved from its original installation location and no split bolt in proximity.



E Tag

Consider a higher priority depending on condition of the pole and exposure.

1. Horizontal Break in the grain or cuts that meet criteria. See flow chart below.
2. Vertical Cracks, splits, or damage at any attachment points **impacting structural integrity that are loose (compelling abnormal condition)**, regardless of the existence of a split bolt.
3. Substantial deterioration or damage present inside the vertical cracks or splits.
4. Vertical cracks that split the pole in half and you can see through.

Related Documents: [TD-2305M](#) EDPM Pole Inspection, [TD-2325S](#), [066209](#), [G.O. 95 Rule 44.3 and 47.3](#).

Definitions:

1. **Buckling** at the ground line or an unusual angle with respect to the ground may indicate that the pole has rotted or is broken.
2. **Cracks** -
 - a. **Horizontal cracks (Breaks)** perpendicular to the grain of the wood may weaken the pole.
 - b. **Vertical cracks**, although not normally considered to be a sign of a defective pole, can pose a hazard to the climber, and the employee should keep his or her gaffs away from them while climbing.
3. **Checks (Vertical)** are a natural separation of the wood normally occurring across or through the rings and usually as a result of seasoning. Surface seasoning checks have a negligible effect on all strength properties.
4. **Splits (Vertical)** are a separation of the wood through the piece to the opposite surface or to an adjoining surface due to the tearing apart of the wood cells.
5. **Holes**. Hollow spots and woodpecker holes can reduce the strength of a wood pole.
6. **Shell rot and decay**. Some poles have a strong outside shell and a center more susceptible to internal decay or 'heart rot', Others have a strong center and tend to decay externally, called 'shell rot.'
7. **Knots**. One large knot or several smaller ones at the same height on the pole may be evidence of a weak point on the pole.
8. **Depth of setting**. Evidence of the existence of a former ground line substantially above the existing ground level may be an indication that the pole is no longer buried to a sufficient depth.
9. **Burn marks**. Burning from transformer failures or conductor faults could damage the pole so that it cannot withstand changes in mechanical stress



Leaning Pole


General Guidance: Consider the following when evaluating a leaning pole:

- Lean vs Bend: Lean is a foundational issue where the structure is straight and not bent. Bend is where the structure has a curve.
- Is the leaning pole causing excessive conductor sag or reduced clearance issues that could result in contact, fire risk, or public safety?
- Does the lean appear as if it will become worse or affect safety (considering environmental and configuration factors -soil, wind, pole attachments, equipment, guying)?

Note: If the Inspector suspects that a third-party attachment is causing the pole to lean, consider writing a Third-Party Utility notification in addition to an EC Notification.

Select the Priority and Due Date based on flow chart and field conditions.

Related Documents: [023058](#), [TD-2014S](#) – Third Party Damage, [030109](#) – Mud Sill

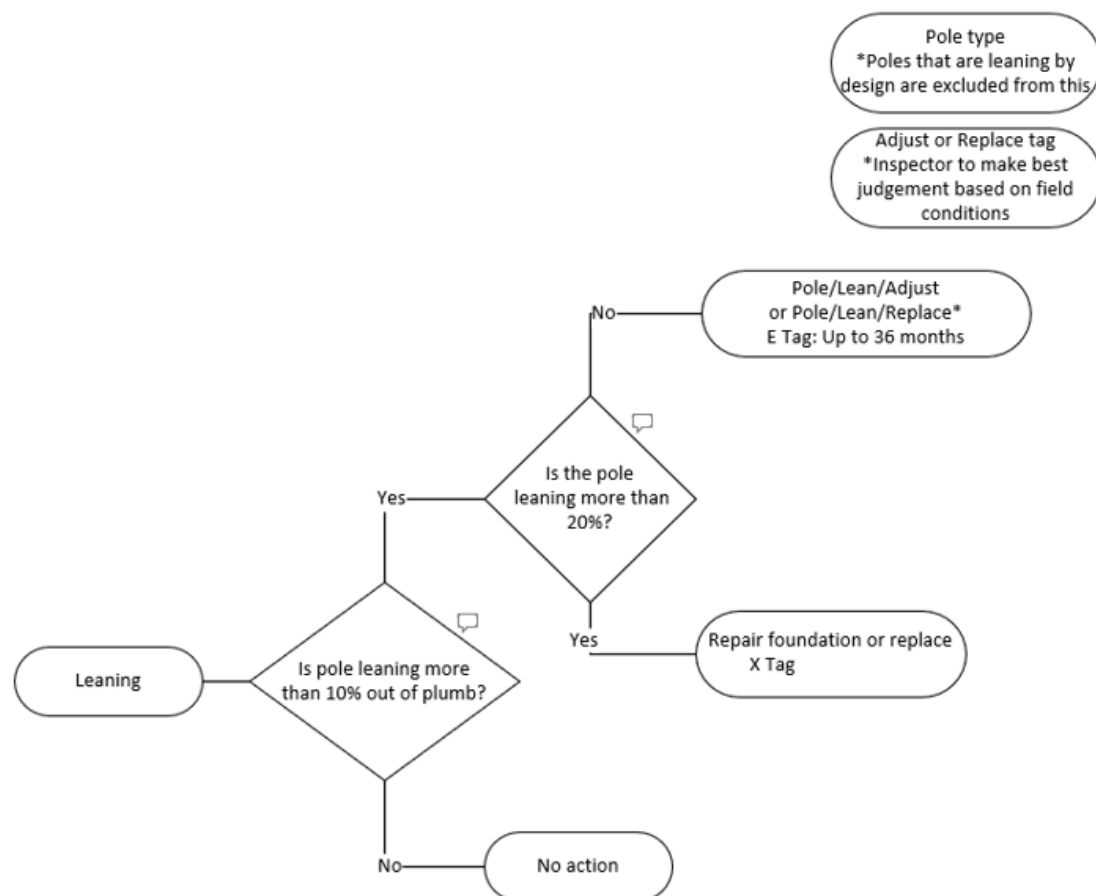



Job Aid: Overhead Assessment







TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atrch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

Examples

LEANING POLE	LEANING SLACK SPAN
	
<p>At this Location: Leaning pole greater than 10% out of plumb. No equipment, in rural area.</p> <p> </p>	<p>At this Location: Leaning towards a tree more than 10% and less than 20% out of plumb. Inspector pulled plug and confirmed pole is solid below ground.</p> <p> </p>
<p>Perform Minor Work: No</p>	<p>Perform Minor Work: No</p>
<p>Write 3rd Party Notification: No</p>	<p>Write 3rd Party Notification: No</p>
<p>Write EC Notification: Yes FDA= Pole / Leaning / Adjust</p>	<p>Write EC Notification: Yes FDA= Pole / Leaning / Replace</p>
<p>Priority= Minimum E Tag, depending on exposure</p>	<p>Priority= Minimum E Tag, depending on exposure</p>









Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003A1ch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

STUBBED POLE LEANING TOWARDS SCHOOL	POLE BENDING 3 POT TRANSFORMER IN BUCK POSITION
	
<p>At this Location: Stubbed pole leaning more than 10% and less than 20% towards school, supported by down guy. Pole Bands are loose due to additional deterioration of the pole.</p>  	<p>At this Location Pole is leaning less than 10% out of plumb, bending in direction of offset equipment. Go to overload (bent) flow chart.</p>  
Perform Minor Work: No	
Write 3rd Party Notification: No	
Write EC Notification: Yes FDA= Pole / Lean / Replace Priority= Minimum E Tag, consider shorter duration due to exposure	



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

LEANING POLE



At this Location: Leaning pole greater than 20% out of plumb. No equipment, in rural area.



Perform Minor Work: No

Write 3rd Party Notification: No

Write EC Notification: Yes

FDA= Pole / Leaning / Adjust

Priority= Minimum X Tag, depending on exposure.

POLE LEANING NEAR RAILROAD TRACKS



At this Location: Severe lean greater than 20% with low conductor over railroad.



Perform Minor Work: No

Write 3rd Party Notification: No

Write EC Notification: Yes

FDA= Pole / Lean / Replace

Priority= A Tag, follow the emergency process



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

STUBBED POLE – DOES NOT NEED REPAIR



At this Location: Metal stubbed pole.

Refer stub pole procedure.



Perform Minor Work: No

Write 3rd Party Notification: No

Write EC Notification: No

Cross-section or Horizontal Crack

General Guidance: Slice is a reduction in cross sectional area. It could be horizontal and can include mechanical damage, horizontal cracks, or cuts into pole. Circumferential damage to only 1 side of the pole. If the damage is large enough in relation to the size of the pole, write EC tag for Pole / Broken / Damage / Replace. In the long text of the EC notification, document approximate percentage of damage to circumference.


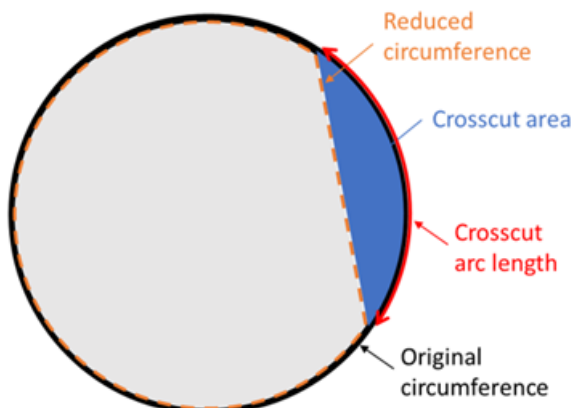


Figure 1: Schematics of a Pole Cross Section



Figure 2: Definition of Crosscut Arc Length

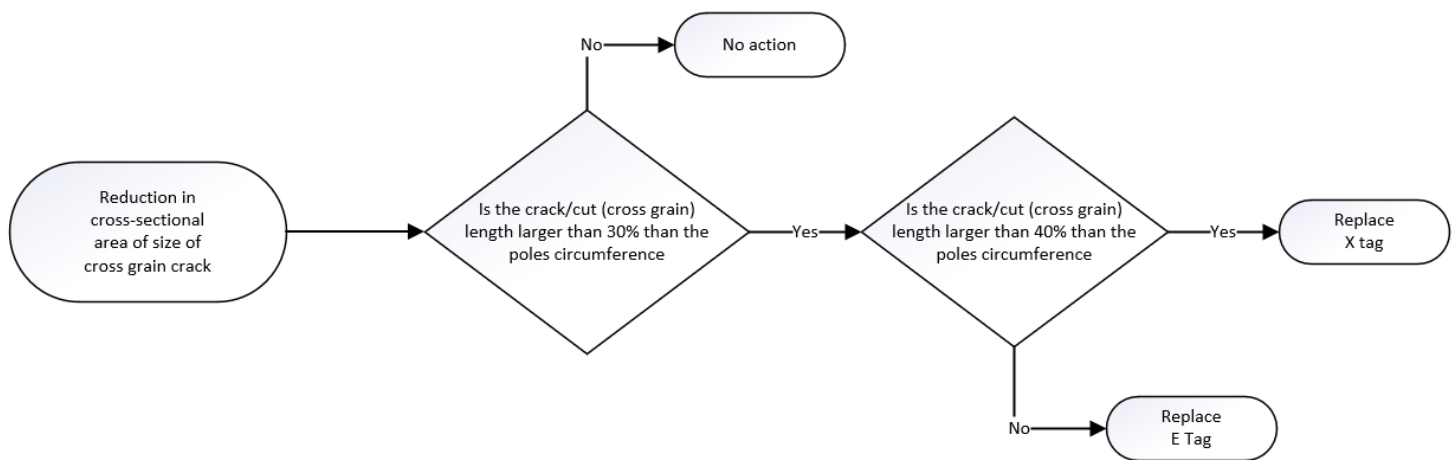

Job Aid: Overhead Assessment




TD- 2305M-JA02





WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

Examples

BROKEN POLE	
	At this Location: Broken pole, not supported.  
	Perform Minor Work: No
	Write 3rd Party Notification: No
	Write EC Notification: Yes FDA= Pole / Broken/Damaged / Replace Priority= A Tag, Follow the Emergency Procedure Note: Flow chart doesn't lead us here, but inspector should use knowledge as a lineman to identify

CUT INTO POLE	
	
At this Location: Vandalized pole. Chain saw cut into lower portion of pole. Arc length 20 inches (>40% circumference)  	
Perform Minor Work: No	
Write 3rd Party Notification: No	
Write EC Notification: Yes FDA= Pole / Broken/Damaged / Replace Priority= A Tag, Follow the emergency process due to damage claim.	



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

VEHICLE DAMAGE, TEMP REPAIRS MADE



At this Location: Pole damaged by vehicle. Cross-arm acting as Splint installed as temporary repair. Circumference of pole at base is 32 inches. Arc length of damage is 18 inches. (>40% circumference)



Perform Minor Work: No

Write 3rd Party Notification: No

Write EC Notification: Yes

FDA= Pole / Broken/Damaged / Replace

Priority= Minimum E Tag, depending on exposure



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

SIGNIFICANT ARC LENGTH DAMAGE (TRACTOR DAMAGE)



At this Location: Significant arc length damage (Tractor Damage). Refer to reduction in cross-sectional area flow chart.



Perform Minor Work: No

Write 3rd Party Notification: No

Write EC Notification: Yes

FDA= Pole / Broken / Damage / Replace

Priority= Minimum E Tag, depending on exposure

CUT INTO POLE



At this Location: Cut into pole. Not a deep cut, no strain on pole, no public exposure. Refer to reduction in cross-sectional area flow chart above.



Perform Minor Work: No

Write 3rd Party Notification: No

Write EC Notification: Yes

FDA= Pole / Broken/Damaged / Replace

Priority= Minimum E Tag, depending on exposure



Reduced Circumference

General Guidance: Does pole have significant reduced circumference in the bottom ~8 feet? Circumference reduction should be more or less uniform (hourglass).

For example, animal, burnt, or shell rot. If uniform circumference loss is significant, inspector should measure the circumference. When measuring, measure the circumference of the healthy part of the pole nearest the damage minus the circumference of the damaged part of the pole. Divide the difference by the circumference of the healthy part of the pole.

$$\frac{(\text{circumference of healthy part}) - (\text{circumference of damage part})}{(\text{circumference of healthy part})} = \% \text{ circumference loss}$$

No Action	E Tag	X tag
0-10%	10-30%	>30%

Reference ATS 2325P-01



Job Aid: Overhead Assessment




TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

Examples

SIGNIFICANT REDUCED CIRCUMFERENCE (BEAR DAMAGE)		
		At this Location: Significant Reduced Circumference (Bear Damage). Temporary Repairs made.  
		Perform Minor Work: No
		Write 3rd Party Notification: No
		Write EC Notification: Yes FDA= Pole / Broken/Damaged / Replace Priority= X Tag, depending on exposure



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

BURNT POLE



At this Location:

Pole is burnt. Scrape pole to ensure circumference is not impacted.



Perform Minor Work: No

Write 3rd Party Notification: No

Write EC Notification: No

DAMAGE TO POLE FROM SPECIFIC EVENT



At this Location:

Pole has reduced circumference; healthy wood has 32 inches and damaged section has 27 inches.
Pole= ~15% circumference reduction



Perform Minor Work: No

Write 3rd Party Notification: No

Write EC Notification: Yes

FDA= Pole / Broken/Damaged / Replace

Priority= Minimum E Tag, depending on exposure



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14







Split (Vertical Separation)

General Guidance: Please refer to beginning of this Pole section.

Split at Communication Level, whole length or location near an equipment supporting structure.

A vertical "Check" is a normal process of wood pole drying out. See example below.

Examples

POLE SPLIT AT COMMUNICATION LEVEL	POLE CHECK
	
<p>At this Location: Pole split, can see daylight through pole at communication level. Joint pole.</p>  	<p>At this Location: Pole Check, structural integrity not compromised. Natural cracking on the pole. Not due to strain or loading.</p>  
Perform Minor Work: No	Perform Minor Work: No
Write 3rd Party Notification: No	Write 3rd Party Notification: No
Write EC Notification: Yes FDA= Pole / Broken/Damaged / Replace Priority= B Tag, depending on exposure	Write EC Notification: No



Job Aid: Overhead Assessment


TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

POLE SPLIT

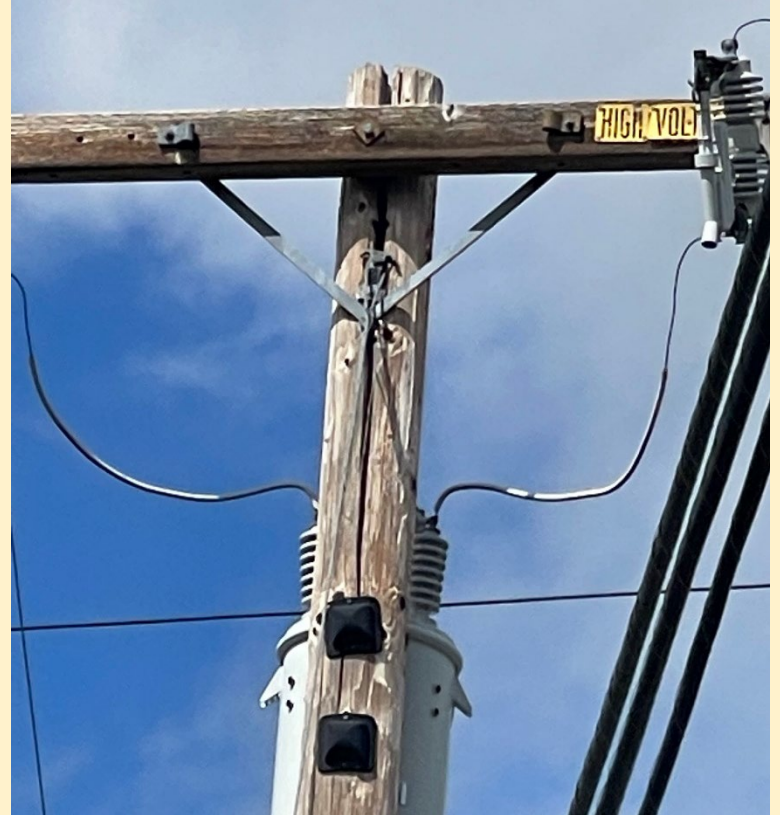

At this Location: Pole top split and can see daylight. Dead end single guy, down guy fixture has moved and slid down from original location onto the brace. Cross-arm brace hardware also compromised. No split bolt.



Perform Minor Work: No

Write 3rd Party Notification: No

Write EC Notification: Yes

FDA= Pole / Broken/Damaged / Replace

Priority= X Tag, depending on exposure.



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atrch02
Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

POLE SPLIT



At this Location: Checks are opening on the pole at the equipment level. Multiple checks, possible movement on the cross-arm hardware, at the brace bolt on the top cross-arm. Hardware sinking in, pole twist spiral.



Perform Minor Work: No

Write 3rd Party Notification: No

Write EC Notification: Yes

FDA = Pole / Broken/Damaged / Replace

Priority = Minimum E Tag, depending on exposure



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atrch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

POLE SPLIT



At this Location: Split in the pole top has been corrected with a split bolt, but the dead end has moved and is laying on top of the split bolt.



Perform Minor Work: No

Write 3rd Party Notification: No

Write EC Notification: Yes

FDA = Pole / Broken/Damaged / Replace

Priority = Minimum E Tag, depending on exposure.



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

POLE CHECKS



At this Location: Pole Checks. Multiple vertical cracks running down pole are not at the points of attachment affecting the hardware. No compelling abnormal conditions to report.



Perform Minor Work: No

Write 3rd Party Notification: No

Write EC Notification: No



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02
Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

POLE CHECK



At this Location: Pole checks at the equipment level attachments but not affecting the hardware. Not a compelling abnormal condition.



Perform Minor Work: No

Write 3rd Party Notification: No

Write EC Notification: No



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14


Overload (Bent)

General Guidance:

For deformed poles, follow the flow chart below to determine action.

Common drivers for deformed poles: Improper/lack of guying, third party attachment.

Review clearances to verify no reduced clearance issues, all levels of clearance requirements that could result in contact, fire risk, or public safety.

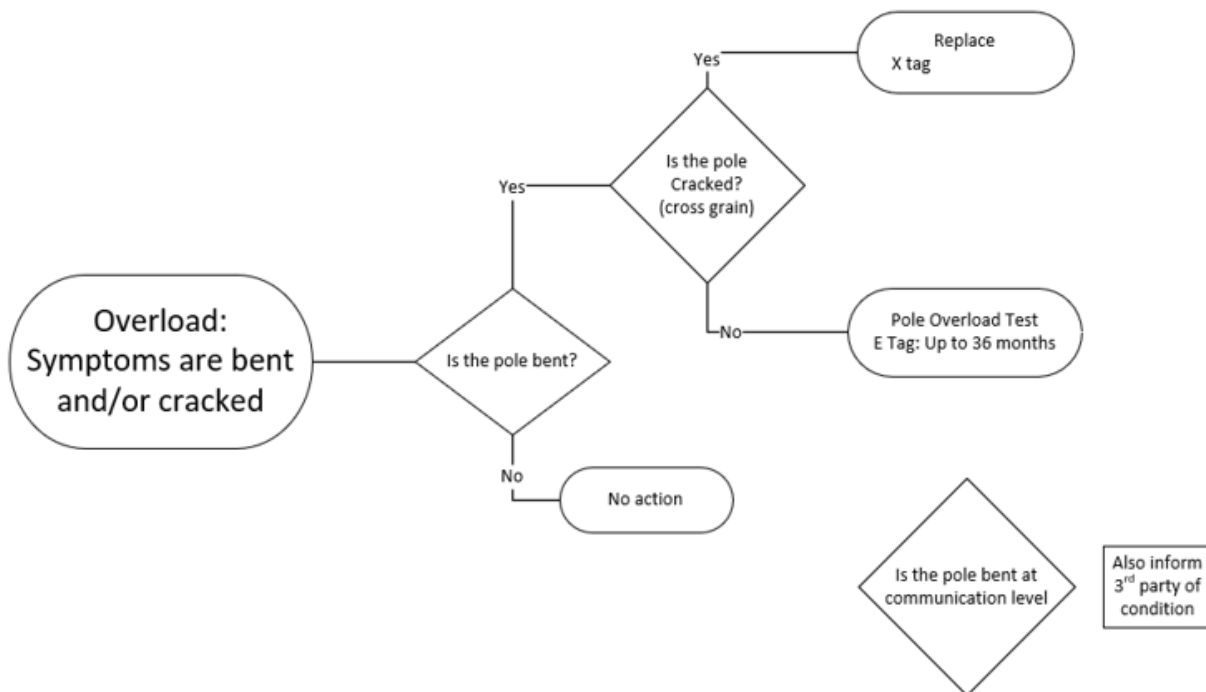

Minor Work: No

EC Notification: Follow flow chart.

Select the Priority and Due Date based upon compelling abnormal condition that may adversely impact public safety and/or service reliability.

Related Documents: [TD-2305M](#) EDPM Pole Inspection



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

Examples

POLE BENT 4 FEET OUT OF LINE



At this Location: Pole is bent 4 feet out of line and has horizontal crack. Deformed in the middle of the pole, towards vegetation.



Perform Minor Work: No


Write 3rd Party Notification: No

Write EC Notification: Yes

FDA= Pole/Broken/Damage/ Replace

Priority= X Tag, depending on exposure

INADEQUATE SUPPORT AT COMMUNICATIONS LEVEL

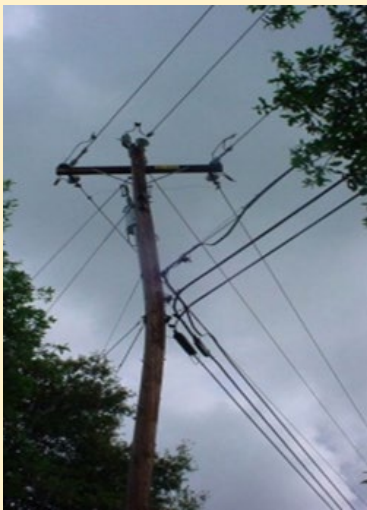

At this Location: Pole is bent at communication level. No horizontal crack. Two guys stabilizing communication level.



Perform Minor Work: No

Write 3rd Party Notification: Yes

Write EC Notification: Yes

FDA= Pole / Overload / Test

Priority= Minimum E Tag, depending on exposure.

Note: Needs both EC and Third-Party notifications









Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

OVER STRESSED POLE	UNBALANCED LOAD AT TOP
	
<p>At this Location: Pole is twisted, cracked, due to communication. Field comments "overloaded by communications". No horizontal crack.</p>  	<p>At this Location: Deformed pole with bowed top in line with conductor. No horizontal crack visible.</p>  
Perform Minor Work: No	Perform Minor Work: No
Write 3rd Party Notification: Yes	Write 3rd Party Notification: No
Write EC Notification: Yes FDA= Pole / Overload / Test	Write EC Notification: Yes FDA= Pole / Overload / Test
Priority= Minimum E Tag, depending on exposure.	Priority= Minimum E Tag, depending on exposure.









Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atrch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

OVERLOAD BENT	
POLE BROKEN AT THE COMMUNICATION LEVEL	POLE BENT AT MIDDLE SECTION
	
At this Location: Pole is bent and has horizontal crack. Pole broken at the communication level.  	At this Location: Pole is bent, but not cracked. Broken pole, Supported by guy.  
Perform Minor Work: No	Perform Minor Work: No
Write 3rd Party Notification: No	Write 3rd Party Notification: No
Write EC Notification: Yes FDA= Pole / Broken/Damaged / Replace Priority= X Tag	Write EC Notification: Yes FDA= Pole / Overload / Test Priority= Minimum E Tag, depending on exposure.



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atrch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

POLE BENDING 3 POT TRANSFORMER IN BUCK POSITION



At this Location: Pole is leaning less than 10% out of plumb, bending in direction of offset equipment. Pole is not cracked.



Perform Minor Work: No

Write 3rd Party Notification: No

Write EC Notification: Yes

FDA= Pole / Overload / Test

Priority= Minimum E Tag, depending on exposure.



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02






Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

Decayed / Rotten

General Guidance: Please refer to beginning of this Pole section.

Examples

DECAY OF POLE OVER TIME	SEVERE DETERIORATION AT GROUND LEVEL
	
At this Location: Pole top decayed 	At this Location: Deteriorated condition found during inspection. High public exposure.  
Perform Minor Work: No	Perform Minor Work: No
Write 3rd Party Notification: No	Write 3rd Party Notification: No
Write EC Notification: Yes FDA= Pole Decayed / Rotten / Replace Priority= B Tag, depending on exposure	Write EC Notification: Yes FDA= Pole Decayed / Rotten / Replace Priority= A Tag



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atrch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

DECAY OF POLE OVER TIME – AERIAL VIEW



At this Location: Pole top decayed.



Perform Minor Work: No

Perform Minor Work: No

Write 3rd Party Notification: No

Write 3rd Party Notification: No

Write EC Notification: Yes

Write EC Notification: Yes

FDA= Pole Decayed/Rotten/Replace

FDA= Pole Decayed / Rotten / Replace

Priority= X Tag

Priority= B Tag, depending on exposure



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

DECAY OF POLE OVER TIME – AERIAL VIEW



At this Location: Pole top decayed.



Perform Minor Work: No

Write 3rd Party Notification: No

Write EC Notification: Yes

FDA= Pole Decayed/Rotten/Replace

Priority= Minimum E Tag, depending on exposure.



Job Aid: Overhead Assessment


TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

DECAYED POLE, MULTIPLE ISSUES

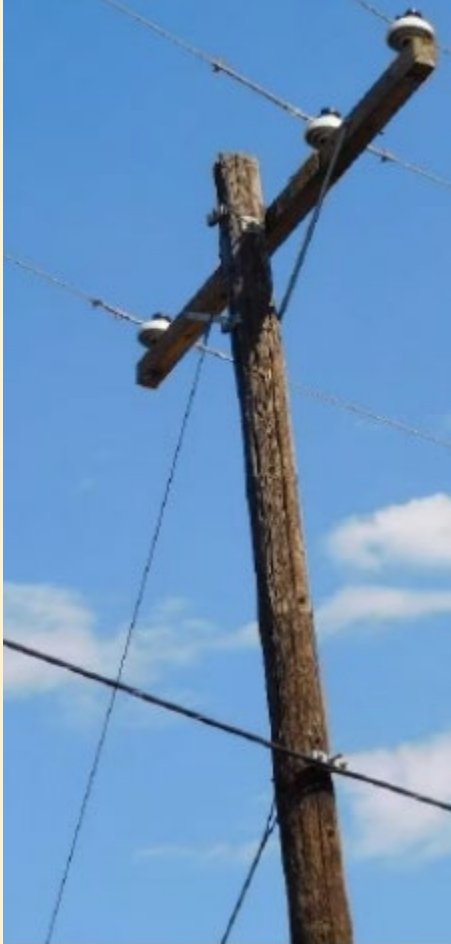

At this Location: Pole has multiple conditions: Pole in poor condition, decayed, and extensive weathering, and pole top rot. Pole checks alone are not a compelling abnormal condition, but in combination with all the other conditions, write EC tag.



Perform Minor Work: No

Write 3rd Party Notification: No

Write EC Notification: Yes

FDA = Pole Decayed / Rotten / Replace

Priority = Minimum E Tag, depending on exposure.



Woodpecker

General Guidance: Visually inspect poles for woodpecker damage based on the flow chart below.

- A through hole counts as two holes
- A filled hole is still considered a hole.
- Consider reframe instead of replacing where possible.



Minor Work: No

Write 3rd Party Notification: No

EC Notification: Refer to flow chart for EC priority.

Reference: [066209 – Repair of Damaged Pole Tops](#)

Per [066209](#):

Active Nests:


- Active Nests are ones with eggs or young in them.
- Do not disturb active nests unless they present an immediate safety or operating hazard.

Inactive Nests:

- Inactive nests are those nests without viable eggs or young.
- Inactive nests, except eagle nests or T&E (threatened and endangered) species' nests, can be removed; however, do not keep an inactive nest without notifying avian program management personnel or governmental agencies. Nests may be difficult to identify.

If there is any uncertainty about the type of nest, contact Lead / Supervisor or the avian program management personnel or the Bird Hotline at (415) 973-9453 for assistance with an active nest removal or relocation.

Figure 1: Pole Cross Section Showing Two Example of Modeled Edge Distances

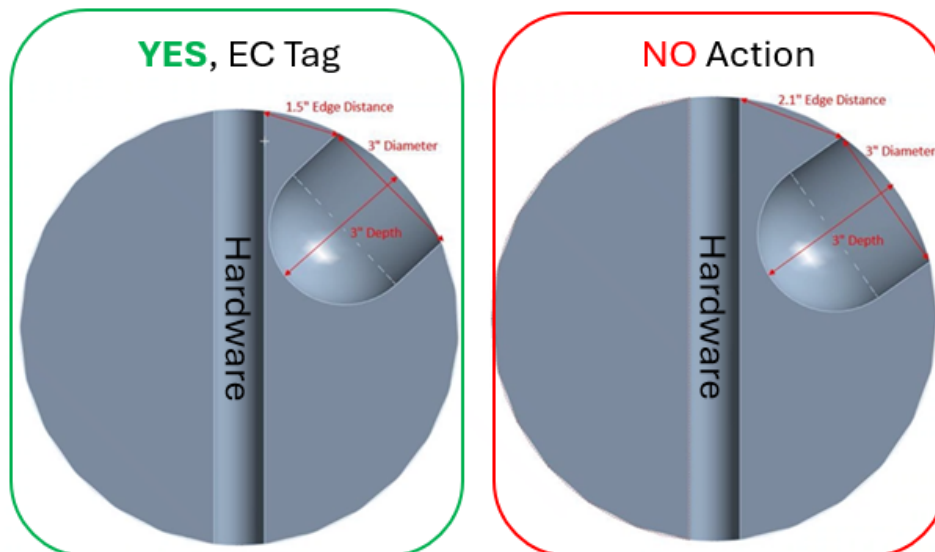



Job Aid: Overhead Assessment




TD- 2305M-JA02




WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

Examples

WOODPECKER DAMAGE <1 INCH HOLES	
	At this Location: Holes are less than 1 inch in diameter and acorn/feeder holes cover more than 50% of the pole surface in a 3 ft section.  
	Perform Minor Work: No
	Write 3rd Party Notification: No
	Write EC Notification: Yes FDA= Pole / Woodpecker Damage / Replace Priority= Minimum E Tag, depending on exposure.

WOODPECKER DAMAGE 1-3 INCH HOLES	
	At this Location: There are multiple holes that the sum of the holes widths is greater than 9 inches in any 1 ft section.  
	Perform Minor Work: No
	Write 3rd Party Notification: No
	Write EC Notification: Yes FDA= Pole / Woodpecker Damage / Replace Priority= Minimum E Tag, depending on exposure.



WOODPECKER DAMAGE 1-3 INCHES



At this Location: The sum of the holes are less than 9 inches. Woodpecker holes are within 2 inches of the attachment hardware on the surface of the pole.



Perform Minor Work: No

Write 3rd Party Notification: No

Write EC Notification: Yes

FDA= Pole / Woodpecker Damage / Replace or Pole / Broken Damage / Reframe*

Priority= Minimum E Tag, depending on exposure.

Note: Inspector should use judgement on if pole can be reframed instead of replaced

WOODPECKER DAMAGE 1-3 INCHES



At this Location: Single hole 1-3 inches within 2 inches from attachment hardware.



Perform Minor Work: No

Write 3rd Party Notification: No

Write EC Notification: Yes

FDA= Pole / Woodpecker Damage / Replace or Pole / Broken Damage / Reframe*

Priority= Minimum E Tag, depending on exposure.

Note: Inspector should use judgement on if pole can be reframed instead of replaced



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

WOODPECKER DAMAGE >3 INCHES



At this Location: Woodpecker hole is greater than 3 inches, less than 12 feet from top of pole, and within 2 inches from attachment hardware.



Perform Minor Work: No

Write 3rd Party Notification: No

Write EC Notification: Yes

FDA= Pole / Woodpecker Damage / Replace

Priority= Minimum E Tag, consider B Tag, due to size of hole and proximity to hardware



Job Aid: Overhead Assessment


TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

WOODPECKER DAMAGE NESTNG CAVITY

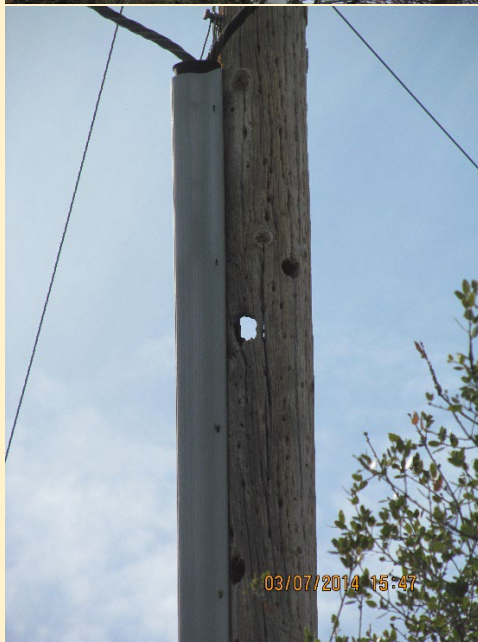

At this Location: A through hole counts as 2 holes. The 3 holes within a 1-foot section added together are greater than 9 inches.



Perform Minor Work: No

Write 3rd Party Notification: No

Write EC Notification: Yes

FDA= Pole / Woodpecker Damage / Replace

Priority= Minimum E Tag, consider B Tag, due to size of holes



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

WOODPECKER DAMAGE 1-3 INCHES



At this Location: The sum of the holes are less than 9 inches. Woodpecker holes are not within 2 inches from attachment hardware.



Perform Minor Work: No

Write 3rd Party Notification: No

Write EC Notification: Yes

FDA= Pole / Woodpecker Damage / Repair

Priority= F Tag, up to 5 years

WOODPECKER DAMAGE <1 INCH HOLES



At this Location: Holes are less than 1 inch in diameter and acorn/feeder holes do not cover more than 50% of the pole surface in a 3 ft section.



Perform Minor Work: No

Write 3rd Party Notification: No

Write EC Notification: No



Job Aid: Overhead Assessment


TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

WOODPECKER DAMAGE <1 INCH

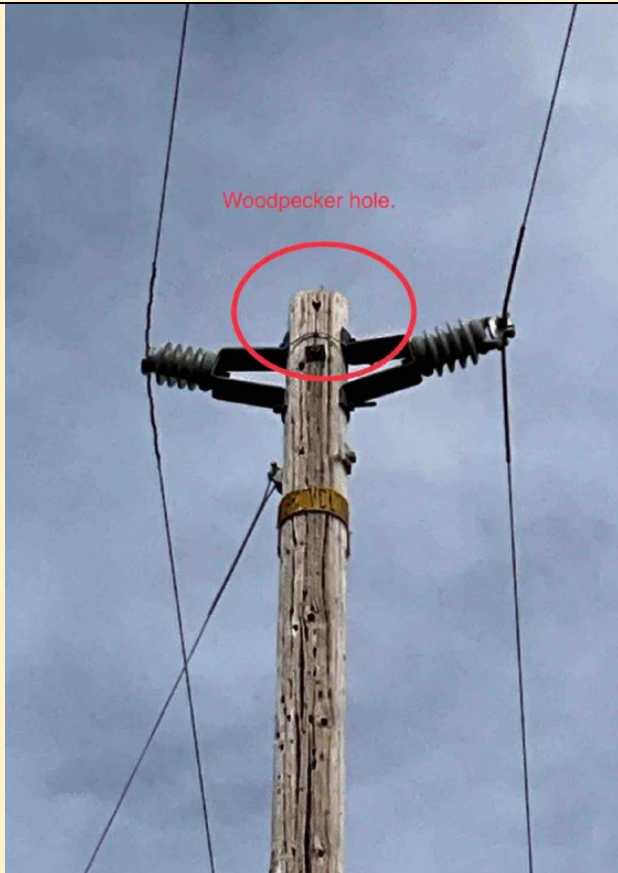

At this Location: Woodpecker hole less than 1 inch, damage is within 6 inches from top. Holes cover less than 50% of the pole surface in a 3 ft section.



Perform Minor Work: No

Write 3rd Party Notification: No

Write EC Notification: No

The following are guidelines for repair of repair of woodpecker-damaged pole tops.

Reference: [066209 – Repair of Damaged Pole Tops](#)






Soil Excessively Eroded or Washed Away at Base of Pole

General Guidance: If the inspector notices that a large amount of soil was washed or eroded away at the base of a pole, consider writing an EC notification to investigate whether the pole still meets its designed set depth.

Related Documents: [015203](#), page 2, table 1

Example

SOIL ERODED AT BASE OF POLE	
	At this Location: a large amount of soil was washed or eroded away at the base of a pole, Not leaning.  
	Perform Minor Work: No
	Write 3rd Party Notification: No
	Write EC Notification: Yes FDA= Pole / Soil Eroded / Graded / Replace
	Priority= Minimum E Tag, depending on exposure.



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02
Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

Transmission Poles and Distribution Underbuilds

General Guidance: At minimum, when performing GO 165 patrols or inspections, Inspectors should perform a “patrol” of the transmission assets in the area being patrolled or inspected in order to identify any **obvious structural problems or hazards** that need to be addressed by the Transmission Organization. Review clearances to verify no reduced clearance issues, all levels of clearance requirements that could result in contact, fire risk, or public safety.

Note: Do not install distribution barcode on transmission poles

When in doubt call your supervisor or PG&E Lead

- Examples of the types of issues that could be identified:
- Damaged or broken poles
- Broken or decayed crossarms
- Broken insulators
- Damaged tie wire
- Vegetation issues

Minor Work: No

If you identify an obvious structural problem or hazard in the field that is NOT an emergency:




Write EC Notification: Yes

- Generate an EC to generate an LC.

Reference:

- [Standard 027742: Installation of Distribution Cable Risers on Poles](#)

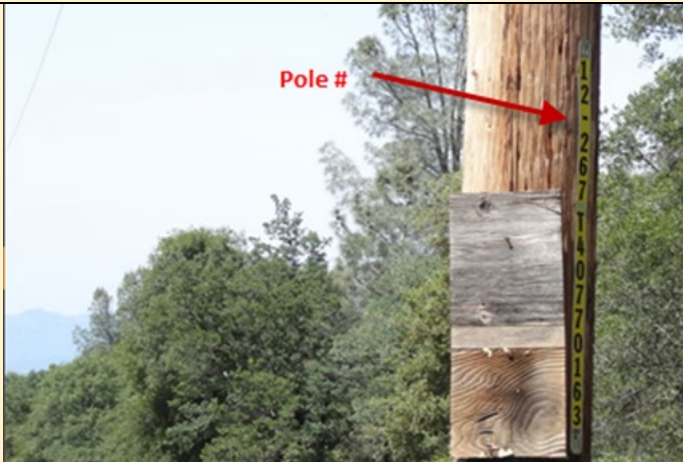Example

TAKE PICTURE OF TRANSMISSION POLE	
	<p>In the process of creating the EC Notification, include a photo of the Transmission pole number.</p> <div></div>



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

Example 2





A. Distribution riser on structure

General Guidance: Steel Transmission Structure with Distribution Underbuilds with **external** riser present. If observed, yes, create EC notification to relocate riser.

Note: Presents of distribution riser on steel transmission pole exposes customer equipment to transmission flashover voltages.

Reference:

- [Standard 027742: Installation of Distribution Cable Risers on Poles](#)

RISER ON STEEL TRANSMISSION POLE	
	
<p>At this Location: Steel Transmission Structure with Distribution underbuilds with external riser on steel pole.</p> <p> </p>	
<p>Perform Minor Work: No</p>	
<p>Write 3rd Party Notification: No</p>	
<p>Write EC Notification: Yes</p> <p>FDA= Riser / Pothead / Installed in Error / Relocate</p> <p>Priority= Minimum E Tag, depending on exposure.</p>	



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02




Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

B. Distribution riser on structure

General Guidance: Structure must be steel Transmission Structure with Distribution Underbuilds with **internal riser** within steel pole. If observed, yes, create EC notification to relocate riser.

Note: Presents of distribution riser on steel transmission pole exposes customer equipment to transmission flashover voltages.

STEEL TRANSMISSION STRUCTURE WITH DISTRIBUTION UNDERBUILD WITH INTERNAL RISER WITHIN STEEL POLE	
	<p>At this Location: Steel Transmission Structure with Distribution underbuilds with internal riser within steel pole.</p> <p> </p>
	<p>Perform Minor Work: No</p>
	<p>Write 3rd Party Notification: No</p>
	<p>Write EC Notification: Yes FDA= Riser / Pothead / Installed in Error / Relocate Priority= Minimum E Tag, depending on exposure.</p>



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025




Rev: 14

Example 3

Distribution transformer serving an external customer installed without a common neutral present.

General Guidance: If observed, yes, create EC notification to relocate the transformer.

Related Documents: [068177](#), G.O. 95 Rule 33B, [056425](#) (Note 1 on pg. 1 and sub-note 1 on bottom of pg. 1)

DISTRIBUTION TRANSFORMER ON STEEL TRANSMISSION POLE WITHOUT COMMON NEUTRAL	
	At this Location: Distribution transformer on steel transmission pole without common neutral.  
	Perform Minor Work: No
	Write 3rd Party Notification: No
	Write EC Notification: Yes FDA= Transformer / No Common Neutral / Relocate Priority= Minimum E Tag, depending on exposure.



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02
Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14




Example 4

Missing or Broken Distribution Bridging

General Guidance: If observed, yes, create EC notification to repair or install missing bridging.

Note: If bridging is not installed on a distribution wood cross-arm on a transmission wood pole, then create an EC tag to install bridging.

Related Documents: [TD-2305M-B009](#)

WOOD CROSSARM ON WOOD TRANSMISSION POLE WITH DISTRIBUTION UNDERBUILD BRIDGING	
	<p>Bridging Example</p> <div></div>






Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

BURNT POLE DUE TO MISSING BRIDGING	
	At this Location: Transmission pole with missing bridging on the distribution cross-arm, burnt pole, assess pole.  
	Perform Minor Work: No
	Write 3rd Party Notification: No
	Write EC Notification: Yes FDA= OH Facility / Transmission issue / Create LC Priority= B Tag, depending on exposure

Solely Owned Poles with Third-Party Utility Attachments

General Guidance: Identify all solely owned pole with third-party attachments (based on how it is mapped). Initiate a map correction to indicate structure is mapped as solely owned but has utility attachment in the field.

Minor Work: No

EC Notification: No

Related Documents: [TD-2305M](#) EDPM Pole Inspection, [TD-2325S](#)

Intumescent Pole Covers

PG&E has added intumescent pole covers to slow or prevent fire damage to some wood poles in T3/T2 areas. The cover is introduced in Utility Bulletin: TD-015203-B005

Disclaimer: Intumescent pole covers are not a valid CGI condition. It is not the intent of PG&E to require a CGI EC Notification on intumescent covered poles unless the location, including vegetation, customer access, etc., meets the existing CGI conditions. as described in System Inspection's Training material and the Overhead Job Aid



Job Aid: Overhead Assessment



TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

- **Pole Damaged:**
 - You observe noticeable pole damage, even with the cover on the pole.
 - Examples may include overloads, woodpecker/animal/vehicle damage, and signs of broken/bent/leaning/split poles, etc.
 - Always create an EC Notification to repair/replace the damaged Hardware/Framing
 - **Suspect Pole and Cover Damaged:**
 - Any gaps of the cover larger than a tennis ball exposes the wood to fire damage.
 - Create an EC Notification to repair/replace the cover and to assess the pole for other possible damage.
 - **Note:** If authorized and trained to do so, you may cut away the cover allowing further inspection of the pole and then the cover can be reapplied. Patch pieces are available using Material code M140214.
- Intumescent Pole Covers Example:

DAMAGED INTUMESCENT POLE WRAP	
	At this Location: Damaged intumescent pole wrap.  
	Perform Minor Work: Yes, if safe to do so.
	Write 3rd Party Notification: No
	Write EC Notification: Yes, if minor work cannot be completed. FDA= Hardware/Framing / Broken/Damaged / Repair or Replace Priority= E Tag



Distribution Towers / Steel Lattice

General Guidance: You are required to record a distribution inspection for **structures carrying distribution voltage**. If transmission is on the same tower, inspect distribution components only. If no transmission on tower, inspect distribution components and notify supervisor to confirm that the tower inspection is in the transmission plan. Inspectors are required to inspect distribution towers / lattices for the following:

- Steel Covered by Earth
- Rust or Corrosion at Tower Footings
- Tower Footing Damaged
- Tower Member Loose
- Marking Hi-Sign Missing/Not Legible
- Guarding - Tower Not Guarded (Where Applicable)
- Guy Attachment, Turn Buckles, or Preformed Guys Loose
- Tower Rusty – Needs Paint

Minor Work: No

EC Notification: Yes

Related Documents: [022168](#)

Tree Attachments

Definition: A Tree Connect is a PG&E asset because the tree which is not owned by PG&E has one or more attachments connected to it.

PG&E Attachments may include:

- Primary Conductor
- Secondary Conductor
- Service Conductor
- Streetlight Conductor
- Hardware
- Anchor
- Guy Assemblies



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

General Guidance: As you perform a visual inspection of all associated conductor(s) from structure to midspan in all directions or to weather head or termination point in all directions, look for tree attachments (Mapped or Un Mapped).

The Ultimate Goal is to have all Tree Connects mapped, have an Orange Inspection Halo and record the Inspection of each Tree Connect using the Inspection Checklist.

Note: When performing an inspection for a tree connect, tree connects should be recorded as PG&E owned and not customer owned.

Minor Work: No

Related Documents: TD-2999B-044

Common Scenarios: Follow process for each:

- (1) Tree Connect is Mapped and has an Orange Inspection Halo (Complete inspection)

- (a) **Reference:** Mapped tree symbol



- (2) Tree Connect is Mapped as a proposed Clearance Pole (Red dotted circle) With No Halo:

- (a) Follow [Adhoc Inspection Process](#)

- (3) Tree Connect is Un-mapped:

- (a) Follow [Adhoc Inspection Process](#)

- (4) Tree Connect is mapped but does not have an Orange Inspection Halo:

- (a) Request Halo <mailto:SystemInspectionHaloIssues@pge.com>

- (5) Tree connect is mapped but does not exist in field:

- (a) Complete inspection record indicating structure does not exist in field.

Tree Attachments “Found in the Field” Procedure

Vegetation Management (VM) has provided guidance below in order to:

- Better evaluate the **tree condition** and select the most appropriate **Priority Tag Designation**
- Clarify when **VM assessments** are needed
- Ensure we are prioritizing the **most urgent and immediate wildfire safety risks**

Note: Keep in the mind that **deciduous dormant trees** are naturally occurring and are trees that tend to drop their leaves in fall or winter.



GENERAL TREE GUIDELINES

See below for a list of common tree species that either remain green annually or lose leaves in the fall or winter season. **NOTE:** This is a non-inclusive list. When in doubt, take a photo and send it to your regional Estimating Arborist inbox. Refer to the **VM Estimating Arborist Area Map** for more information.

COMMON EVERGREEN TREES THAT REMAIN GREEN YEAR ROUND	COMMON DECIDUOUS TREES THAT LOSE LEAVES IN FALL/WINTER
<ul style="list-style-type: none">• Redwood Trees• Fir Trees• Pine Trees• Cypress Trees• Madrone Trees• Tan Oak Trees• Liveoak Trees• Bay Trees	<ul style="list-style-type: none">• Sycamore Trees• Maple Trees• Most Other Oaks• Fruit & Nut Trees• Birch Trees• Ash Trees• Elm Trees• Willow Trees

ACTIVELY FALLING TREE



Unstable soil, tree uprooting

Observed Tree Condition: Actively Falling Tree

Immediate Action Required: Yes, first responder to stay on site until hazard has been made safe

EC Notification Priority: A tag, follow emergency process.

DEAD OR DYING TREE



Dying tree, all brown needles, not dormant



Cavity at base of tree



Deep cavity in trunk below tree connect point



Major wound on trunk



White or black mushrooms on tree



Minor wound on trunk

Observed Tree Condition: Dead or Dying Tree

VM Review Needed: No, unless tree condition cannot be adequately assessed by System Inspections.

Tree Condition Criteria:

- Tree is truly dead, not deciduous dormant
- Majority of the main branches are dying, dead or brown
- Significant rot or decay present at the tree base
- Bark is falling off (which is unnatural)
- Deep cavity present in trunk of tree
- Significant cracks (not hairline cracks) present in trunks
- Trunk is structurally unsound
- Fungus or Conk growth observed on trunk, base or tree roots

EC Notification Priority: B Tag



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

DECLINING TREE



Declining branches beyond normal aging



Significantly weeping

Observed Tree Condition: Healthy (green) Tree, only making the evaluation on what you actually see today

VM Review Needed: No; VM will review these trees annually moving forward

Tree Condition Criteria:

- No signs of significant decline and looks similar to surrounding natural trees
- No clearly outstanding defects other than natural and normal aging
 - Normal aging can include broken branches or few brown branches

EC Notification Priority: NO EC Tag



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

HEALTHY (GREEN) TREE



Healthy redwood



Healthy deciduous tree in winter with leaf drop



Dead top but the rest of the tree is healthy



Broken branch but the rest of the tree is healthy

Observed Tree Condition: Healthy (green) Tree, only making the evaluation on what you actually see today

VM Review Needed: No, unless tree condition cannot be adequately assessed by System Inspections.

Tree Condition Criteria:

- Signs of significant decline compared to surrounding natural trees
- Some visible minor defects that are observed beyond natural and normal aging
- Brown branches observed throughout the canopy
- Minor cracks present in main trunk
- Significant sap or black bleeding weeping from trunk (some sap and weeping is normal)

EC Notification Priority: E Tag



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

Identification by System Inspections:

- Assess the tree condition per Vegetation Management (VM) guidance.
- If tree is “**Green**” and considered to be in **Good Condition**, **NO EC is required**.
 - If open EC exists for location and field conditions are **NOT compelling** or **NOT a regulatory condition**, process cancellation request.
- If an immediate hazard exists**, Create an **Emergency “A” Tag**.
 - The location cannot be made safe to the public without additional Qualified Company Representative (QCR) support, the first responder **MUST** standby until relieved by the additional QCRs **OR** until the hazard has been made safe.

Category	Priority	MAT	Work Type Code	Tree Mortality
Emergency	A	17B	501	Dead or Dying OR Green

- Under **Item Details**, the **Facility Type / Damage / Action (FDA)** of notification should be:
 - Tree/Vine / Decayed/Rotten / Install CL Pole
 - Tree/Vine / Decayed/Rotten / Remove
- Notification **Cause** should be:
 - Tree Contact

Object	Damage	Cause	Activity
Tree / Vine	Decayed / Rotten	Tree Contact	Install CL Pole
Tree / Vine	Decayed / Rotten	Tree Contact	Remove

- If tree is “**Dead or Dying**” or “**Green**” and considered to **NOT be in Good Condition**, Create **EC Replacement Tag**, based on field conditions:

Category	Priority	MAT	Work Type Code	Tree Mortality
EC	B or E	07C	311C	Dead or Dying OR Green

- EC “B” or “E” Tags:**
 - Under **Item Details**, the **Facility Type / Damage / Action (FDA)** of notification should
 - Tree/Vine / Decayed/Rotten / Install CL Pole
 - Tree/Vine / Decayed/Rotten / Remove



Object	Damage	Activity
--------	--------	----------

Tree / Vine Decayed / Rotten Install CL Pole

Tree / Vine Decayed / Rotten Remove

- If open EC exists for location and field conditions warrant an expedited Priority, update Pending EC as appropriate.
- If tree condition cannot be adequately assessed, Create an **EC Assessment Tag** for VM Review:

Category	Priority	MAT	Work Type Code	Tree Mortality
EC	B	07A	311A	Dead or Dying OR Green

- The **EC Assessment Tag** **MUST ONLY** have the designated **FDA for Tree Assessment**.
- Under **Item Details**, the **Facility Type / Damage / Action (FDA)** of notification should be:
 - Tree/Vine / Tree Connect / Assessment

Object	Damage	Activity
--------	--------	----------

Tree / Vine Tree Connect Assessment



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02
Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

TREE CONNECTS



At this Location: Tier 3 area, tree connect on dead/dying tree; attachments are solid.



Perform Minor Work: No

Write 3rd Party Notification: No

Write Veg Form: No

Write EC Notification: Yes

FDA= Tree/Vine / Decayed/Rotten / Install Clearance Pole **AND** Tree/Vine / Decayed/Rotten / Remove

Priority= E Tag, depending on exposure



Job Aid: Overhead Assessment




TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

Examples

TREE CONNECT ON DEAD/DYING TREE	
	<p>At this Location: Tier 2 area, tree connect on dead/dying tree with multiple woodpecker holes and damaged primary insulators.</p> <p> </p>
	<p>Perform Minor Work: No</p>
	<p>Write 3rd Party Notification: No</p>
	<p>Write Vegetation Notification: No</p>
	<p>Write EC Notification: Yes</p> <p>FDA= Tree/Vine / Decayed/Rotten / Install Clearance Pole AND Tree/Vine / Decayed/Rotten / Remove</p> <p>Priority= X Tag</p>



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

Buddy Pole

Buddy Pole: A short section of pole, cut above and below the communication facilities, which are not being transferred to the new pole, and supported entirely by connections to the new pole.

Cut-and-kick: The wood pole replacement process where a new pole is placed in the same hole as the old pole and the old pole is temporarily secured to the new pole.

General Guidance: If there is a compelling abnormal condition (e.g., buddy pole not properly supported), then write EC notification. When in doubt call your supervisor or PG&E Lead

Minor Work: No




3rd Party Notification: No

EC Notification: Yes

Select the Priority and Due Date based upon compelling abnormal condition that may adversely impact public safety and/or service reliability.

Related Documents: [TD-2326P-01](#), [TD-2326P-01-JA01](#)

Example

BUDDY POLE	
	At this Location: Buddy pole is properly supported.  
	Perform Minor Work: No
	Write 3rd Party Notification: No
	Write EC Notification: No



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

Equipment

Oil-filled Equipment

Equipment Oil: Leaking/Weeping Stain

General Guidance: Refer to TD-2305M EDPM Manual - Assessments and Notifications Section for additional information about addressing oil in the field.

IF you observe a **stain or leak**

THEN (1) Look for **exposure or contamination**.

Refer to the PCB Spill/Leak Category Response Matrix to determine the appropriate action and priority.

- **Field employees must comply with the oil spill matrix table for how to handle oil conditions. Field employees should use the oil “indicator” language from the oil spill matrix table to describe the oil condition in the comments of the EC notification.**

Reminders:

- The field employee must create an emergency notification if the table directs creation of an A tag.
- If an Inspector identifies the emergency condition, they must create the A tag (do not wait for responder to create the A tag).
- WHEN the table directs you to contact EFS, the field employee must provide information and photos for EFS to make an informed decision.
- If identified after working hours, contact Environment Emergency Hotline, 1-800-874-4043.
- The field employee must note results of discussion with EFS in the notification:
 - Name of EFS
 - Guidance from EFS
- If you are unsure how to handle an oil condition, contact your supervisor or lead for guidance.

Minor Work: No

EC Notification: Yes

Related Documents: [TD-2320P-01, Attachment 1 - PCB Spill/Leak Category Response Matrix for Overhead, Sub-Surface, and Padmount Equipment](#)



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atrch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

Spill/Leak Category Response Matrix – Overhead Equipment

Indicator	Equipment Manufactured Before July 1979† (Potential PCB)		Equipment Manufactured July 1979 or later† (Non-PCB)	
	EC Notification Priority	Standby at Site	EC Notification Priority	Standby at Site
Dielectric fluid is actively leaking and/or has run off the surface of the equipment and is in contact with the ground, i.e., soil, vegetation, water or structure.	A Replace	Yes	A Replace	Yes, until the Supervisor discusses with EFS the need to remain onsite based on the location and size of spill.
Dielectric fluid is actively leaking and is about to run off the surface of the equipment but has not made contact with the ground, i.e., soil, vegetation, water, or structure.	A Replace	Yes	A Replace	Yes, until the Supervisor discusses with EFS the need to remain onsite based on the location and size of spill.

†IF equipment is manufactured between July 1979 and December 1984, THEN consult Local EFS to assess potential for residual PCB contamination.

Spill/Leak Category Response Matrix – Overhead Equipment (continued)

Indicator	Equipment Manufactured Before July 1979† (Potential PCB)		Equipment Manufactured July 1979 or later† (Non-PCB)	
	EC Notification Priority	Standby at Site	EC Notification Priority	Standby at Site
Small volume of dielectric fluid has gradually reached the surface of the equipment and is wet but has not yet made contact with the ground (seeps/weepers).	A Replace	Not Required	A or B	Describe seep/weep in notification Supervisor discusses with EFS to determine EC notification category based on sensitivity of location and upcoming weather.
Residual stain or mark on the equipment that appears dried and has not made contact with the ground, e.g., stain on side of overhead transformer.	B 3 Month Recheck Describe stain in notification. Re-check in 3 months.	Not Required	EC tag Not Required	Not Required

†IF equipment is manufactured between July 1979 and December 1984, THEN consult Local EFS to assess potential for residual PCB contamination.



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

Example

LEAKING OH TRANSFORMER	
	<p>At this Location: Leaking OH Transformer, Residual Stain mark that appears dried, no sign of oil on ground. Oil has leaked out of the high side bushing, appears dried.</p> <p> </p>
	<p>Perform Minor Work: No</p>
	<p>Write 3rd Party Notification: No</p>
	<p>Write EC Notification: No No further action</p>
LEAKING OH TRANSFORMER	
	<p>At this Location: Leaking OH Transformer, Residual Stain mark that appears dried on IFD (Internal Fault Detection)</p> <p> </p>
	<p>Perform Minor Work: No</p>
	<p>Write 3rd Party Notification: No</p>
	<p>Write EC Notification: No No further action</p>



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

LEAKING OH TRANSFORMER, OIL ON THE GROND



At this Location: Leaking OH transformer, oil on the ground.



Perform Minor Work: No

Write 3rd Party Notification: No

Write EC Notification: Yes

FDA= Transformer / Leaking / Seeping / Replace

Priority= A Tag, follow the emergency process



Corrosion

General Guidance: In many parts of PGE's service territory, facilities are exposed to conditions that both cause and accelerate corrosion of metal components.

During detailed inspections, examine facilities and assess their condition for corrosion. If corrosion is minor, repairs to the protective coatings that cover the metal surfaces on the equipment should be made. In addition, during the diagnostic testing for specific types of distribution line equipment, perform an examination for corrosion.

Minor Work: Yes

EC Notification: Yes, if compelling

Select the Priority and Due Date based upon compelling abnormal condition that may adversely impact public safety and/or service reliability.

IF you observe corrosion:

THEN:

- I. Look for exposure.
- II. Refer to the below table to determine the corrosion rating and the required actions to perform. Visual examples follow:

Description	Symptoms	Required Actions
Integrity is breached	Hole(s) in metal (public exposure to High Voltage, Cover not securable, significant oil leak or spill, etc..)	EC notification Priority A or X - replace or make safe and issue Priority B - Replace/Repair
Metal is damaged	Separation, layering, bubbling	EC notification Priority E - replace/repair.
Moderate to little or no corrosion	No sight of metal degradation, Discolored paint, staining	Inspect at next interval. No action required



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

Examples

TRANSFORMER CORROSION

**Picture from ground****Close up Picture**

At this Location: Transformer with heavy corrosion has breached integrity of tank. Hole in lid of tank.
NOTE: Refer to spill matrix when oil release is confirmed or found.

**Perform Minor Work:** No**Write 3rd Party Notification:** No**Write EC Notification:** Yes**FDA =** Transformer / Corroded / Replace**Priority =** Minimum X Tag, depending on exposure.

OH CORROSION



At this Location: Corrosion Weakening Integrity of Tank. Metal is separating into layers. Corrosion will breach tank.



Perform Minor Work: No

Write 3rd Party Notification: No

Write EC Notification: Yes

FDA= Transformer / Corroded / Replace

Priority= Minimum E Tag, depending upon exposure

TRANSFORMER NOT CORRODED



At this Location: Transformer paint has deteriorated to primer. Black on transformer is not corrosion. No action.



Perform Minor Work: No

Write 3rd Party Notification: No

Write EC Notification: No



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003A1ch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14


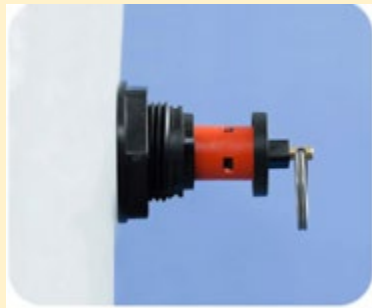


Internal Fault Device Activated

General Guidance: Is the Internal Fault Device activated (overheated) on the transformer (orange band is visible).

Minor Work: No

Related Documents: N/A

Example

TRANSFORMER INTERNAL FAULT DEVICE ACTIVATED	
	
Not Activated	Activated
<p>At this Location: Transformer internal fault device activated, indicating overheating, and the orange band is visible. Not to be confused with pressure relief valve.</p> <p> </p>	
<p>Perform Minor Work: No</p>	
<p>Write 3rd Party Notification: No</p>	
<p>Write EC Notification: Yes</p> <p>FDA= Transformer / Broken/Damaged / Replace</p> <p>Priority= A Tag E-Tag</p>	

b. Shipping Lock Present on Transformer

General Guidance: Shipping lock present on transformer is a non-compelling abnormal condition.

Minor Work: No

EC Notification: No

Transformer – Parallel

Is there an obvious paralleled transformer condition at this location? If yes, create EC notification to address parallel condition in the field. Priority should be F Tag, 60 months.


Minor Work: No

Related Documents: N/A

General Guidance: Use a combination of the mapping symbols and the actual field observations to properly assess the condition.


Examples

Banked transformers on separate poles should be identified as banked.

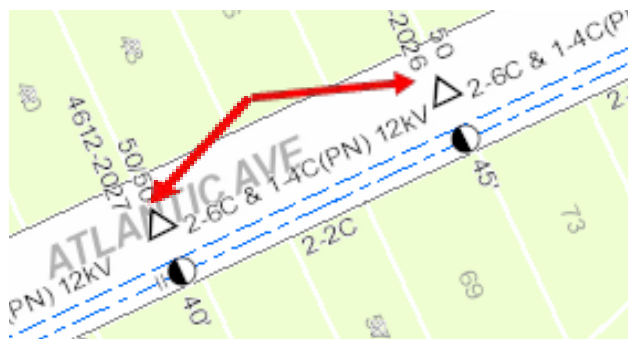

OH Paralleled Transformers

OH Transformers separated by bobs are ok

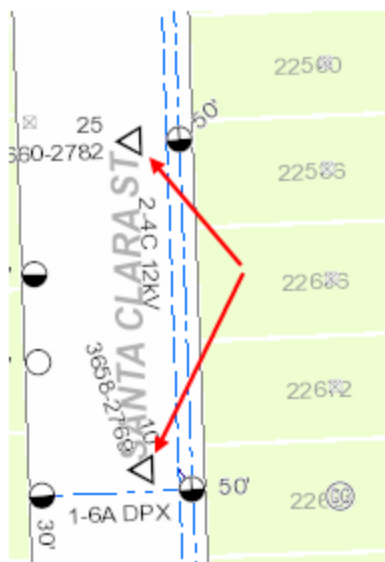



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003A1ch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

Transformer Bushings

General Guidance: Does the transformer have primary and/or secondary bushings and/or terminations damaged or broken? If so, write EC notification.

Examples

FLASHED INSULATOR ON TRANSFORMER



At this Location: Flashed insulator on transformer



Perform Minor Work: No

Write 3rd Party Notification: No

Write EC Notification: Yes

FDA= Transformer / Flashed / Replace

Priority= E Tag, depending upon exposure



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

SmartMeter / SCADA Equipment / Other Equipment on Poles

Broken/Damaged SmartMeter Relay/Access Point/Data Collector Unit or SCADA Equipment

General Guidance: If, through visual inspection, an inspector sees broken or damaged SmartMeter, antenna, DCU, or SCADA equipment, create EC notification. Be sure to check the SmartMeter box on the EC Form. If visible, note the operating number and/or serial number of the equipment.

Supervisors will contact SmartMeter and/or Operations to notify them of the issue and **determine EC or COE.**

Minor Work: No

EC Notification: Yes, unless COE

Related Documents: [072145](#), [072150](#), [068190](#), [054421](#)



Job Aid: Overhead Assessment






TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

Examples

EXAMPLES	
	
ANTENNA	CONTROL BOX ON STEEL TOWER
 	
PG&E WEATHER STATION	CONTROL BOX ON WOOD POLE



Switch Handle/Control Box is Not Locked

General Guidance: Ensure that boxes or enclosures located 8 feet or less above the ground are locked.

Minor Work: Yes

- Perform minor work if possible and if safe to do so.
- IF not able to perform minor work, THEN create EC notification.

EC Notification: Yes, only if not able to perform minor work.

FDA: Hardware/Framing / Missing / Install

Select the Priority and Due Date based upon compelling abnormal condition that may adversely impact public safety and/or service reliability.

Related Documents: [066195](#)

Surge “Lightning” Arrestors

Broken or Flashed

General Guidance: Are arrestors broken, damaged, flashed, or is the ground lead disconnect activated? If yes, Create EC notification to replace lightning arrestor.

Minor Work: No

EC Notification: Yes

Select the Priority and Due Date based upon compelling abnormal condition that may adversely impact public safety and/or service reliability.

Related Documents: [031822](#)



Job Aid: Overhead Assessment







TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

Examples

NON-EXEMPT SURGE ARRESTOR BLOWN	EXEMPT ABB-TYPE ARRESTOR BLOWN
	
At this Location: Non-Exempt Surge Arrester Blown  	At this Location: Exempt ABB arrester operated / blown indicated by the orange marker sticking out the bottom.  
Perform Minor Work: No	Perform Minor Work: No
Write 3rd Party Notification: No	Write 3rd Party Notification: No
Write EC Notification: Yes FDA= Lightning Arrester / Broken/Damaged / Replace Priority= E Tag, depending on exposure	Write EC Notification: Yes FDA= Lightning Arrester / Broken/Damaged / Replace Priority= E Tag, depending on exposure

Loose Hardware

General Guidance:

If the support hardware is missing or loose to where it no longer provides stability or alignment, write an EC notification.

Ensure all components are properly secured and verify that the hardware can accommodate the expected contraction and expansion.

Examples

MISSING HARDWARE IMPACTING INTEGRITY – Aerial View



At this Location: The nut on the through bolt has come off of the king pin.



Perform Minor Work: No


Write 3rd Party Notification: No

Write EC Notification: Yes

FDA = Hardware / Missing / Install

Priority = E Tag, depending on exposure



LOOSE HARDWARE	
	At this Location: Loose hardware involving cutouts. Arm loose/deteriorated causing the cutouts to almost be in underslung position.
	Perform Minor Work: No
	Write 3rd Party Notification: No
	Write EC Notification: Yes FDA: Hardware / Loose / Adjust Priority: E Tag, depending on exposure.

Conductor




Bare Primary & Secondary Conductor





Part 1

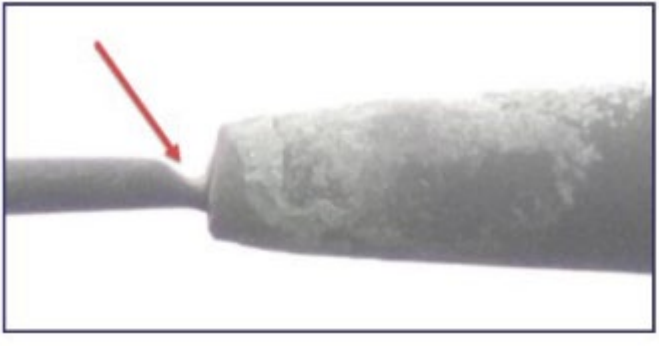Category 1 – Conductor visual assessment

General Guidance: Visually check all conductors (primary/secondary/service), associated attachments and dead-ends for damage from the structure being inspected to mid-span in all directions or the weather-head or to the conductor's termination point.

1. Primary, secondary, and/or service conductors that are broken, damaged, burnt, corroded, loose, frayed, bird caging or necking of conductor.
 - **General Guidance:** If observed, create EC Notification to repair or replace the conductor.
 - Note:** If conductor has 30% or more of strands broken or if steel core in ACSR is broken, these are A Tag stand by situations. If necking of conductor is extreme (>40%), write A Tag.

NECKING OF CONDUCTOR	
	At this Location: Solid wire next to automatic splice has extreme (>40%) conductor necking.
	 
	Perform Minor Work: No
	Write 3rd Party Notification: No
	Write EC Notification: Yes FDA = Conductor / Broken/Damaged / Repair Priority = A tag, depending on exposure.

NECKING OF CONDUCTOR	
	
At this Location: Solid wire next to automatic splice has minor/moderate (< 40%) conductor necking.	
 	
Perform Minor Work: No	
Write 3rd Party Notification: No	
Write EC Notification: Yes FDA = Conductor / Broken/Damaged / Repair Priority = B Tag, depending on exposure	



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02




Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

A. Does the conductor have broken strands?

1. (No) No Action
2. (Yes) Strands broken within 2" of hardware interface.
 - a. (Yes) >30% strands visibly broken?
 - i. (Yes) Repair/Replace Level IA or IIX
 - ii. (No) Repair/Replace E Tag, up to 12 months
 - b. (No) >30% strands broken?
 - i. (No) Repair/Replace E Tag, up to 36 months.
 - ii. (Yes) Repair/Replace Level 1A or IIX.

Examples

GUN SHOT DAMAGE	
	At this Location: More than 30% broken strands.  
	Perform Minor Work: No
	Write 3rd Party Notification: No
	Write EC Notification: Yes
	FDA: FDA = Conductor / Broken/Damaged / Repair or Replace Priority: A Tag or X Tag depending on exposure.



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atrch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

BROKEN STRANDS



At this Location: Damage to the conductor, more than 30% broken strands



Perform Minor Work: No


Write 3rd Party Notification: No

Write EC Notification: Yes

FDA = Conductor / Broken/Damaged / Repair or Replace

Priority = A Tag or X Tag depending on exposure.

BROKEN STRANDS UNDER VIBRATION DAMPER

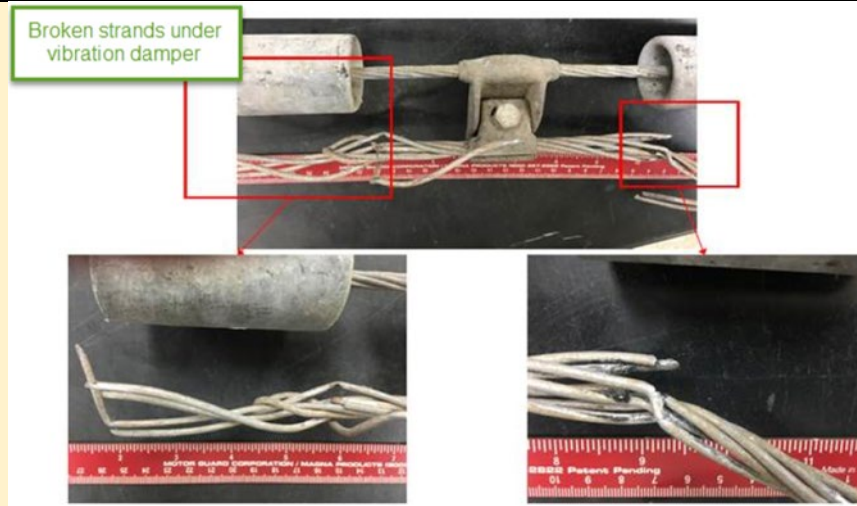

At this Location: Broken strands (more than 30%) under vibration Damper



Perform Minor Work: No


Write 3rd Party Notification: No

Write EC Notification: Yes

FDA = Conductor / Broken/Damaged / Replace

Priority = A Tag, follow emergency process or X Tag

Vibration Damper

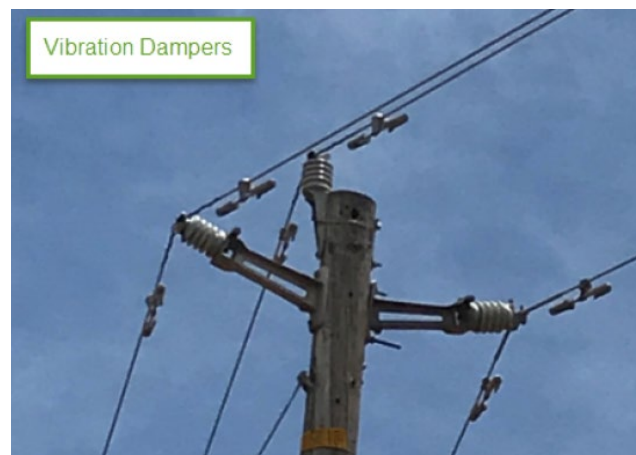



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02




Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

B. Is arc damage present?

1. (No) No action
2. (Yes) Does arched conductor have broken strand(s) or reduced cross sectional area?
 - a. (No) No action
 - b. (Yes) Is solid conductor?
 - i. (No) Repair/Replace E Tag
 - ii. (Yes) Repair/Replace E Tag

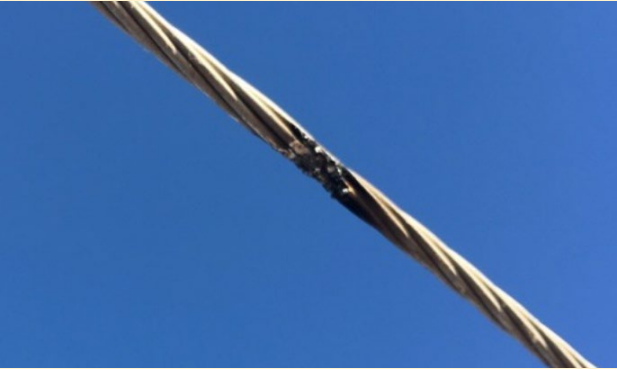Examples

BURNT CONDUCTOR PRIMARY OR SECONDARY	
	At this Location: Burnt Conductor, midspan, primary or secondary.  
	Perform Minor Work: No
	Write 3rd Party Notification: No
	Write EC Notification: Yes
	FDA: FDA = Conductor / Burnt / Repair or Replace Priority: E Tag, depending on exposure






Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

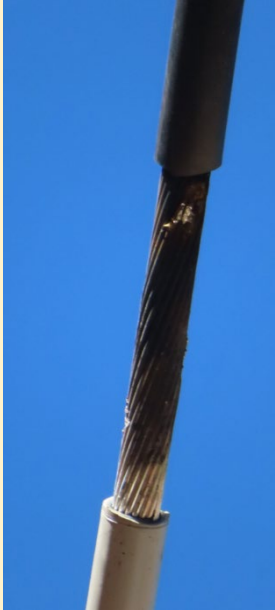Rev: 14

EXPOSED PRIMARY COVERED CONDUCTOR TREE WIRE, BURNT CONDUCTOR	
	<p>At this Location: Tree Wire conductor exposed and burnt, loss of cross-sectional area.</p> <p><i>Note: Tree wire refer to page 122.</i></p> <div></div>
	Perform Minor Work: No
	Write 3rd Party Notification: No
	Write EC Notification: Yes FDA= Tree Wire / Exposed / Repair FDA= Conductor / Burnt / Repair Priority: E Tag, depending on exposure

C. Is conductor corroded?

1. (No) No action
2. Broken strands present?
 - a. (Yes) See, "Does the conductor have broken strands?"
 - b. (No) No Action
3. Arc Damage present?
 - a. (Yes) See, "Is arc damage present."
 - b. (No) No action

D. Does the conductor have excessive bird caging?

1. (No) No Action
2. (Yes) Is conductor under tension?
 - a. (No) No action
 - b. (Yes) Repair/Replace E Tag



Job Aid: Overhead Assessment



TD- 2305M-JA02



WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

Examples

EXCESSIVE BIRD CAGING	
	At this Location: Conductor has excessive bird caging. 
	Perform Minor Work: No
	Write 3rd Party Notification: No
	Write EC Notification: Yes FDA: FDA = Conductor / Broken/Damaged / Repair or Replace Priority: E Tag, depending on exposure

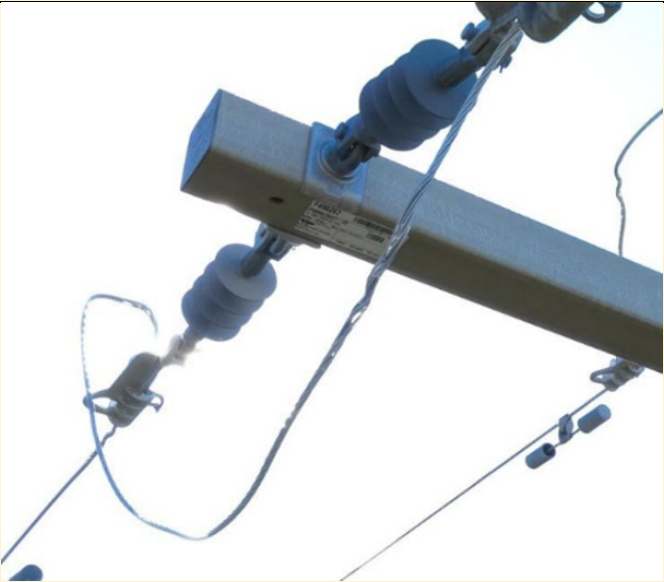BIRD CAGING ON JUMPER NOT UNDER TENSION	
	At this Location: Bird caging on jumper not under tension. 
	Perform Minor Work: No
	Write 3rd Party Notification: No
	Write EC Notification: No



Job Aid: Overhead Assessment


TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

BIRD CAGING GUY WIRE

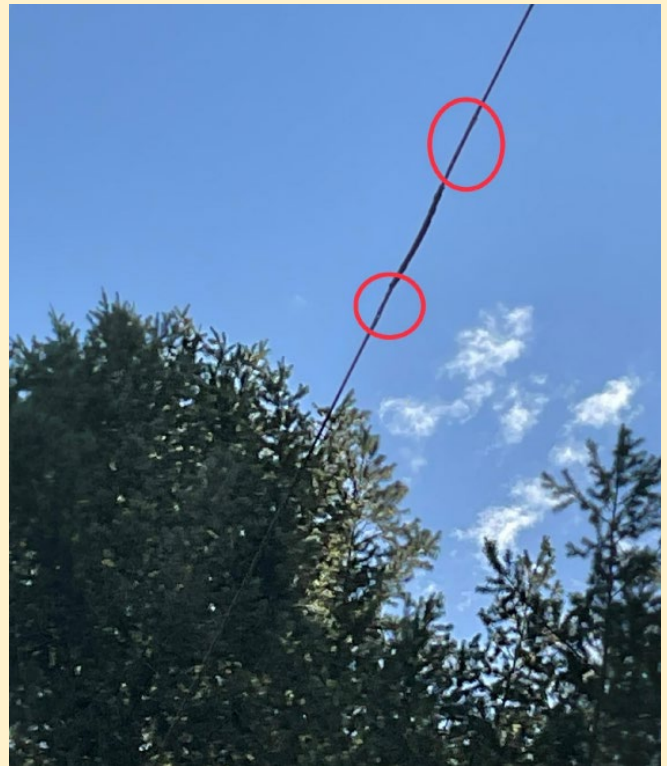

At this Location: Bird caging guy wire



Perform Minor Work: No

Write 3rd Party Notification: No

Write EC Notification: No






Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atdh02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

BIRD CAGING SERVICE NEUTRAL	
	At this Location: Bird caging on service neutral. Not excessive bird caging.  
	Perform Minor Work: No
	Write 3rd Party Notification: No
	Write EC Notification: No



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

BIRD CAGING ON ARMOR ROD NON-COMPELLING



At this Location: Bird caging on armor rod. Not excessive.



Perform Minor Work: No

Write 3rd Party Notification: No

Write EC Notification: No



E. Is there cracked AWAC conductor? Or localized corrosion on lashing or neutral conductor interfaces? (Secondary)

1. (No) No action
2. (Yes) Is hot leg exposed?
 - a. (No) Repair/Replace Level IIX
 - b. (Yes) Repair/Replace Level IA

CRACKED SERVICE



At this Location: Corrosion, lashing is fused to conductor, hot leg is clearly exposed.



Perform Minor Work: No

Write 3rd Party Notification: No

Write EC Notification: Yes

FDA= Conductor Damaged / Replace

Priority = A Tag, follow the emergency process.



Category 2 – Connector/jumper visual assessment

Visually check for excessively corroded or damaged connectors and dead-end hardware which has a potential to fail, drop conductor, or cause an ignition.

- **General Guidance:** If observed, create EC Notification to replace connectors or dead-end hardware

A Tag:

- Any cracking Circumferential (Vertical/Perpendicular to length of splice).
- Any cracking Longitudinal to end of splice. (Horizontal/Parallel to length of splice).

X Tag:

- Longitudinal (horizontal) cracking in middle of splice, NOT extending to end
- Corrosion hole(s) near end of splice
- Visual signs of conductor slipping

B Tag:

- NO Cracking
- YES, to excessive, corrosion, pitting and/or minor/moderate conductor necking.

No Tag:

- NO Cracking
- Minor corrosion, missing pilot funnels, no cracking or physical degradation.

F. Is the splice/connector/automatic dead-end damaged, corroded or cracked?

1. (No) No Action
2. (Yes) Repair/Replace A Tag



Job Aid: Overhead Assessment






TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atrch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

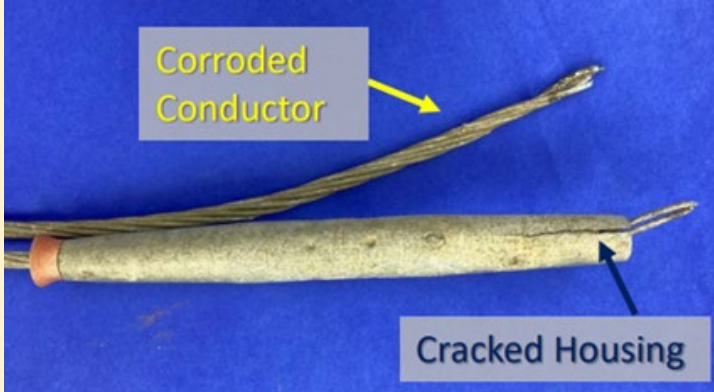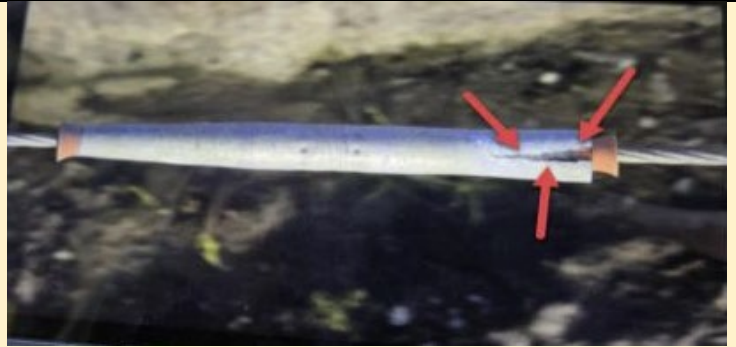Example

DAMAGED, CORRODED, CRACKED SPLICES OR AUTOMATIC DEAD-ENDS	
	
	
At this Location: Crack is longitudinal AND compromises end(s) of splice  	
Perform Minor Work: No	
Write 3rd Party Notification: No	
Write EC Notification: Yes	
FDA= Conductor / Broken Splice / Damaged / Replace	
Priority = A tag, follow emergency process	



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003A1ch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

BROKEN DEAD-END



At this Location: Longitudinal crack to end of dead-end.



Perform Minor Work: No

Write 3rd Party Notification: No

Write EC Notification: Yes

FDA= Conductor / Broken Splice / Damaged/Replace

Priority = A Tag, follow emergency process

CRACKED DEAD END AND SPLICE



At this Location: Longitudinal (Horizontal) cracking in the middle of splice, NOT extending to the end.



Perform Minor Work: No

Write 3rd Party Notification: No


Write EC Notification: Yes

FDA= Conductor / Broken Splice / Damaged Replace

Priority = X Tag, depending on exposure.



CONDUCTOR SLIPPING

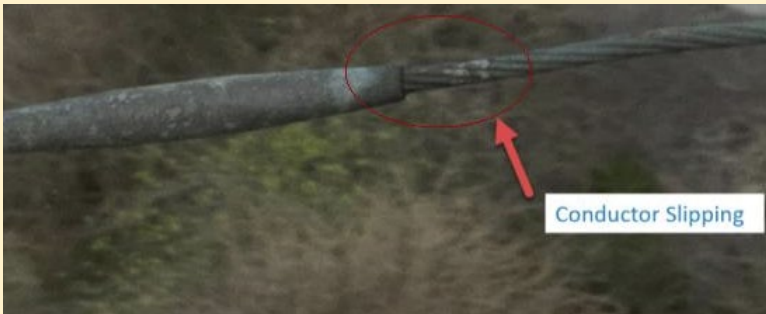

At this Location: Conductor slipping from splice. Visual marking of conductor has been moved compared to end of splice.



Perform Minor Work: No

Write 3rd Party Notification: No

Write EC Notification: Yes

FDA= Conductor / Broken Splice / Damaged/Replace

Priority = X Tag, depending on exposure.

**CORROSION ON SPLICE OR DEAD END**

At this Location: Corrosion on splice – discoloration on aluminum.




Perform Minor Work: No

Write 3rd Party Notification: No

Write EC Notification: Yes

FDA= Conductor / Broken Splice / Damaged/Replace

Priority = B Tag, depending on exposure.

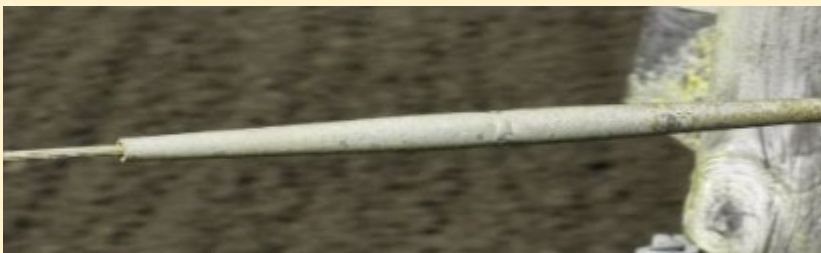NON-COMPELLING SPLICE EXAMPLE

At this Location: No cracking or physical degradation. Minor corrosion and missing pilot funnels, is not an abnormal compelling condition.



Perform Minor Work: No

Write 3rd Party Notification: No

Write EC Notification: No



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atrch02

Publication: 01/06/2025 Effective: 01/14/2025




Rev: 14

G. Is the insulation tape on connector deteriorating?

1. (No) No Action
2. (Yes) Repair/Replace E Tag

Example

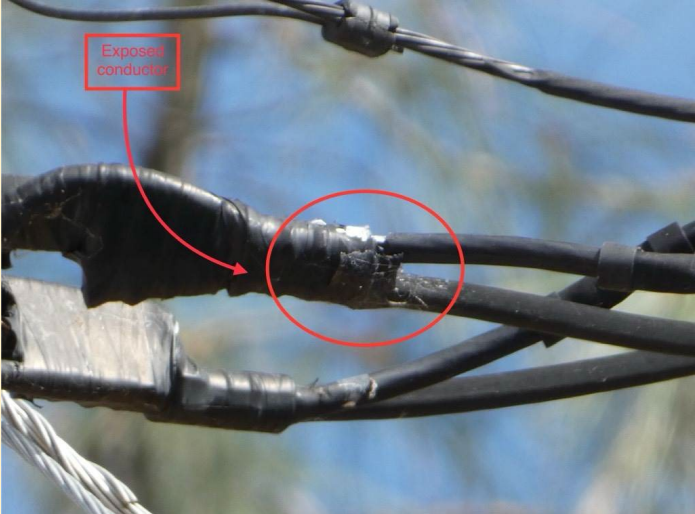CONNECTOR WITH DETERIORATED TAPE	
	At this Location: Deteriorated tape insulation, potential cross-phasing  
	Perform Minor Work: No
	Write 3rd Party Notification: No
	Write EC Notification: Yes FDA= Connector/ Insulation Deteriorated / Repair Priority = E Tag, depending on exposure

CONNECTOR WITH DETERIORATED TAPE	
	At this Location: Deteriorated tape insulation, potential cross-phasing.  
	Perform Minor Work: No
	Write 3rd Party Notification: No
	Write EC Notification: Yes FDA= Connector/ Insulation Deteriorated / Repair Priority = E Tag, depending on exposure



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atrch02

Publication: 01/06/2025 Effective: 01/14/2025


Rev: 14

H. Is the jumper frayed and/or burnt?

1. (No) No Action
2. (Yes) Repair/Replace E Tag

Examples

BURT JUMPER

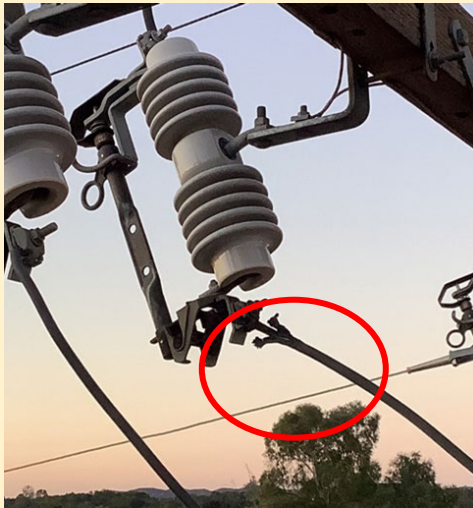

At this Location: Primary jumpers and / or transformer secondary connection jumpers frayed and burnt. Insulation showing signs of deforming.



Perform Minor Work: No

Write 3rd Party Notification: No

Write EC Notification: Yes

FDA = Jumper / Burnt / Replaced

Priority = E Tag, depending on exposure



Category 3 – Loose Primary Neutral Ground

Look for broken service neutrals, or signs that the neutral is in poor condition i.e., damaged, burnt, loose, corroded, showing signs of wearing and about to fail. Conductor separation issues.

General Guidance: Use binoculars. If observed, Create EC to repair or replace conductor

I. Is the primary neutral/ground unsupported or hanging?

1. (No) No Action
2. (Yes) Repair/Replace Level II: up to 6 months.



Job Aid: Overhead Assessment







TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

Example

LOOSE PRIMARY NEUTRAL GROUND	
	
At this Location: Loose primary neutral ground run, unsupported conductor, hanging.  	At this Location: Loose primary neutral ground run, unsupported conductor, hanging.  
Perform Minor Work: No	Perform Minor Work: No
Write 3rd Party Notification: No	Write 3rd Party Notification: No
Write EC Notification: Yes FDA = Molding, Loose, Adjust Priority = B Tag, depending on exposure	Write EC Notification: Yes FDA = Molding, Loose, Adjust Priority = B Tag, depending on exposure

Category 4- Incorrectly installed splices/connectors

Are secondary connectors (mini wedge and Insulink) installed on primary conductor?

Guidance: If yes, write EC notification to replace connector.

J. Are secondary connectors installed on primary?

1. (No) No Action
2. (Yes) Repair/Replace F Tag



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003A1ch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

Example

SECONDARY CONNECTOR INSTALLED ON PRIMARY



At this Location: Secondary connector installed on primary.



Perform Minor Work: No

Write 3rd Party Notification: No

Write EC Notification: Yes

FDA: Connector / Incorrectly Installed / Replace

Priority: F Tag, depending on exposure




Job Aid: Overhead Assessment

TD- 2305M-JA02


WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

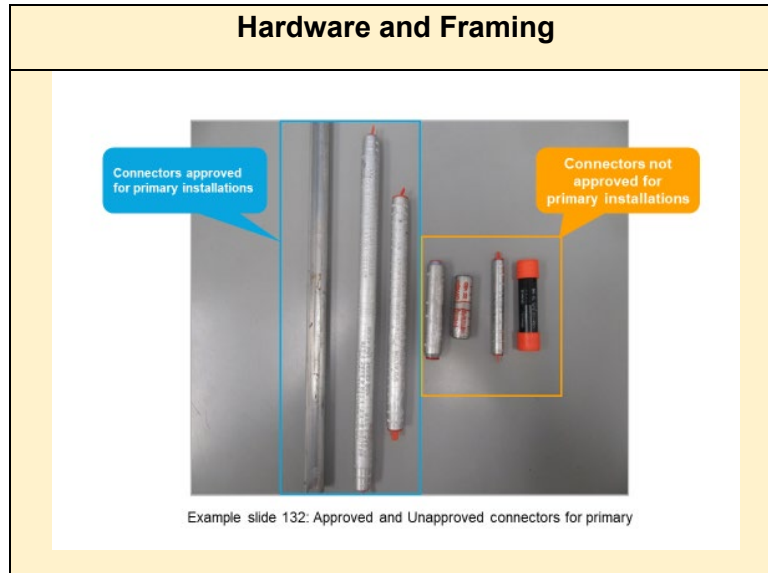

Wedge Connectors

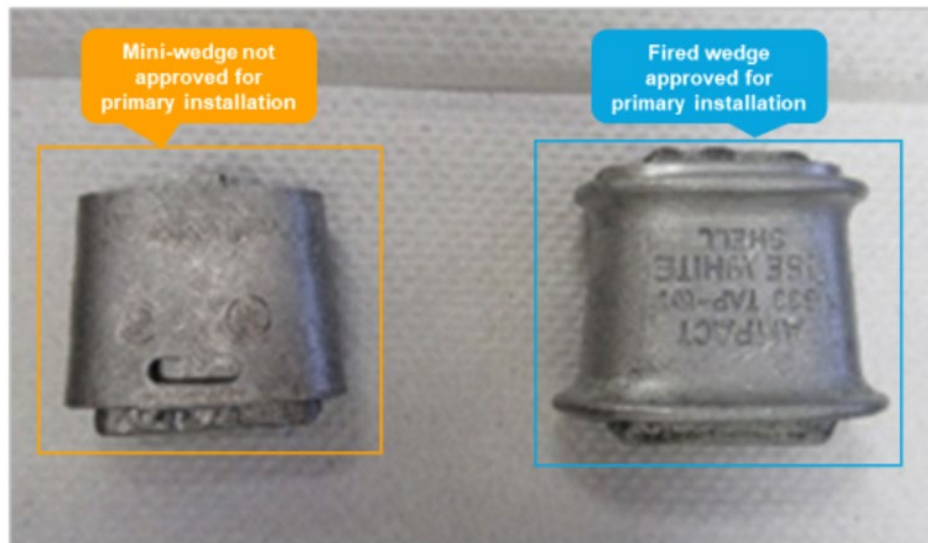



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

Are tap clamps installed incorrectly?

Guidance: If yes, write EC notification to replace connector.

- a. Identify improperly installed tap clamps (aka chance clamps); e.g.
 - i. Installed on armor rod (used for tying in conductor with hand ties; not an appropriate method of attaching tap clamps) (Refer to Category 4, K)
 - ii. No tap guards installed on conductor smaller than 1/0 Al and/or smaller than #2 Cu (Refer to Category 4, K)
 - iii. Installed on tap lines (jumpers) feeding more than 2 transformers based on what inspectors can see in the field (transformer banks count as 1 transformer). (Refer to Category 4, L)
 - iv. Used on any other type of equipment (recloser, capacitor, regulator, risers, etc.) other than a transformer. (Refer to Category 4, L)

Note: *Chance Clamp is a brand name; this is also known as a hot-line clamp or tap clamp, etc. Parallel Grove Connectors (PGs) are not included. PG's acceptable on armor rod is grandfathered from FRO standard 043052.*

K. Are tap clamps installed without tap guard or over armor rod?

1. (No) No Action
2. (Yes) Repair/Replace F Tag

L. Are tap clamps installed on primary energized conductors that meet criteria on note a-ii, a-iii and a-iv?

1. (No) No Action
2. (Yes) Repair/Replace E Tag



Job Aid: Overhead Assessment




TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

Example

INCORRECTLY INSTALLED CHANCE CLAMP	
 <p>Tap clamp on armor rod installed incorrectly.</p>	<p>At this Location: Incorrectly installed per note C above - chance clamp on armor rod.</p> <p> </p>
	<p>Perform Minor Work: No</p>
	<p>Write 3rd Party Notification: No</p>
	<p>Write EC Notification: Yes</p>
	<p>FDA: Connector / Incorrectly Installed / Replace</p> <p>Priority: F Tag, depending on exposure</p>



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14


Are connections made with dissimilar metals installed incorrectly?

Proper installation is Aluminum over Copper.

Guidance: If installed incorrectly, write EC notification to replace connector.

Copper over Aluminum (cu/al) causes salts to drip down on copper causing accelerated corrosion

ALUMINUM OVER COPPER

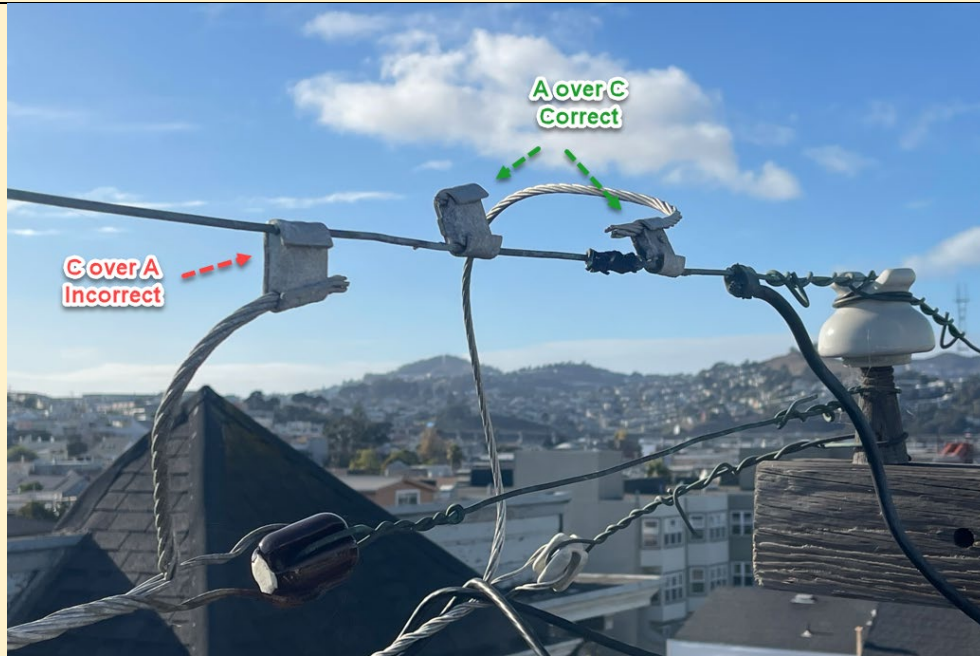

At this Location Copper over Aluminum Installation.



Perform Minor Work: No

Write 3rd Party Notification: No

Write EC Notification: Yes

FDA: Connector / COPPER OVER ALUMINUM / Replace

Priority: E Tag, depending on exposure.

M. Is dissimilar metal connection(s) made with the copper (CU) over aluminum (AL)?

1. (No) No Action
2. (Yes) Repair/Replace E Tag



Job Aid: Overhead Assessment

TD- 2305M-JA02




WMP-Discovery2023-2025 DR SPD 024-Q003Atrch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

N. Is vibration damper installed over splice preventing free movement?

1. (No) No Action
2. (Yes) Repair/Replace E Tag

SPIRAL DAMPNER	
	At this Location: Spiral dampener installed over splice preventing free movement.  
	Perform Minor Work: No
	Write 3rd Party Notification: No
	Write EC Notification: Yes FDA= Conductor / Splice/Tied In / Replace
	Priority = E tag, depending on exposure.

O. Splice under the tie wire or tied into the insulator?

1. (No) No Action
2. (Yes) Repair/Replace E Tag

Examples

SPLICES TIED INTO THE INSULATOR OR UNDER THE TIE WIRE



At this Location: Splice under the tie wire or tied into the insulator.



Perform Minor Work: No

Write 3rd Party Notification: No

Write EC Notification: Yes

FDA = Conductor / Splice Tied In / Replace

Priority = E Tag, depending on exposure

SPLICES TIED INTO THE INSULATOR OR UNDER THE TIE WIRE – AERIAL VIEW



At this Location: Splice under the tie wire or tied into the insulator. Splice bent / damaged.

Note: Example of insignificant contamination on insulator. Non-compelling condition.



Perform Minor Work: No

Write 3rd Party Notification: No

Write EC Notification: Yes

FDA = Conductor / Splice Tied In / Replace

Priority = E Tag, depending on exposure



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02
Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

Part 2

Category 5 – Tie Wire Damaged but not broken yet.

Damaged / Corroded

General Guidance: Ensure tie wires are not damaged, broken, or corroded. Repair damaged service or secondary tie wire as minor work if possible. Ensure armor rod is installed and in good condition when applicable.

Visually inspect hand ties to identify wear prior to failure; utilize bucket truck, binoculars, or camera to get a closer look - especially on older installations.

If damage to conductor or tie wire, create EC notification.

Minor Work: Yes, on service or secondary only

IF not able to perform minor work, THEN create EC notification.

EC Notification: Yes, only if not able to perform minor work.

Select the Priority and Due Date based upon compelling abnormal condition.

Reference:

[052990](#) - [Formed Insulator Ties for Distribution Line Conductors](#)

[028853](#) - [Armor Rods and Ties for Aluminum Conductors](#)

[024079](#) - [Armor Rods and Ties for Copper Conductors](#)

P. Is the tie wire loose or hand tie slipping?

1. (No) No action
2. (Yes) Imminent expectation of failure? Or tie wire off insulator?
 - a. (No) Repair/Replace E Tag
 - b. (Yes) Repair/Replace Level IA or IIX

Examples

TIE WIRE SLIPPING AND COMING LOOSE	
	At this Location: Tie wire is slipping.  
	Perform Minor Work: No
	Write 3rd Party Notification: No
	Write EC Notification: Yes
	FDA= Tie wire / Broken/Damaged / Repair / Replace Priority = X Tags, however extenuating circumstances may escalate to A Tag



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003A1ch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

LOOSE TIE WIRE



At this Location: Loose tie wire



Perform Minor Work: No

Write 3rd Party Notification: No

Write EC Notification: Yes

FDA = Tie wire / Broken/Damaged / Repair / Replace

Priority = E tag, depending on exposure.



TIE WIRE LOOSE



At this Location: Tie wire loose allowing insulators to spin, conductor not seated properly in the insulator saddle.



Perform Minor Work: No

Write 3rd Party Notification: No

Write EC Notification: Yes

FDA= Tie wire / Broken/Damaged / Repair / Replace

Priority = E Tag, depending on exposure.

INSULATOR GROOVE



At this Location: Up-strain on the conductor and the tie is not tight enough to secure the conductor in the insulator saddle.



Perform Minor Work: No

Write 3rd Party Notification: No

Write EC Notification: Yes

FDA= Tie wire / Broken/Damaged / Repair / Replace

Priority= E tag, depending on exposure.



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atrch02




Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

Q. Is the tie wire worn and/or corroded, and/or strands are broken?

1. (No) No action
2. (Yes) Is corrosion product staining insulator? (signs of excessive staining/discoloring of insulator) Or strands broken with imminent expectation of failure?
 - a. (No) Repair/Replace E Tag
 - b. (Yes) Repair/Replace Level IA or IIX

Examples

TIE WIRE CORRODED	
	At this Location: Tie wire is corroded, strand is broken.  
	Perform Minor Work: No
	Write 3rd Party Notification: No
	Write EC Notification: Yes
	FDA= Tie Wire / Corroded / Replace Priority = X tag, depending on exposure.



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

BROKEN / CORRODED TIE WIRE



At this Location: Broken tie wire



Perform Minor Work: No

Write 3rd Party Notification: No

Write EC Notification: Yes

FDA = Tie wire / Broken/Damaged / Repair / Replace

Priority = X Tag, depending on exposure.



Job Aid: Overhead Assessment


TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atrch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

BROKEN / CORRODED TIE WIRE

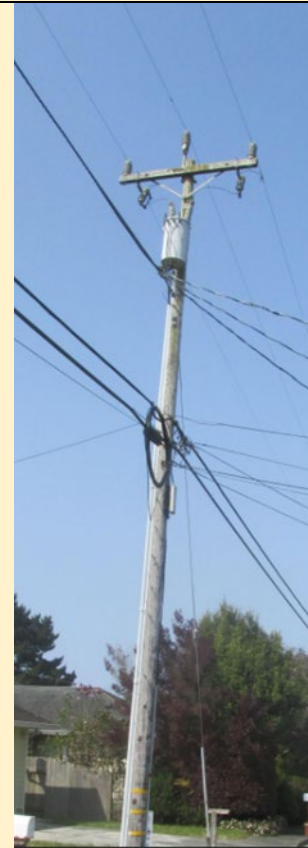

At this Location: Corroded and broken tie wire, top tie, with one strand remaining, held in correct position by downward force.



Perform Minor Work: No

Write 3rd Party Notification: No

Write EC Notification: Yes

FDA = Tie wire / Broken/Damaged / Repair / Replace

Priority = E tag, depending on exposure.



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

BROKEN / CORRODED TIE WIRE



At this Location: Broken tie wire



Perform Minor Work: No

Write 3rd Party Notification: No

Write EC Notification: Yes

FDA = Tie wire / Broken/Damaged / Repair / Replace

Priority = E tag, depending on exposure.

R. Is the tie wire improperly installed?

1. (No) No action
2. (Yes) Is it possible for the conductor to become unattached from the insulator?
 - (No) Repair/Replace E Tag
 - (Yes) Repair/Replace Level IA or IIX



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atrch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

Examples

IMPROPERLY INSTALLED TIE SLIPPED BELOW INSULATOR	
	<p>At this Location: Improperly installed tie slipped below the insulator, now hanging from the spool pin.</p> <p> </p>
	<p>Perform Minor Work: No</p>
	<p>Write 3rd Party Notification: No</p>
	<p>Write EC Notification: Yes</p> <p>FDA= Tie wire / Broken/Damaged / Repair / Replace</p> <p>Priority = E Tag, depending on exposure.</p>



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02




Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

S. Is the insulator steel pin bent? (Especially on angle poles)

1. (No) No action
2. (Yes) Is it possible for conductor to conductor to become unattached from the insulator?
 - a. (No) Repair/Replace E Tag
 - b. (Yes) Repair/Replace Level IA or IIX

Examples

ANGLE POLE WITH TIE WIRE, BENT STEEL PIN	
	At this Location: Angle pole with post top insulator, where the inside angle insulator conductor is only being supported by tie wire (non-clamped). Post top insulator steel pin is bent.
	 
	Perform Minor Work: No
	Write 3rd Party Notification: No
	Write EC Notification: Yes
	FDA= Tie wire / Broken/Damaged / Repair / Replace
	Priority = X Tag, depending on exposure.



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025


Rev: 14

Category 6 – Floater (tie wire broken or insulator is broken from framing)

T. Is the conductor floating? Or sitting on the crossarm?

1. (No) No action
2. (Yes) Repair/Replace Level IA or IIX

Examples

BROKEN TIE WIRE	
	At this Location: Broken tie wire, which caused a floating conductor condition (sitting on the cross-arm) Insufficient clearance.  
	Perform Minor Work: No
	Write 3rd Party Notification: No
	Write EC Notification: Yes
	FDA= Conductor / Floater / Repair Priority= A Tag, Follow emergency procedure



Job Aid: Overhead Assessment


TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003A1ch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

FLOATER – CONDUCTOR TOUCHING CROSSARM

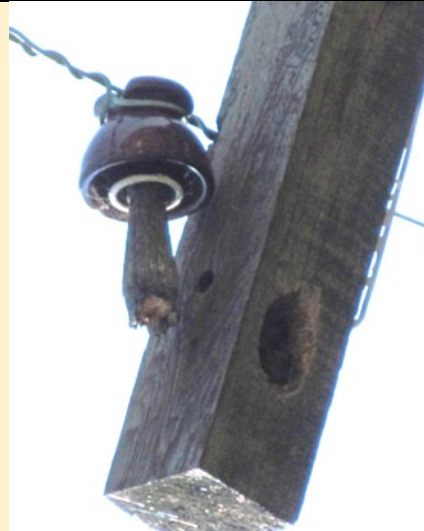

At this Location: Insulator lying on its side. Conductor lying on crossarm regardless of Primary or Secondary.



Perform Minor Work: No

Write 3rd Party Notification: No

Write EC Notification: Yes

FDA= Crossarm / Decayed/Rotten / Replace

FDA= Conductor / Floater / Repair

Priority= A Tag, depending on exposure.



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

FLOATER



At this Location: Floater, conductor is not contacting the arm. Rotten crossarm.



Perform Minor Work: No

Write 3rd Party Notification: No

Write EC Notification: Yes

FDA=Crossarm / Decayed/Rotten/ Replace

FDA= Conductor / Floater / Repair

Priority= X Tags, however extenuating circumstances may escalate to A Tag (*refer to clearance section when there is reduced clearance do to not tied to structure*).

COMMON NEUTRAL FLOATER



At this Location: Common neutral floater not touching structure.



Perform Minor Work: No

Write 3rd Party Notification: No

Write EC Notification: Yes






FDA= Conductor / Floater / Repair

Priority= X Tags, depending on exposure.

U. Is the conductor out of the insulator groove?

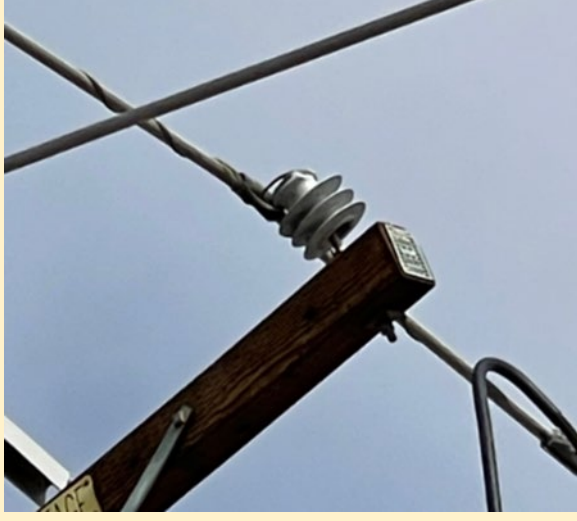1. (No) No action
2. (Yes) Is it possible for the conductor to fall off the insulator?
 - a. (No) Repair/Replace E Tag
 - b. (Yes) Repair/Replace Level IA or IIX

Examples

CONDUCTOR TIED TO SIDE OF SKIRT, NOT IN GROOVE	TIE WIRE BROKEN / LOOSE / NOT IN GROOVE
	
<p>At this Location: Insulator spun, and conductor tied on the skirt.</p> <div data-bbox="203 1297 337 1360">   </div>	<p>At this Location: Tie Wire Broken / Loose / Not in Groove</p> <div data-bbox="792 1297 862 1360">  </div>
<p>Perform Minor Work: No</p>	<p>Perform Minor Work: No</p>
<p>Write 3rd Party Notification: No</p>	<p>Write 3rd Party Notification: No</p>
<p>Write EC Notification: Yes</p> <p>FDA = Tie Wire / Broken/Damaged / Replace</p> <p>Priority = X tag, depending on exposure.</p>	<p>Write EC Notification: Yes</p> <p>FDA = Tie Wire / Improperly Installed / Repair</p> <p>Priority = X tag, depending on exposure.</p>



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

QUESTIONABLE TIE WIRE



At this Location: Not obvious if it is still attached. Insulator has spun.



Perform Minor Work: No

Write 3rd Party Notification: No

Write EC Notification: Yes

FDA = Tie wire / Broken/Damaged / Repair / Replace

Priority = X Tag, depending on exposure.



Job Aid: Overhead Assessment




TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

Category 7 – Conductor Clearance

JUMPER TENSION

At this Location: Jumper Tension, pulling over cutout.
 
Perform Minor Work: No
Write 3rd Party Notification: No
Write EC Notification: Yes
FDA= Jumper / Clearance impaired / Adjust
Priority= E Tag, depending upon exposure



Job Aid: Overhead Assessment

TD- 2305M-JA02




WMP-Discovery2023-2025 DR SPD 024-Q003Atch02
Publication: 01/06/2025 Effective: 01/14/2025




Rev: 14

V. Is there insufficient clearance between conductor/connector and cross-arm.

1. (No) No action
2. (Yes) Repair/Replace E Tag

Example

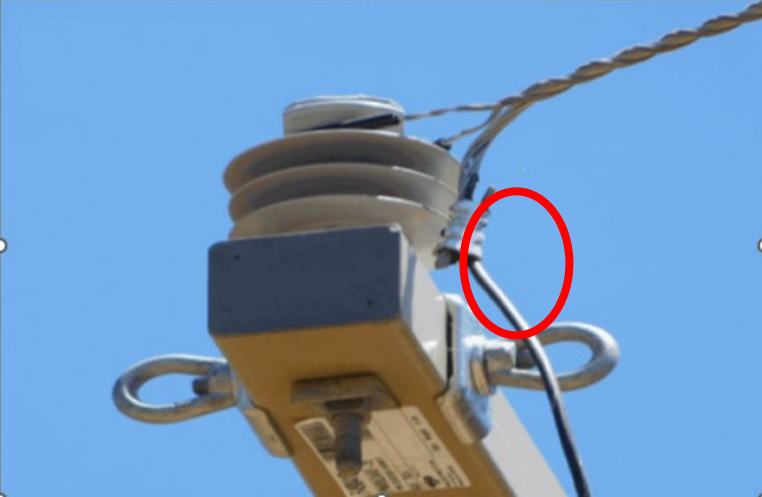INSUFFICIENT CLEARANCE – AERIAL VIEW	
	At this Location: Over the top jumper laying on cross-arm.
	 
	Perform Minor Work: No
	Write 3rd Party Notification: No
	Write EC Notification: Yes FDA: Jumper / Clearance / Impaired / Adjust Priority: A Tag, Follow the emergency process

INSUFFICIENT CLEARANCE	
	At this Location: Insufficient clearance between connector and cross-arm
	 
	Perform Minor Work: No
	Write 3rd Party Notification: No
	Write EC Notification: Yes FDA: Conductor / Clearance / Impaired / Adjust Priority: E Tag, depending on exposure



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

JUMPER CLEARANCE

At this Location: Jumper Clearance  
Perform Minor Work: No
Write 3rd Party Notification: No
Write EC Notification: Yes FDA= Jumper / Clearance impaired / Adjust Priority = E Tag, depending on exposure



W. If it looks marginal to the eye, inspector to stop and measure using diagnostic tool. Pay specific attention to road crossings, spans where conductors roll (horizontal to vertical) and look for clearance condition

Reference clearance job aid within this document.

Is the conductor sagging and does not meet the required clearance distance?

1. (No) No action
2. (Yes) Is there a public safety hazard?
 - a. (No) Repair/Replace E Tag
 - b. (Yes) Repair/Replace Level IA or IIX









Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02
Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

Example

UNSUPPORTED TRANSMISSION LINE WITH DIMINISHED CLEARANCE	
	
	
<p>At this Location: Unsupported transmission line with diminished clearance to the distribution level seen from the ground or aerial.</p> <p> </p>	
<p>Perform Minor Work: No</p>	
<p>Write 3rd Party Notification: No</p>	
<p>Write EC Notification: Yes</p> <p>FDA = OH Facility / Transmission Issue / Create LC</p> <p>Priority = E Tag, depending on exposure</p>	



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02




Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

X. Uneven Sag?

1. (No) No action
2. (Yes) Is the conductor low or in danger of making contact to adjacent phase or object?
 - a. (No) Repair/Replace E Tag
 - b. (Yes) Repair/Replace Level IA or IIX

Examples

SAGGING CONDUCTOR	
	At this Location: Sagging Conductor  
	Perform Minor Work: No
	Write 3rd Party Notification: No
	Write EC Notification: Yes FDA= Conductor / Sag / Clearance / Adjust PRIORITY= E Tag, depending on exposure.

- A. Open wire secondary conductor with rack construction has missing spreader brackets for spans > 135'.

General Guidance: If observed, create EC Notification to have spreader brackets installed where bucket truck accessible; use line of sight and if available, foreman-cane or rangefinder.



Job Aid: Overhead Assessment

TD- 2305M-JA02


WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

OPEN WIRE RACK CONSTRUCTION

Example: Open wire
rack construction

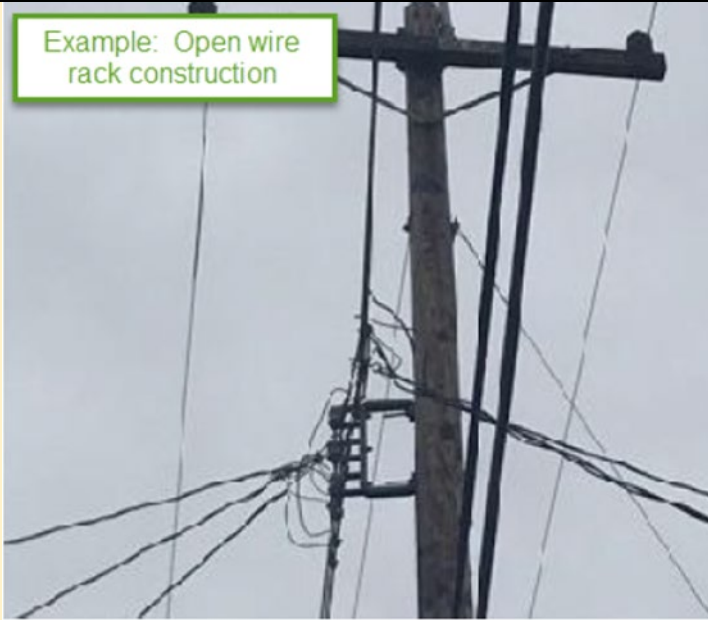

At this Location: Span length >135' missing spreader bracket for open wire extended rack construction.



Perform Minor Work: No

Write 3rd Party Notification: No

Write EC Notification: Yes

FDA= Conductor / Sag / Clearance / Install
Spreader Bracket

Priority = E Tag, 3-12 months depending on
exposure



Service Conductor

Category 1 – Exposed hot leg on the service.

As previously stated on page 14 - OH Inspections: Inspection Requirements

- You are required to view all conductor(s) to mid-span or to the weather-head or to the termination point –
- If you are unable to perform the task above, you will be required to create a CGI notification in the Inspect App.


Look for broken service neutrals go to Flow A, if there are signs that the neutral is in poor condition i.e., damaged, burnt, loose, corroded, showing signs of wearing and about to fail, go to process Flow B. Conductor separation issues. Any damaged and exposed conductor or insulation needs to be addressed, but sufficient airgap with low chance of cross phase may lower priority.

General Guidance: Use binoculars. If observed, Create EC to repair or replace conductor

A. Is there a broken or open service neutral?

1. (No) No action
2. (Yes) Repair/Replace Level IA or Level IIX

BROKEN OR OPEN SERVICE NEUTRAL

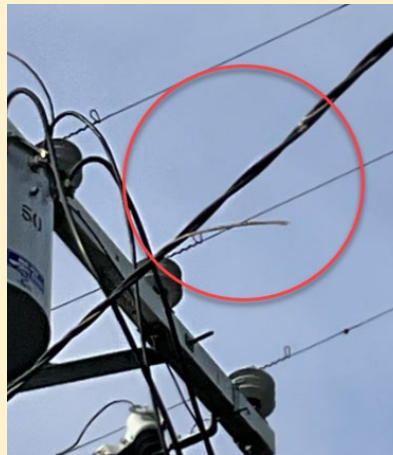

At this Location: Broken / Open Service neutral.



Perform Minor Work: Yes, if safe to do so. If you replace the service conductor, this is capital Minor Work. Fill out EC Notification to account for this minor work.

Write 3rd Party Notification: No

Write EC Notification: Yes, if minor work is not possible, or to document completed capital minor work.

FDA = Conductor / Broken/Damaged / Repair or Replace

Priority = A Tag, Emergency due to broken service neutral, follow emergency process



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

EXAMPLE OF DAMAGE BEFORE INSTALLATION



At this Location: Service insulation damaged on the surface.



Perform Minor Work: Yes

Write 3rd Party Notification: No

Write EC Notification: Yes

FDA= Conductor / Broken/Damaged / Repair

Priority = E Tag, depending on exposure

Is the service conductor cracked, exposing the hot leg?

- **General Guidance:** Use binoculars. Evaluate service drops looking for cracked or damaged insulation exposing hot legs and bundled together cross phase. If insulation is cracked or damaged to the point where hot leg is exposed, this is a minimum X Tag and maybe an Emergency/Standby condition.

B. Deteriorated service wire exposing one of the hot legs and bundled together with a potential for cross phase?

1. (No) No action
2. (Yes) Repair/Replace Level IA or IIX



Job Aid: Overhead Assessment




TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atrch02





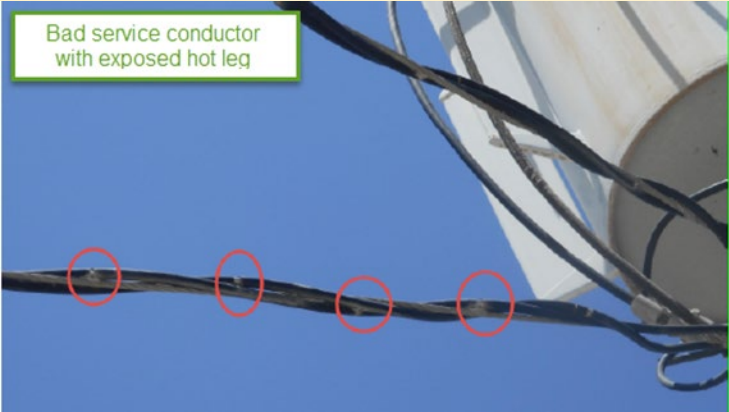

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

Examples

BAD SERVICE CONDUCTOR WITH EXPOSED HOT LEG	
	<p>At this Location: Bad service conductor with exposed hot leg, bundled with a potential to cross phase.</p> <p> </p>
	<p>Perform Minor Work: No</p>
	<p>Write 3rd Party Notification: No</p>
	<p>Write EC Notification: Yes</p> <p>FDA: FDA = Conductor / Broken/Damaged / Replace</p> <p>Priority: X Tag or A Tag, depending on exposure.</p>



OVERHEAD SERVICE STRAIN OR ABRASION	OVERHEAD SERVICE STRAIN OR ABRASION
	
<p>At this Location: Service strain abrasion, with possible burning at some sections. Damaged insulation.</p>  	<p>At this Location: Service strain abrasion, no slack remaining.</p>  
<p>Perform Minor Work: Yes, if safe to do so. If you replace the service conductor, this is capital Minor Work.</p> <p>Fill out EC Form to account for this minor work; charge time to your division standing order.</p>	<p>Perform Minor Work: Yes, if safe to do so. If you replace the service conductor this is capital Minor Work.</p> <p>Fill out EC Form to account for this minor work; charge time to your division standing order.</p>
Write 3rd Party Notification: No	Write 3rd Party Notification: No
<p>Write EC Notification: Yes, if minor work not possible, or to document completed capital minor work</p> <p>FDA = Conductor / Broken/Damaged / Repair or Replace</p> <p>Priority = E Tag, depending on exposure, in comments add note about strain abrasion burnt conductor</p> <p>If abrasion has caused an exposed hot leg, assign Priority "A", emergency, and stand-by.</p>	<p>Write EC Notification: Yes, if minor work not possible, or to document completed capital minor work</p> <p>FDA = Conductor / Broken/Damaged / Repair or Replace</p> <p>Priority = E Tag, depending on exposure, in comments add note about strain abrasion burnt conductor</p> <p>If abrasion has caused an exposed hot leg, assign Priority "A", emergency, and stand-by.</p>



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

Visually check service conductors going into riser, especially at the bend radius and cable grip, observe potential fraying of the conductor insulation at the entry point to the molding or conduit for exposed hot leg, etc.

General Guidance: Use binoculars. If observed, Create EC to repair or replace conductor.

C. Is the hot leg frayed at the entry point of molding of the riser?

1. (No) No action
2. (Yes) Repair/Replace Level IA or IIX

Example

SECONDARY SERVICE RISER DROPS



At this Location: hot leg insulation frayed at the point of entry point of the molding exposing the conductor into contact with the neutral



Perform Minor Work: No

Write 3rd Party Notification: No

Write EC Notification: Yes




FDA= Conductor / Broken/Damaged / Replace

Priority= A Tag or X tag depending on exposure.

**D. Is service conductor insulation cracked, abrasions, holes?**

1. (No) No action
2. (Yes) Is Hot Leg Exposed?
 - a. (No) Repair/Replace E Tag
 - b. (Yes) Is there localized corrosion on lashing or neutral conductor interfaces?
 - i. (Yes) Repair/Replace Level I: A
 - ii. (No) Is there sufficient airgap between conductors?
 1. (Yes) Repair/Replace E Tag
 2. (No) Repair/Replace Level II: X

Examples

DAMAGED / CRACKED GREY SERVICE	
	<p>At this Location: Cracked grey service / Aerial cable. Older grey services tend to crack and will appear to have rings around the protective coating/insulation. Loose lashing, visually cracked, discoloration/corrosion, Degradation. No evidence of arching.</p> <p> </p>
	<p>Perform Minor Work: Yes, if safe to do so. If you replace the service conductor, this is capital Minor Work.</p> <p>Fill out EC Notification to account for this minor work.</p>
	<p>Write 3rd Party Notification: No</p>
	<p>Write EC Notification: Yes</p> <p>FDA=Conductor / Broken / Replace OR FDA=Conductor / Damaged / Replace OR FDA=Conductor / Burnt / Replace</p>
	<p>Priority = E Tag, depending on exposure <u>Consider A-Tag</u> if signs of tracking between phases presents.</p>



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02




Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

E. Is there exposed service connector?

1. (No) No action
2. (Yes) Can Minor work be performed?
 - a. (No) Repair/Replace E Tag (Consider A-Tag, if signs of tracking)
 - b. (Yes) Perform Minor Work

Examples

EXPOSED SERVICE CONNECTOR	
	At this Location: Exposed Conductors, with an acceptable air gap between conductors  
	Perform Minor Work: Yes, if safe to do so
	Write 3rd Party Notification: No
	Write EC Notification: Yes, if minor work cannot be performed. FDA= Connector / Insulation/Deteriorated / Repair Priority = E Tag, depending on exposure <u>Consider A-Tag</u> if signs of tracking between phases presents.



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atrch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

EXPOSED CONDUCTOR



At this Location: Hot leg is exposed next insulink.

Perform Minor Work: Yes

Write 3rd Party Notification: No

Write EC Notification: Yes

FDA= Conductor / Broken/Damaged / Repair

Priority = E Tag, depending on exposure
Consider A-Tag if signs of tracking between phases presents.

Note: Carefully evaluate for potential of conductors to get together



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atrch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

EXPOSED CONDUCTOR



At this Location: Hot leg exposed next to insulink

Perform Minor Work: Yes

Write 3rd Party Notification: No

Write EC Notification: Yes

FDA= Conductor / Exposed / Repair

Priority = E Tag, depending on exposure
Consider A-Tag if signs of tracking between phases presents.



Job Aid: Overhead Assessment


TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

INSULATION DETERIORATED

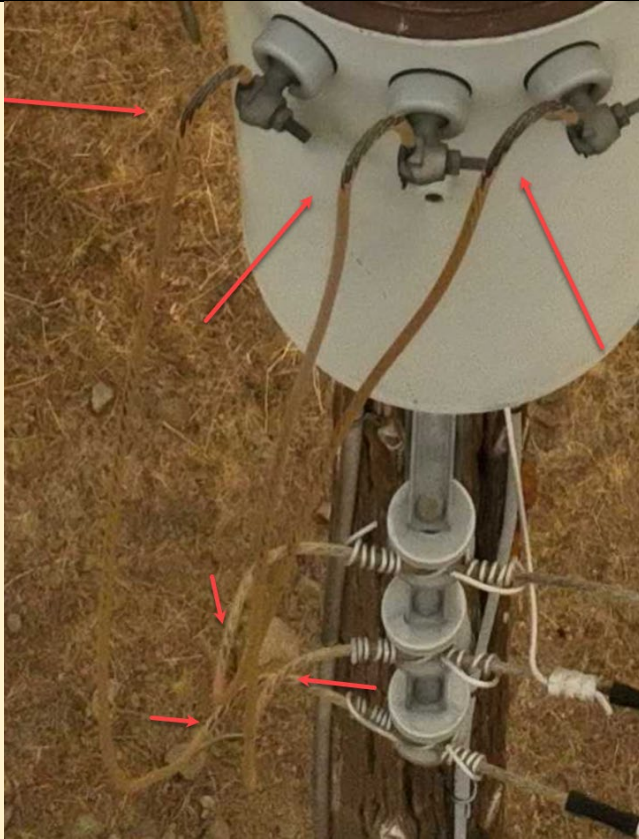

At this Location: Coated insulation wire has deteriorated. Exposed wire on secondary buss wire.

Consider replacing buss wire if repairing insulation would be inadequate.

Perform Minor Work:

Write 3rd Party Notification: No

Write EC Notification: Yes

FDA= Conductor / Broken/Damaged / Repair

FDA = Conductor /Broken/Damaged / Repair

Priority = E Tag, depending on exposure

Consider A-Tag if signs of tracking between phases presents.



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025


Rev: 14

Category 2 – Broken Service Bob

F. Is service insulator unattached between the conductor and the insulator?

1. (No) No action
2. (Yes) Can Minor work be performed?
 - a. (No) Repair/Replace E Tag
 - b. (Yes) Perform Minor Work

Examples

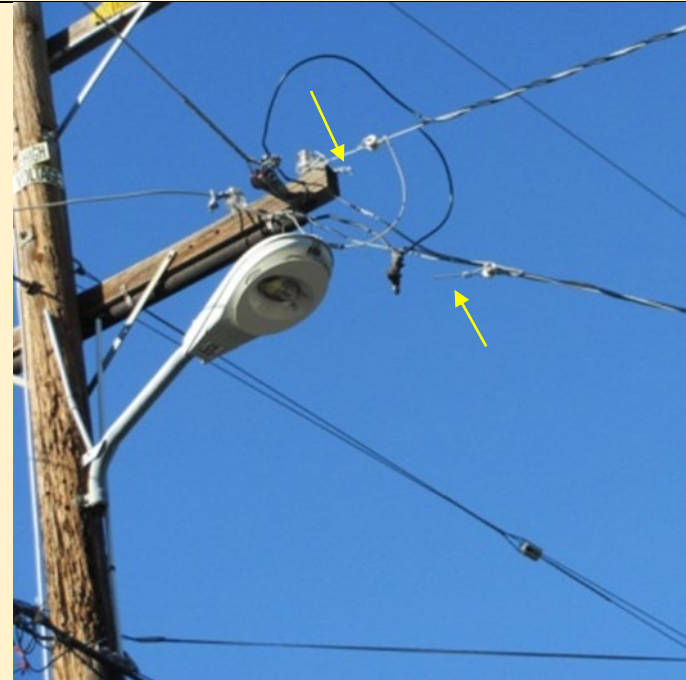HARDWARE BROKEN	
	At this Location: The #6 solid copper is broken causing strain on the conductor. Unsecured service.
	Perform Minor Work: Yes, if safe to do so
	Write 3rd Party Notification: No
	Write EC Notification: Yes, if minor work cannot be performed. FDA= Hardware / Framing / Broken/Damaged / Repair Priority = E Tag, consider X tag or A tag, depending on length of service and exposure.



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

BROKEN SERVICE BOB



At this Location: Broken service Insulator which has become unattached between the copper wire and the insulator.



Perform Minor Work: No


Write 3rd Party Notification: No

Write EC Notification: Yes

FDA= Hardware/Framing /
Broken/Damaged / Repair

Priority= E Tag, consider X tag or A tag,
depending on length of service and
exposure.

PREFORM NOT ATTACHED TO INSULATOR

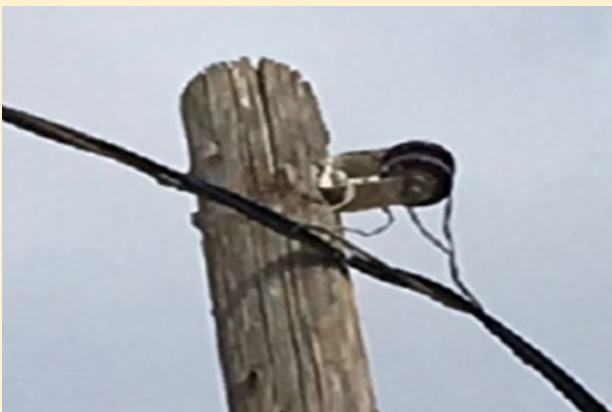

At this Location: Preform not attached to the insulator, rural area, low exposure with no vehicular access.



Perform Minor Work: Yes, if safe to do so.

Write 3rd Party Notification: No

Write EC Notification: Yes

FDA=Tie Wire / Loose / Replace

Priority = E Tag, possible B Tag, depending on
exposure



Category 3 – Conductor Clearance

General Guidance: Refer to the Conductor [Clearance Job Aid](#) and below.

G. Is there insufficient clearance between conductors/connector?

- a. (No) No Action
- b. (Yes) Repair/Replace E Tag

H. Is the conductor sagging and does not meet the required clearance distance?

1. (No) No action
2. (Yes) Is there public safety hazard?
 - a. (No) Repair/Replace E Tag
 - b. (Yes) Repair/Replace Level IA or IIX

I. If service conductor clearance looks marginal to the eye, inspector shall stop and measure using diagnostic tool. Pay specific attention to road crossings and look for clearance condition(s).

Is the service conductor sagging and does not meet the required clearance distance?

3. (No) No action
4. (Yes) Does conductor cross public road?
 - a. (Yes) Is clearance less than 14 feet?
 - i. (Yes) Repair/Replace Level 1: A
 - ii. (No) Is there a public safety hazard?
 1. (Yes) Repair/Replace Level IA or Level IIX
 2. (No) Repair/Replace E Tag
 - b. (No) Is there a public safety hazard?
 - i. (Yes) Repair/Replace Level IA or Level IIX
 - ii. (No) Repair/Replace E Tag



Clearance Evaluation Job Aid

This section is developed based on:

- [TD-2305M-JA12 – Overhead Clearance Evaluation](#)
- [022158 – Clearance Tables CPUC GO95](#)
- [022187-Vertical Separation of Overhead Transmission, Distribution, and Telephone Circuits](#)

to assist Electric Distribution Compliance Inspectors, PG&E Employees, and Contractors in assessing and evaluating conductor clearance issues they visually identify in the field. While this section does not show all examples of allowed clearances, please review the references above for GO95 conductor clearance tables or contact your lead / supervisor for guidance.

This section addresses common conductor clearances such as:

- Wire/Ground minimum allowed clearance (ft)
- Service Drop minimum allowed clearance (ft)
 - Residential
 - Commercial
- Wire/Wire minimum allowed clearance (ft)
 - On same pole
 - On crossing poles
- Wire/Building minimum allowed clearance (ft)



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

Ground Clearances


Guidance Document References:

TD-2305M – EDPM 2011 Manual

Engineering Document 022158 – Clearance Tables CPUC
General Order 95

All Dimensions are in Feet

Ground Clearances - General

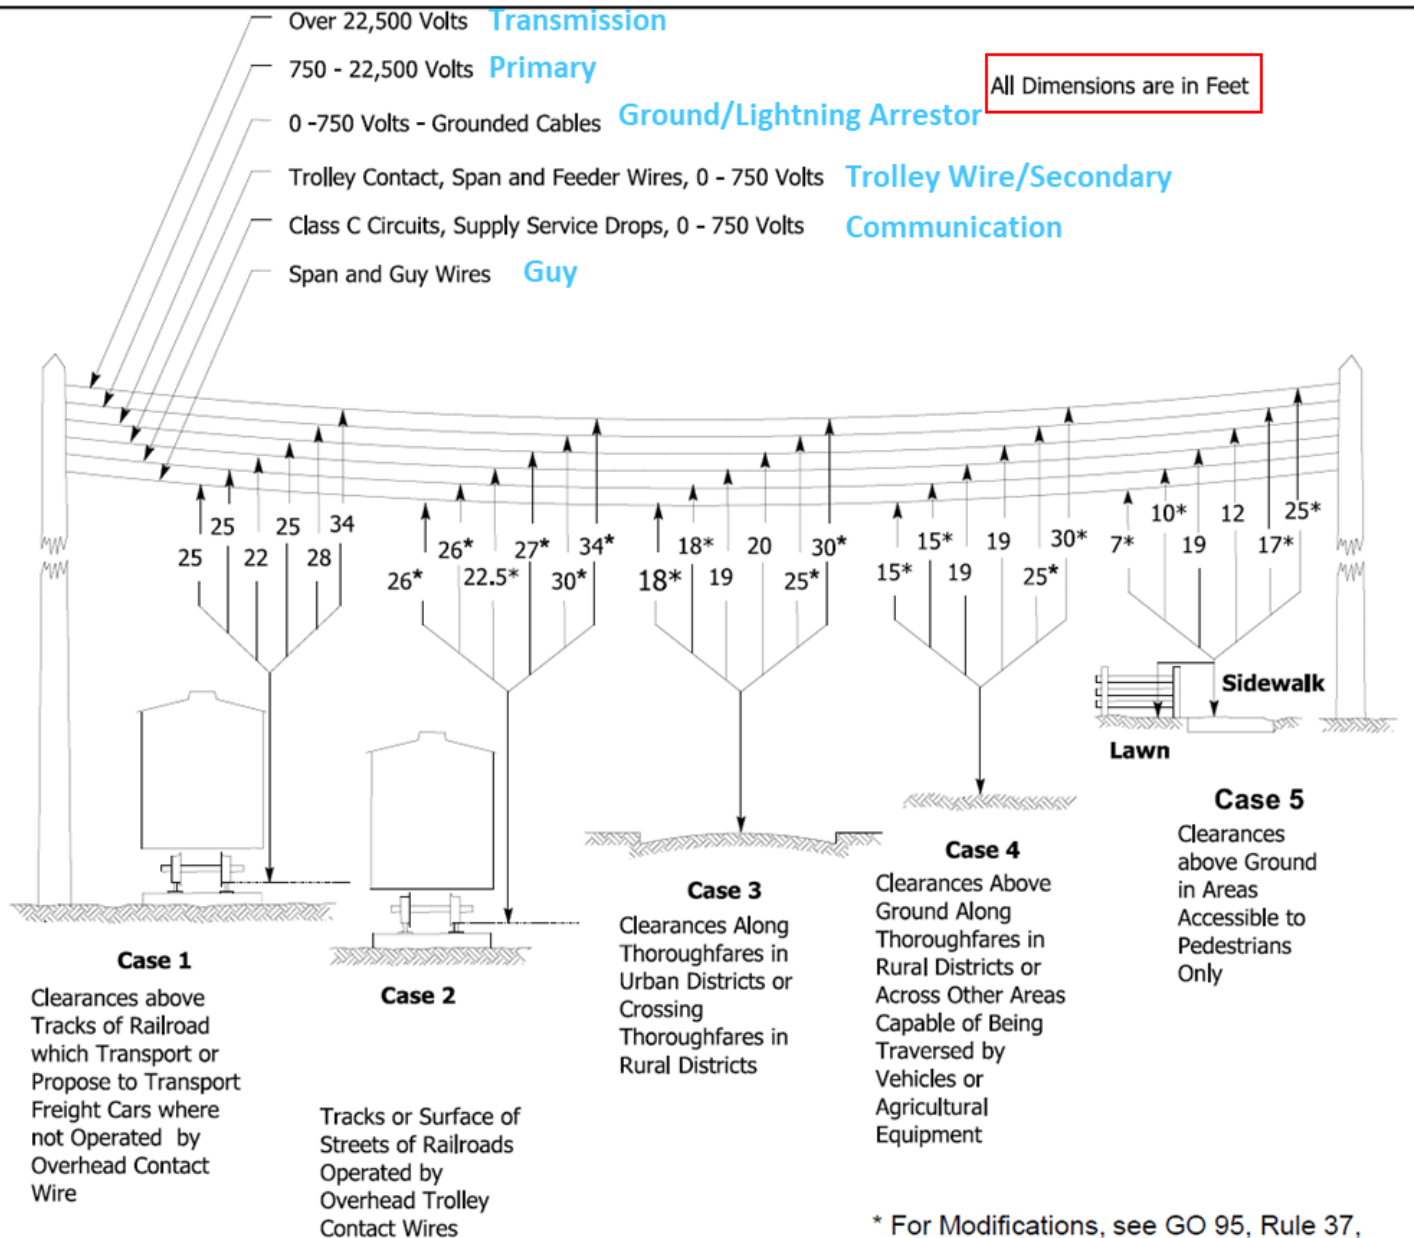


* For Modifications, see GO 95, Rule 37, Table 1, Cases 1 to 5



Job Aid: Overhead Assessment

Case 1: Non-Contact Railroad

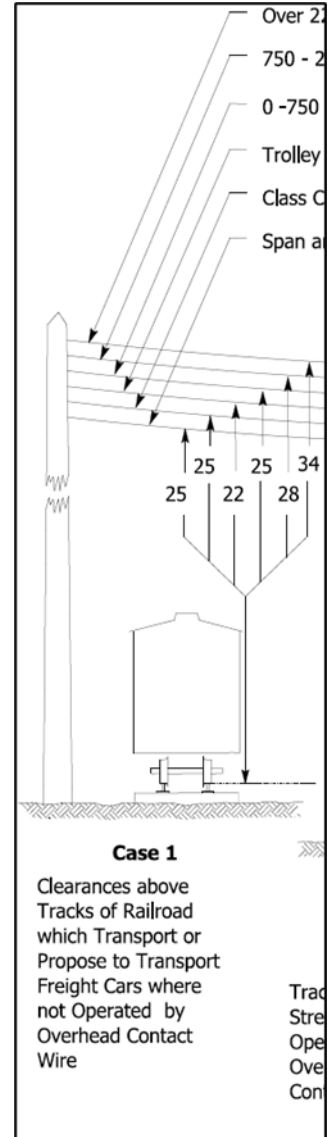



Job Aid: Overhead Assessment


WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

TD- 2305M-JA02

Rev: 14

Case 2: Contact Railroad

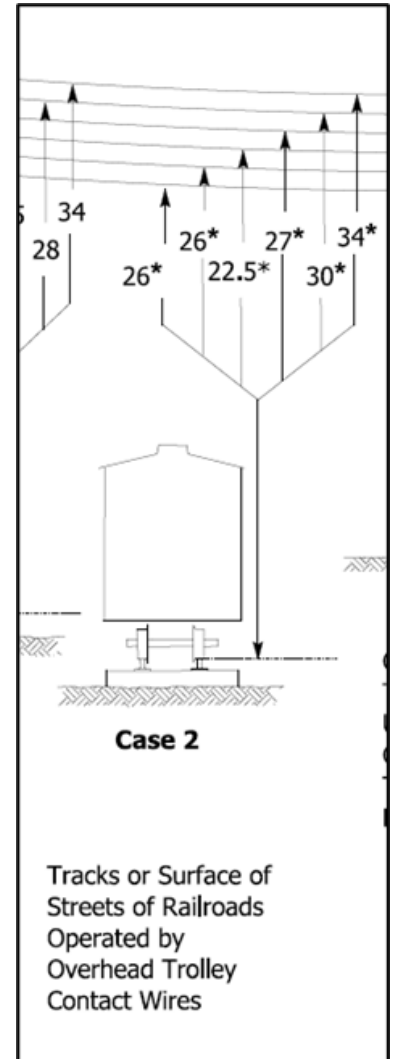




Job Aid: Overhead Assessment

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02
Publication: 01/06/2025 Effective: 01/14/2025

TD- 2305M-JA02

Rev: 14

Case 3: Along or Crossing an Urban Road

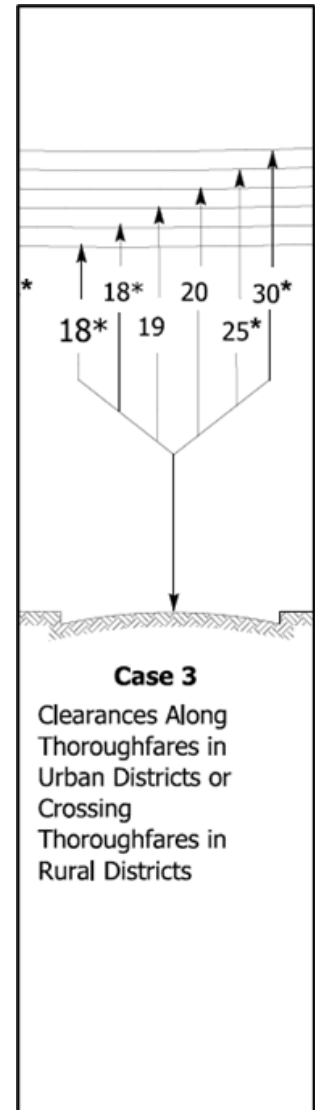



Job Aid: Overhead Assessment

TD- 2305M-JA02



WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

Case 4: Along or Crossing a Rural Road

NOTE: Due to the fisheye lens and the online street view, the poles appear to be leaning but are not.

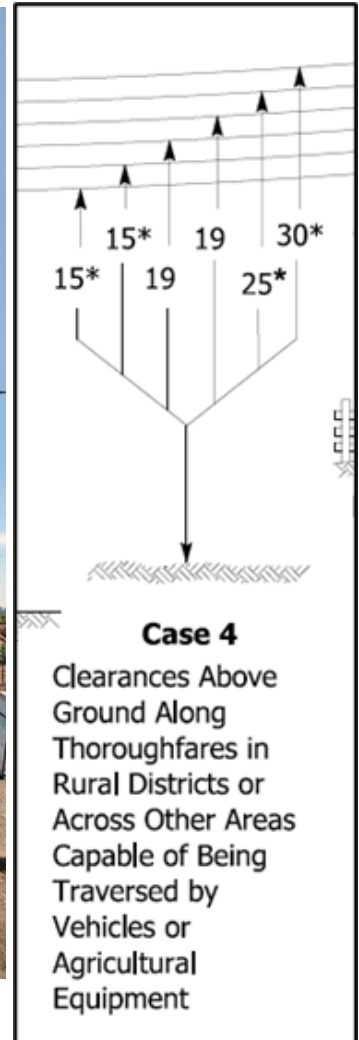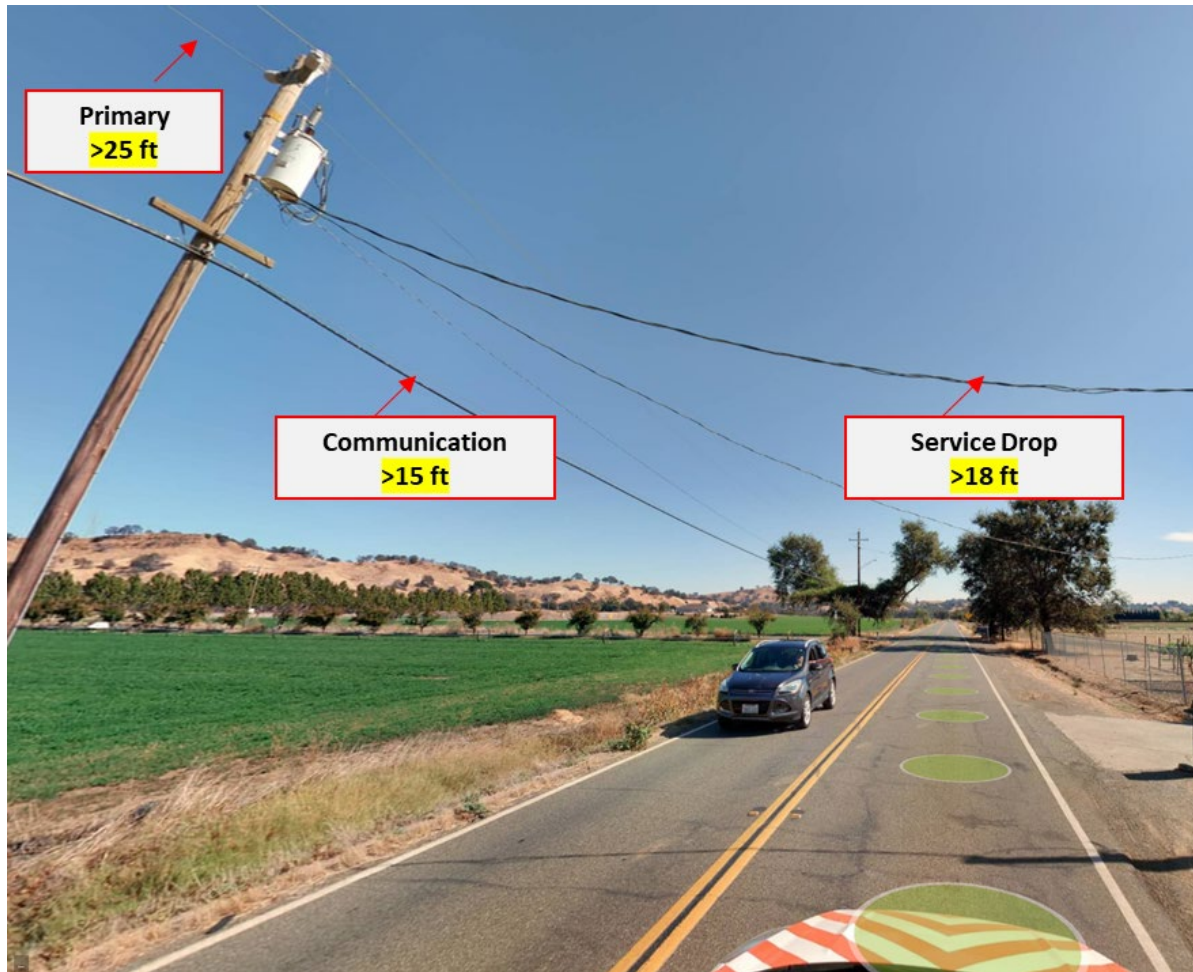



Job Aid: Overhead Assessment


WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

TD- 2305M-JA02


Rev: 14

Case 5: Pedestrian Access - Sidewalk

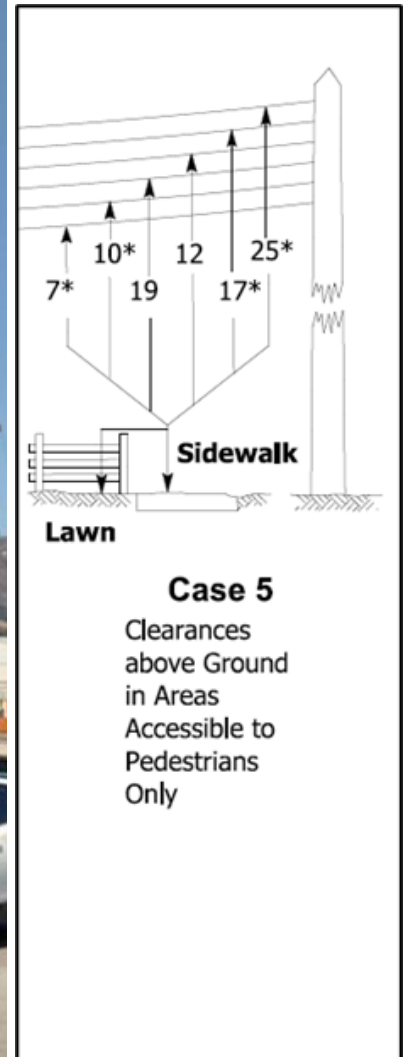



0-750V Service Drops - Residential

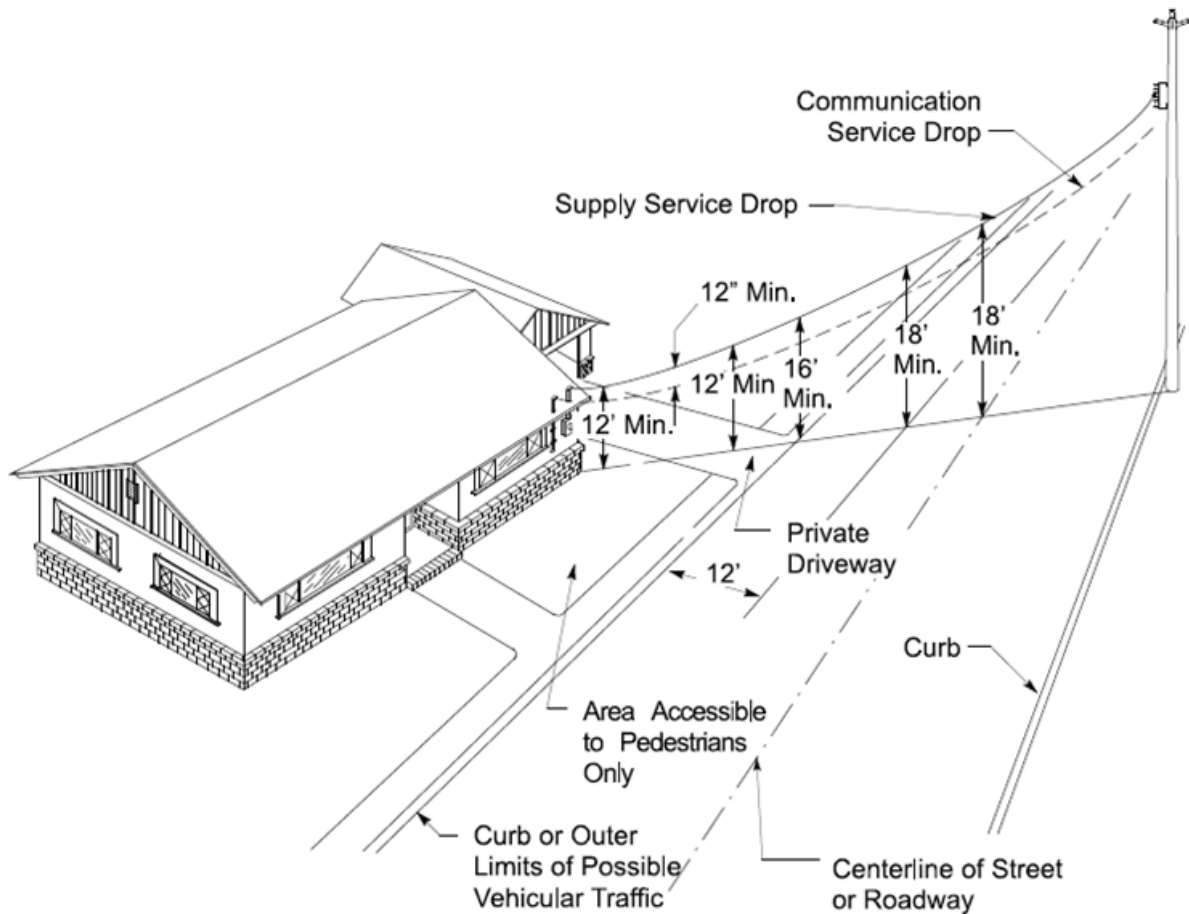



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

Service Drop – Residential


NOTE: Due to the fisheye lens and the online street view, the poles appear to be leaning but are not.





0-750V Service Drops – Industrial and Commercial

0-750V Service Drops - Industrial & Commercial

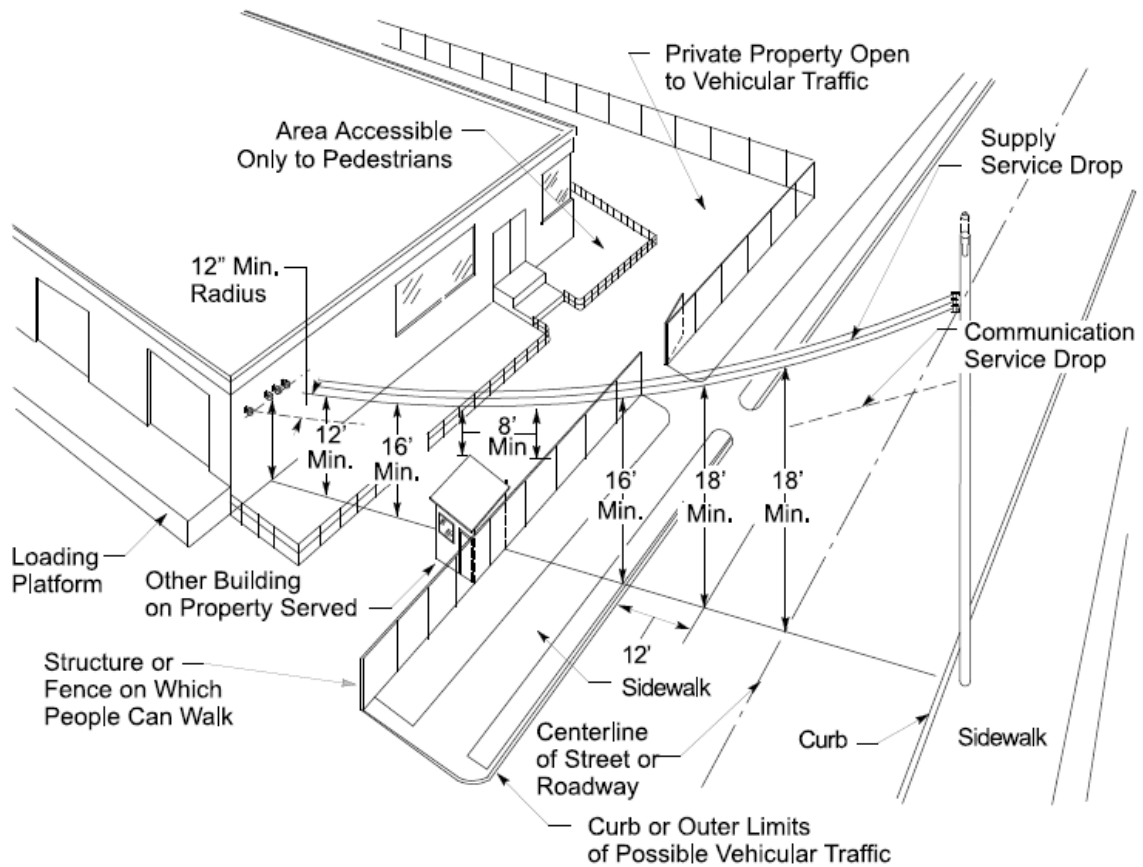



Job Aid: Overhead Assessment

Service Drop – Commercial

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14





Conductor to Conductor Clearance – On Same Pole

All Dimensions are in Feet

* For Modifications See
GO 95, Rule 38, Table 2, Cases 8 to 13

Note: Figure at extreme right of each
conductor level is the separation
between conductors of same
voltage classification

Transmission

Supply Lines
Over 68,000 Volts

Supply Lines
35,000 -
68,000 Volts

Supply Lines
20,000 -
35,000 Volts

Supply Lines
7,500 -
20,000 Volts

Supply Lines
750 - 7,500
Volts

Trolley Feeders,
Service Drops
and Supply
Lines,
0 - 750 Volts

Communication
Lines

Service/Secondary

Conductor to Conductor Clearances – On Same Pole



Job Aid: Overhead Assessment


TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

Same Pole Conductor Clearances

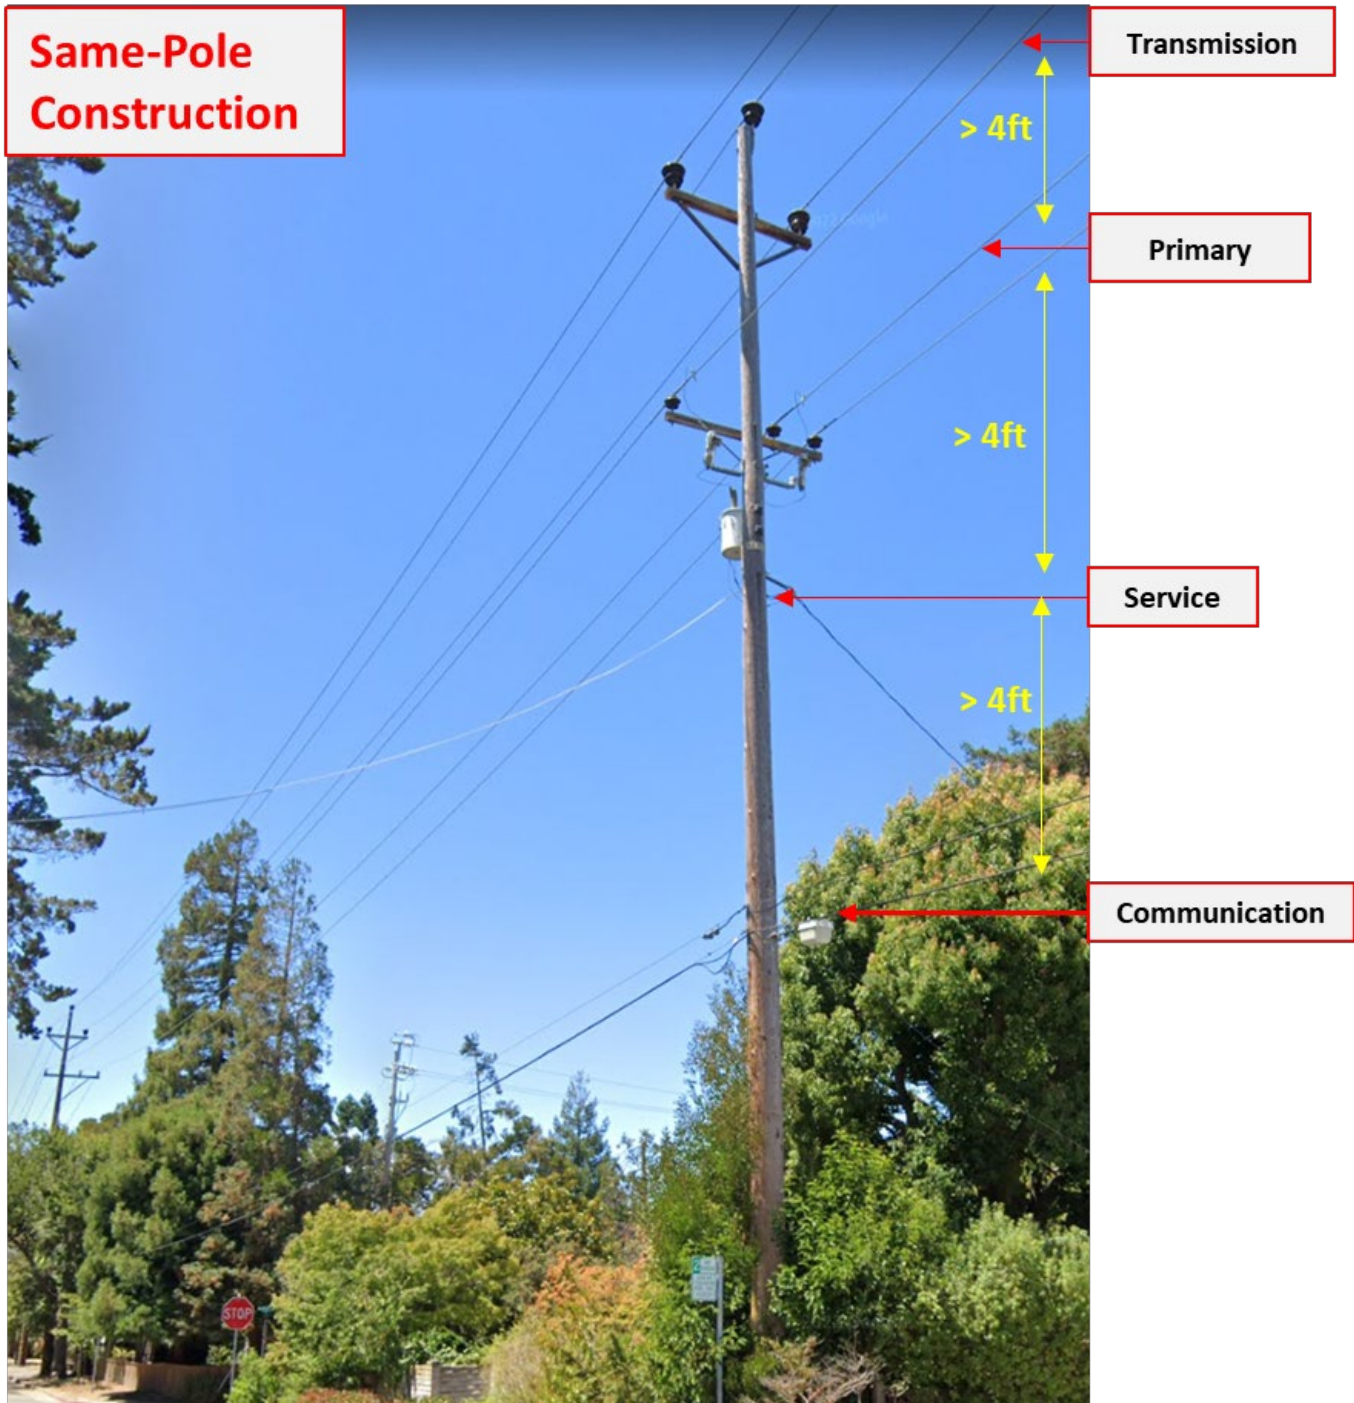




Job Aid: Overhead Assessment

Conductor to Conductor Clearance on Crossing Poles

Conductor to Conductor Clearances - Crossings

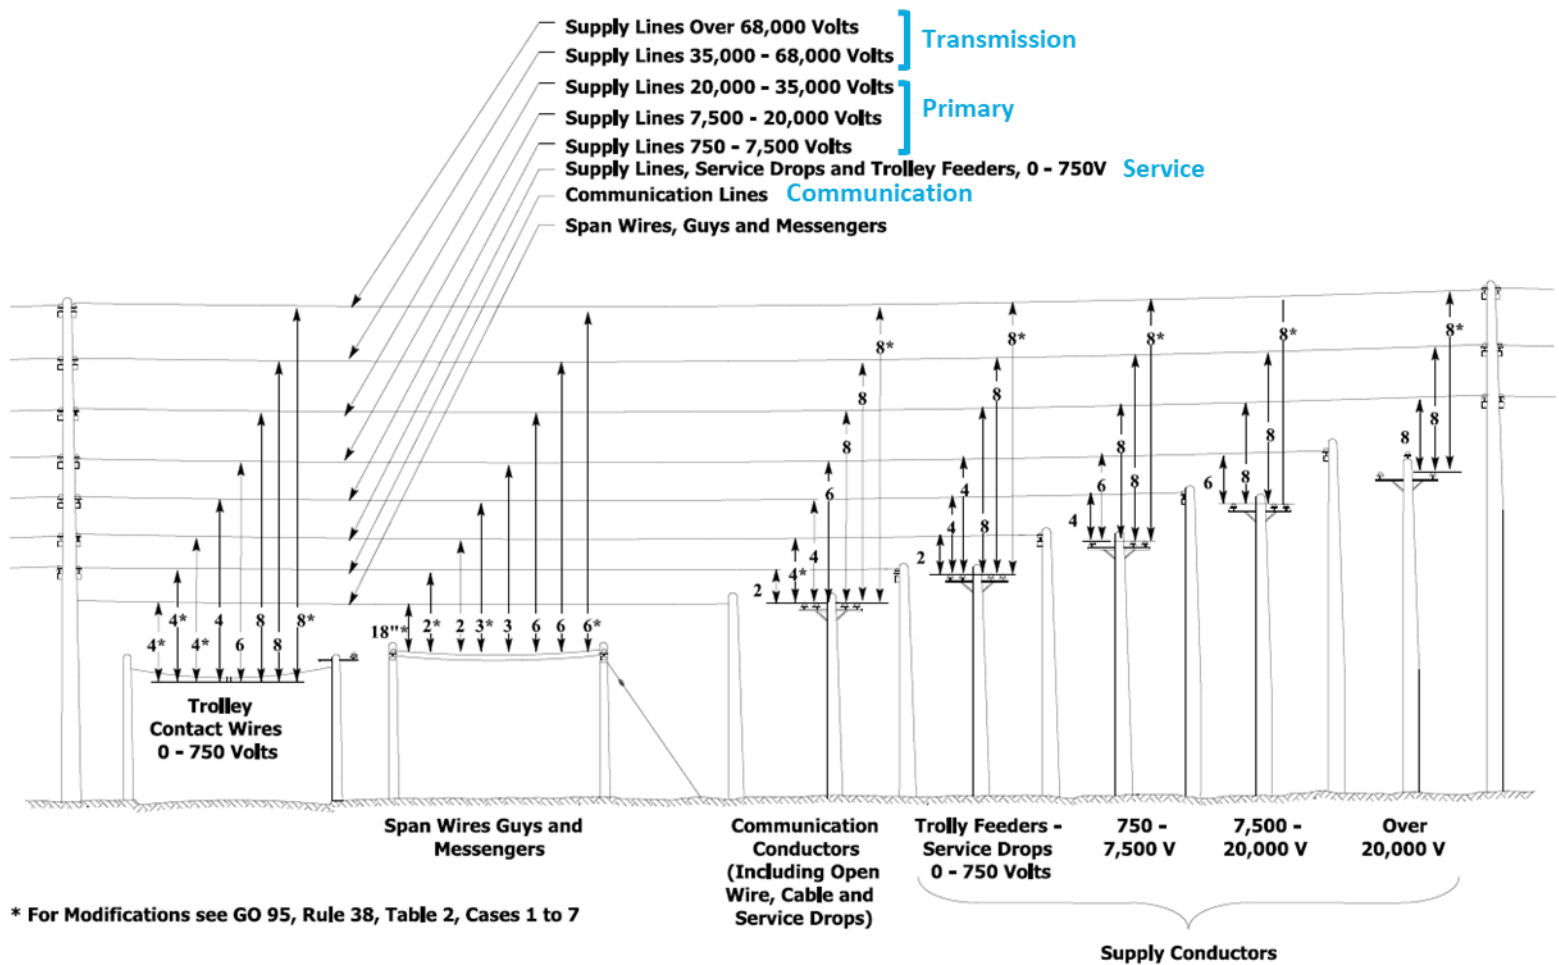

- 300kV plus transmission circuits require 156 inches of clearance to the primary.



Job Aid: Overhead Assessment


Crossing Poles Clearances

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

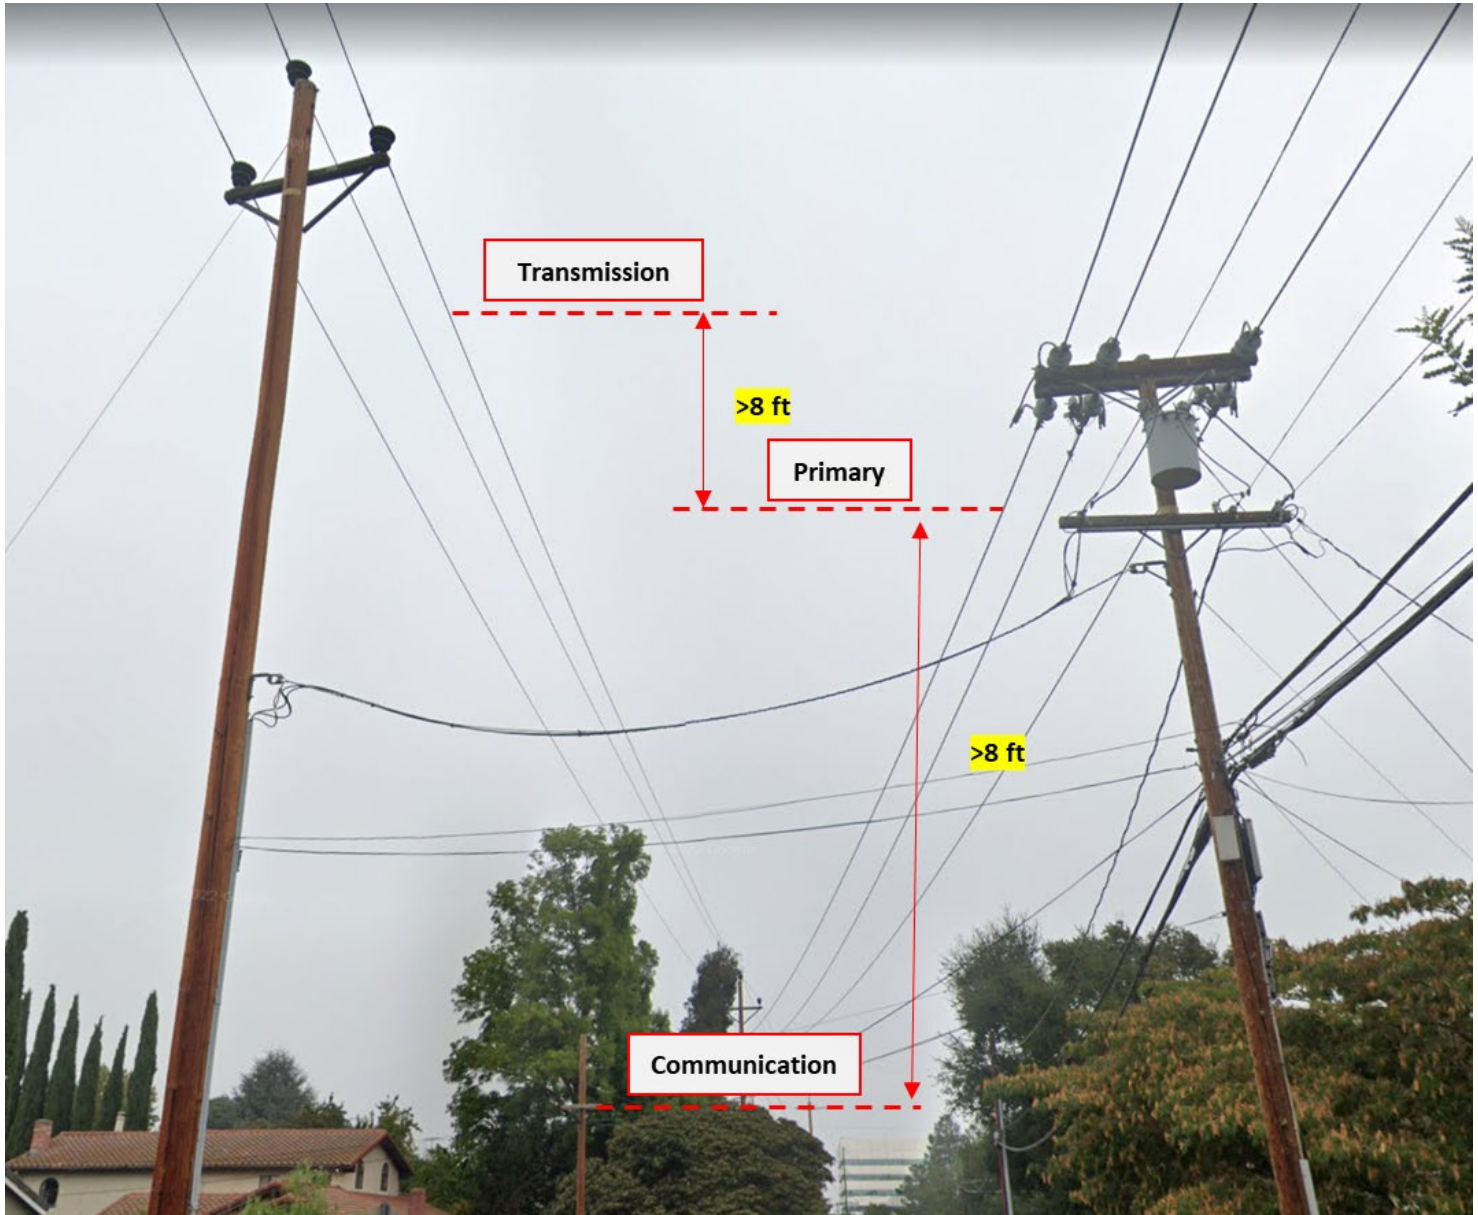



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02
Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14



Conductor to Building Clearances
Above Building Clearance



Job Aid: Overhead Assessment

Alongside Building Clearance

TD- 2305M-JA02
WMP-Discovery2023-2025 DR SPD 024-Q003Atch02
Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14





Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

Covered Conductor

Category 1 – Exposed energized portions on covered conductor

Exposed Primary Covered Conductor- Tree Wire

Guidance: Does covered conductor have any exposed conductor sections? Does the conductor have any exposed energized splices, connectors, flying bells, or any other components that are not covered?

Exclude tree wire that was built to standard at the time of installation.

Dead-end covers and jumper covers are not necessary at transition poles between bare wire and tree wire.

Minor work: No

EC Notification: Yes

Reference: [061149](#): "Raptor Safe Construction and Wildlife Protection, [015195](#) - Installation Details for Aluminum, ACSR, and Copper Covered Tree Wire

A. Is there a mis-aligned, or installed and now missing Dead-End Cover, exposing the bare conductor?

1. (No) No action
2. (Yes) Repair/Replace F Tag



Job Aid: Overhead Assessment




TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

Example

MIS-ALIGNED DEAD-END COVERS	
	At this Location: Dead-End Cover mis-aligned on tree wire construction.
	 
	Perform Minor Work: Yes, if safe to do so. Install anti-rotation Clamp
	Write 3rd Party Notification: No
	Write EC Notification: Yes FDA= Dead End Cover / Broken/Damaged / Replace OR FDA= Dead End Cover / Broken/Damaged / Repair Priority = F Tag, depending on exposure



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02




Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

B. Are there exposed energized splices, connectors, flying bells, or other components?

1. (No) No action
2. (Yes) Repair/Replace F Tag

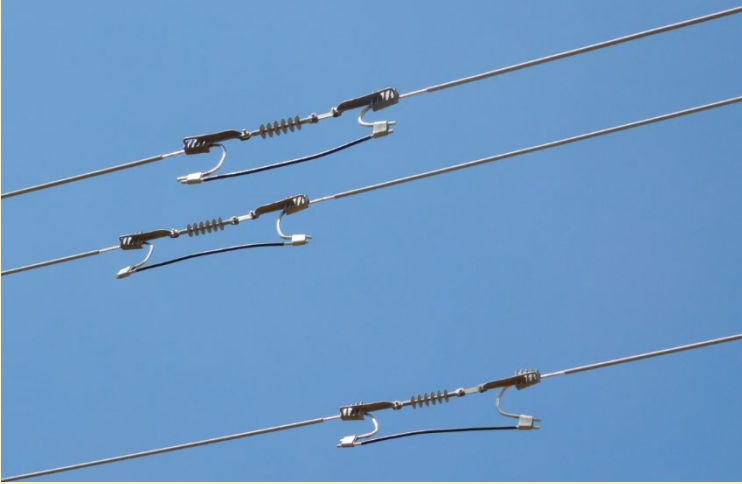Example

Exposed Primary Covered Conductor – Flying Bells, Wedge Connectors not removed after Work	
	At this Location: Flying Bells installed in on primary tree wire, now have exposed connectors and conductor.
	 
	Perform Minor Work: No
	Write 3rd Party Notification: No
Write EC Notification: Yes	
FDA: Tree Wire / Exposed / Repair	
Priority: F Tag, depending on exposure	



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02




Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

C. Is the jacket/insulation burnt and exposing the conductor?

- (No) No Action
- (Yes) Does burnt conductor have broken stand(s) or reduced cross sectional area?
 - a) (No) Repair/Replace E Tag
 - b) (Yes) Repair/Replace Level IA or IIX

Example

Exposed Primary Covered Conductor Tree Wire, Burnt Conductor	
	At this Location: Tree Wire conductor exposed and burnt.  
	Perform Minor Work: No
	Write 3rd Party Notification: No
	Write EC Notification: Yes FDA= Tree Wire / Exposed / Repair FDA= Conductor / Burnt / Repair Priority: E Tag, depending on exposure



Job Aid: Overhead Assessment

TD- 2305M-JA02


WMP-Discovery2023-2025 DR SPD 024-Q003Atch02
Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

Is the covered conductor jacket cut into and bare conductor exposed?

1. (No) No action
2. (Yes) Broken strands present?
 - a. (No) Repair/Replace F Tag
 - b. (Yes) See, Does the Conductor have Broken Strands?

Example

Exposed Primary Covered Conductor Tree Wire	
	At this Location: Tree Wire jacket cut into, and bare conductor exposed
	Perform Minor Work: No
	Write 3rd Party Notification: No
	Write EC Notification: Yes
	FDA: Tree Wire / Exposed / Repair Priority: F Tag, depending on exposure

C. Splice covering, is splice exposed?

- a. (No) No action
- b. (Yes) Repair/Replace F Tag



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025




Rev: 14

Crossarm / Insulators / Cutouts

Framing

1. Crossarm Broken/Deteriorated

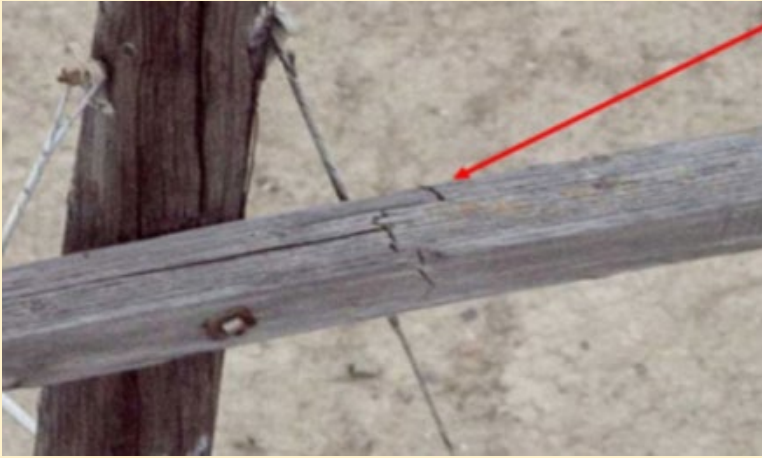General Guidance: Refer to [Crossarm Evaluation Job Aid](#) in this document.

Cracked Cross-Arm – Aerial View	
	At this Location: Top view of a cracked cross-arm on top and sides. May not be seen from the ground.  
	Perform Minor Work: No
	Write 3rd Party Notification: No
	Write EC Notification: Yes FDA = Cross-arm / Broken/Damaged / Replace Priority = X Tag, however extenuating circumstances may escalate to A Tag



Deteriorated Cross-Arm – Aerial View



At this Location: Top view of a Deteriorated/Rotten cross-arm. May not be seen from the ground. Quarter brace hardware coming loose.



Perform Minor Work: No

Write 3rd Party Notification: No

Write EC Notification: Yes

FDA = Cross-arm / Broken/Damaged / Replace

Priority = Minimum B tag, consider A Tag for conditions such as conductor size, double / single arm, exposure, etc.

Deteriorated Cross-Arm – Aerial View



At this Location: Deteriorated Cross-Arm – Aerial View



Perform Minor Work: No

Write 3rd Party Notification: No

Write EC Notification: Yes

FDA = Cross-arm / Broken/Damaged / Replace

Priority = Minimum B tag, consider A Tag for conditions such as conductor size, double / single arm, exposure, etc.



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

CROSSARM DOES NOT NEED REPLACEMENT



At this Location: Crossarm looks good. Prefabricated holes, not woodpecker. No replacement needed.



Perform Minor Work: No

Write 3rd Party Notification: No

Write EC Notification: No

Deteriorated Cross-Arm – Aerial View



At this Location: Deteriorated/Rotten Cross-Arm – Aerial View



Perform Minor Work: No

Write 3rd Party Notification: No

Write EC Notification: Yes

FDA = Cross-arm / Broken/Damaged / Replace

Priority = Minimum B tag, consider A Tag for conditions such as conductor size, double / single arm, exposure, etc.



Job Aid: Overhead Assessment


TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

BURNT CROSSARM – Aerial View

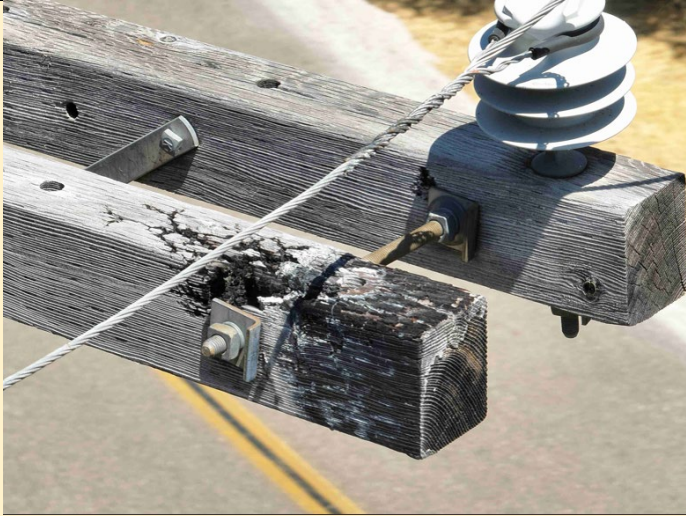

At this Location: Arching on crossarm.



Perform Minor Work: No

Write 3rd Party Notification: No

Write EC Notification: Yes

FDA = Crossarm / Burnt / Replace

Priority = E Tag, depending on exposure.

CROSSARM DOES NOT NEED REPLACEMENT



At this Location: Crossarm looks good.
Follow woodpecker process flow.



Perform Minor Work: No

Write 3rd Party Notification: No

Write EC Notification: No



Crossarm Evaluation Job Aid

General Information:

Environmental conditions throughout the service territory expose support structures to a variety of conditions that can cause or accelerate deterioration of wood components. This section provides guidelines for assessing wood crossarms.

General Guidance: During detailed inspections, examine wood crossarms and assess their condition: Is primary or secondary crossarm damaged, broken, burnt, decayed, rotten, loose, missing hardware or showing signs of bent bolts or brackets that cause the crossarm not to be horizontal, gun shots, insect damage or woodpecker damage, or splitting that compromises the integrity of the crossarm? If yes, create EC notification to replace crossarm; always consider replacing wood crossarms with composite.

Note: Bent crossarm brace alone is not a compelling issue.

Additional Guidance:

Identify conditions such as crossarm configuration, number of phases, location (e.g., urban, rural, forest, inaccessible, traffic, etc.), loading (e.g., double/triple arms, dead ends, alley arms, proximity to trees, angles/conductor size, heavy loading, damaged wood pins, etc.) and the likelihood of these conditions contributing to further deterioration or failure of the crossarm or attached components.

Often cross arms experience significant decay on the top of the arm without exhibiting clues that are visible from the ground¹. For this reason, arms that exhibit two or more of the following characteristics are more likely to decay on the top and should be considered for a more detailed aerial/climbing inspection:

- Arms that appear to be greater than 50 years old²(based on age of pole, presence of wood pins, brown/glass insulators, or other indicators).
- Arms mounted on poles where the pole top is showing signs of decay or crowning.
- Severely weathered arms or arms rounded or apparently decayed ends.
- Damaged wood pins or elongated pinholes.
- Active moss/vegetation growth.
- Presence of woodpecker holes (greater than one inch diameter) on the arm
- Arms in areas of higher rainfall/moisture and reduced sunlight such as those in many coast and mountain areas.
- Wood pins on arms located in agricultural areas or orchards contaminated by aerial spraying and dirt, which contributes to tracking and arm or pin deterioration.

¹ Examples of top and bottom views of crossarm conditions are shown in table 2.

² Many, but not all, arms prior to 1955 were untreated.



Job Aid: Overhead Assessment


TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

Examples

SECONDARY SQUATTER & DECAYED CROSSARM	
	At this Location: Secondary Squatter and decayed crossarm, replace wood crossarm with composite arm.
	Perform Minor Work: No
	Write 3rd Party Notification: No
	Write EC Notification: Yes FDA= Crossarm Decayed / Rotten / Replace FDA= Secondary Squatter / Broken/Damaged / Replace Priority= E Tag, at minimum, next inspection cycle; based on field condition and exposure, corrosion, etc.; prioritize as needed (A, B, E, or F)

2. Bonding Exists and Needs to be Repaired

General Guidance: Visual observation of broken / unattached bonding wire on a cross-arm. Create EC notification.

Minor Work: No

EC Notification: Yes

Related Documents: [06667](#)



Job Aid: Overhead Assessment




TD- 2305M-JA02




WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

Example

BONDING	
	At this Location: Broken or unattached bonding  
	Perform Minor Work: No
	Write 3rd Party Notification: No
	Write EC Notification: Yes
	FDA = Bonding / Broken/Damaged / Replace Priority = E Tag, up to 36 months depending on exposure

CONCENTRIC HAS COME LOOSE	
	At this Location: Concentric has come loose and no longer connected to insulator. This Termination is not grounded, and leakage current is being carried on the semi con jacket of the cable. The distance between the concentric and porcelain termination should be minimal.
	 
	Perform Minor Work: No
	Write 3rd Party Notification: No
	Write EC Notification: Yes FDA: Ground / Missing/ Install FDA: Riser / Pothead Broken/Damaged / Replace Priority: Minimum F Tag, depending on exposure



3. Underarm Bus Not Securely Attached

General Guidance:

It is a requirement to have at least two attachment points, secured to an underarm bus, one on each side.

It is a requirement to use the following corrosion resistant materials for attaching the underarm bus to the crossarm: straps, plumber's tape, lags, galvanized nails, staples, screws, bolts, zip ties, etc.

If an inspector finds an underarm bus secured with non-authorized material, such as duct tape, electrical tape, or rope, it must be secured by at least two additional approved attachment points.

When an inspector re-secures a bus, it must be brought up to construction standards; four attachment points using corrosion resistant materials.

Complete as minor work/re-secure the bus. IF it cannot be completed as minor work, then create EC notification if compelling and needs to be addressed within 5 years.

Minor Work: Yes

EC Notification: Yes, only if not able to perform minor work.

Select the Priority and Due Date based upon compelling abnormal condition that may adversely impact public safety and/or service reliability.

Related Documents: [021924](#), [Crossarm Evaluation](#)



Job Aid: Overhead Assessment




TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

Examples

UNDER-ARM BUS LOOSE & DETERIORATED	
	
At this Location: UAB deteriorated, partial repair with rope, secured with one strap.	
 	
Perform Minor Work: No	
Write 3rd Party Notification: No	
Write EC Notification: Yes	
FDA= Under-Arm Bus / Broken/Damaged / Repair	
Priority = At minimum – must write up as F Tag, next inspection cycle; based on field condition and exposure, corrosion, etc.; prioritize as needed (A, B, E, or F)	






Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

UNDER-ARM BUS LOOSE	
	At this Location: UAB Loose, unattached and hanging.  
	Perform Minor Work: No
	Write 3rd Party Notification: No
	Write EC Notification: Yes FDA= Under-Arm Bus / Broken/Damaged / Repair Priority= E Tag, depending on exposure



Insulators

1. Damaged Insulators

General Guidance Are Insulators chipped, cracked, corroded, severely contaminated to the point of tracking, flashed, or have signs of tracking/arcing, broken, or damaged? If yes, create EC notification. Any contamination without tracking does not automatically require an EC notification. However, in cases where the contamination is severe, an EC notification should be created regardless of the presence of tracking.

Replace ALL insulators if one is chipped, cracked, contaminated, broken, or damaged.
Do Not mismatch insulators.

Note for construction: If an insulator is damaged due to gunshot, replace with epoxy or polymer insulators.

Note for construction: Cannot mix insulator types, always replace full set of insulators.

Note: Inspector should always consider replacing wood crossarm with composite crossarm, based on condition of crossarm. If crossarm is already a composite do not write a crossarm change out.

Minor Work: No

EC Notification: Yes

Select the Priority and Due Date based upon compelling abnormal condition that may adversely impact public safety and/or service reliability.

Related Documents: [022088](#), [068180](#) (composite crossarm), [Crossarm Evaluation Job Aid](#) in this document.



Job Aid: Overhead Assessment




TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003A1ch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

Examples

DAMAGED INSULATOR	
	
At this Location: Damaged insulator, Replace all insulators and the arm.	
 	
Perform Minor Work: No	
Write 3rd Party Notification: No	
Write EC Notification: Yes FDA= Crossarm / Decayed/Rotten / Replace FDA= Insulator / Broken / Damage / Replace Priority= E Tag, depending on exposure	



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

FLASHED INSULATOR POTHEAD

**At this Location:** Flashed pothead**Perform Minor Work:** No**Write 3rd Party Notification:** No**Write EC Notification:** Yes, or COE (see a set of combo cutouts at location follow COE process)**FDA=** Riser / Pothead / Flashed / Replace**Priority=** F Tag At minimum, next inspection cycle; based on field condition and exposure, corrosion, etc.; prioritize as needed (A, B, E, or F)

CONTAMINATED INSULATOR

**At this Location:** Significant contamination, no signs of tracking**Perform Minor Work:** No**Write 3rd Party Notification:** No**Write EC Notification:** Yes**FDA=** Insulator / Broken/Damaged / Replace**Priority=** E Tag, depending on exposure



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003A1ch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

BROKEN SECONDARY INSULATOR



At this Location: Broken secondary insulator. Strain is controlled by the second insulator on the Double arm construction.



Perform Minor Work: No




Write 3rd Party Notification: No

Write EC Notification: Yes

FDA= Crossarm / Decayed / Rotten /
Replace

FDA= Insulator / Broken/ Damage / Replace

Priority= E Tag, depending on exposure

CONTAMINATED INSULATOR	
	At this Location: Significant contamination, no signs of tracking  
	Perform Minor Work: No
	Write 3rd Party Notification: No
	Write EC Notification: Yes FDA= Insulator / Broken/Damaged / Replace Priority= E Tag, depending on exposure

2. Squatters – Primary or Secondary

General Guidance: Are primary or secondary insulators squatting? If yes, create EC Notification.

Minor Work: No

EC Notification: Yes

Select the Priority and Due Date based upon compelling abnormal condition that may adversely impact public safety and/or service reliability.

Notes:

- Inspector should always consider replacing wood crossarm with composite crossarm when needed.

Related Documents: [022088](#), [Crossarm Evaluation](#)



Job Aid: Overhead Assessment




TD- 2305M-JA02




WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

Example

PRIMARY SQUATTER	
	At this Location: 2 Primary wood pin squatters, replace wood crossarm with composite arm.  
	Perform Minor Work: No
	Write 3rd Party Notification: No
	Write EC Notification: Yes FDA= Insulator / Primary Squatter / Replace FDA= Crossarm Decayed / Rotten / Replace Priority= E Tag, at minimum, next inspection cycle; based on field condition and exposure, corrosion, etc.; prioritize as needed (A, B, E, or F)

Secondary Squatter, Crossarm in good shape	
	At this Location: Secondary Squatter, crossarm in good shape  
	Perform Minor Work: No
	Write 3rd Party Notification: No
	Write EC Notification: Yes FDA= Secondary Squatter / Broken/Damaged / Replace Priority= E Tag, depending on exposure



3. Flying Bells

General Guidance: Are flying bells broken or damage? If yes, create EC notification.

Note: If flying bells were installed to de-energize idle facilities, assess vegetation around idle conductor; create EC notification to trim, as vegetation management does not perform trimming on idle facilities.

Minor Work: No

EC Notification: Yes

Select the Priority and Due Date based upon compelling abnormal condition that may adversely impact public safety and/or service reliability.

Refer to the [Glossary](#) for Flying Bell picture.

4. Cotter Key

General Guidance: Ensure the pin is fully seated and cotter key is present.

Use binoculars. Look for missing cotter keys and pins fully seated:

No EC tag is required to adjust a partially backed out cotter key in the retaining pin channel.



If cotter key is not present or pin is not fully seated from top down within 45 degrees of vertical, create EC notification.




Minor Work: Yes, if safe to do so.

EC Notification: Yes

Select the Priority and Due Date based upon compelling abnormal condition that may adversely impact public safety and/or service reliability.

Example

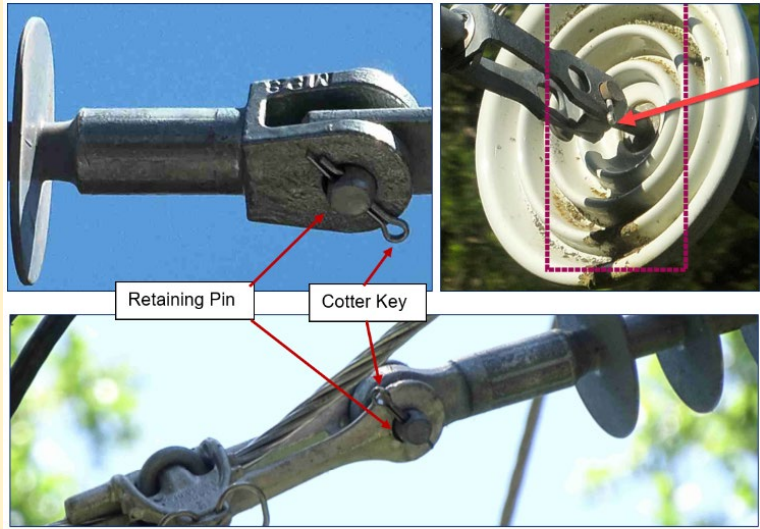MISSING COTTER KEY / RETAINER PIN FULLY SEATED	
	<p>At this Location: Missing Cotter Key / Retainer Pin Fully Seated, may fall out.</p> <p>   </p>
	<p>Perform Minor Work: No</p>
	<p>Write 3rd Party Notification: No</p>
	<p>Write EC Notification: Yes FDA= Hardware / Missing / Install Priority= B Tag, depending on exposure</p>

PIN FULLY SEATED / COTTER KEY PARTIALLY BACKED OUT	
 <p>Retaining Pin Cotter Key</p> <p>Figure 1. Cotter Key partially backed out of Retainer Pin channel</p>	<p>At this Location: Cotter Key partially backed out. Pin is fully seated.</p> <p>   </p>
	<p>Perform Minor Work: Yes, if safe to do so – Using proper work procedures.</p>
	<p>Write 3rd Party Notification: No</p>
	<p>Write EC Notification: No</p>



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003A1ch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

RETAINER PIN COMING LOOSE, ALMOST PULLED OUT



At this Location: Retainer Pin coming loose, almost pulled out. Has slipped off one ear.



Perform Minor Work: No

Write 3rd Party Notification: No

Write EC Notification: Yes

FDA = Hardware / Loose / Adjust

Priority = A Tag, Follow emergency procedure



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

COTTER KEY – RESTING ON BOTH EARS



At this Location: Resting on both ears.



Perform Minor Work: No


Write 3rd Party Notification: No

Write EC Notification: Yes

FDA = Hardware/Framing / Loose / Adjust

Priority = X Tag, depending on exposure

COTTER KEY MISSING – PIN FULLY SEATED

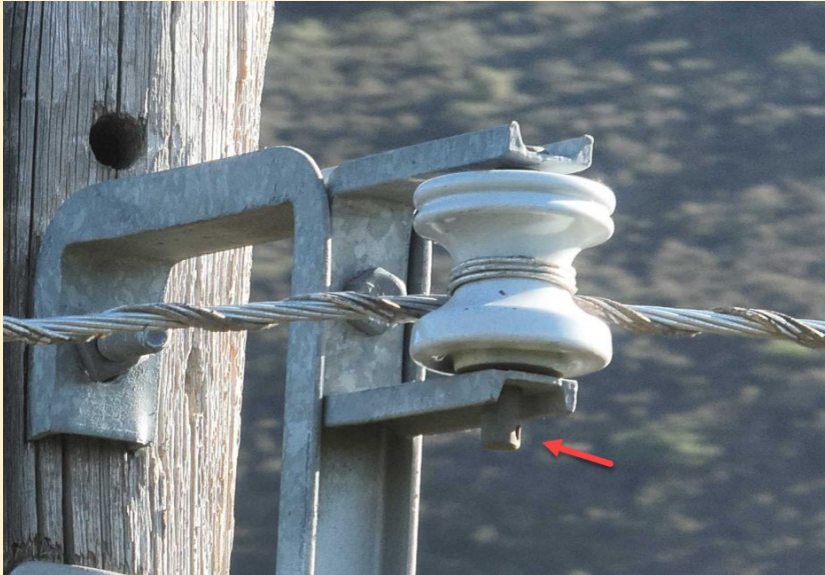

At this Location: Cotter key missing, pin has downward force on head of pin (~45 degrees) and is fully seated.



Perform Minor Work: No

Write 3rd Party Notification: No

Write EC Notification: Yes

FDA= Hardware / Loose / Adjust

Priority= E Tag, depending on exposure

COTTER KEY BACKED OUT



At this Location: Cotter Key partially backed out. Pin is fully seated.



Perform Minor Work: Yes, if safe to do so – Using proper work procedures.

Write 3rd Party Notification: No

Write EC Notification: No



Cutouts / Fuses / Switches

1. Damaged Arcing Horns

General Guidance: Call Restoration Dispatch to get a T-Man dispatched to the location to create a COE (CE) notification. Consider installing a warning tag on the pole.

Minor Work: No

EC Notification: No

Related Documents: [015225](#), [066195](#)

2. Cutouts

General Guidance: Are cutouts broken, damaged, cracked, loose, **severely contaminated to the point of tracking** or flashed?

Guidance: Yes/No, if yes, THEN create an EC Notification.

Minor Work: No

EC Notification: Yes

Select the Priority and Due Date based upon compelling abnormal condition that may adversely impact public safety and/or service reliability.

Related Documents: [015225](#)



Job Aid: Overhead Assessment



TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

Examples

BROKEN DAMAGED CROSSARM MOUNTED CUTOUT	BROKEN CUTOUT
	
At this Location: Broken/Flashed cutout, ensuring bond wire is attached to the bracket.	At this Location: Broken Cutout
Perform Minor Work: No	Perform Minor Work: No
Write 3rd Party Notification: No	Write 3rd Party Notification: No
Write EC Notification: Yes FDA = Cutout / Broken/Damaged / Replace Priority = E Tag, depending on exposure, no COE	Write EC Notification: Yes FDA = Cutout / Broken/Damaged / Replace Priority = A Tag, Follow the emergency process

3. Fuses

General Guidance: Are the Fuses corroded on the mountings or end fittings, red cap missing (E Fuse only), paint finish is flaking or cracked, fiberglass layer exposed, E Fuse found hanging upside down (E Fuse only), missing components, cracks, deterioration, burnt, charring, or blown? Do liquid fuses have the appropriate fluid level?


Minor Work: No

EC Notification: Yes

a. Liquid Filled Fuses (Per TD-2305M-JA02-B003):

General Guidance:

- Low, Missing, or Undetermined Liquid in **HFTD** area
 1. CREATE an EC tag with **Priority E (1 year)** to replace the liquid fuse element with an approved ELF-LR.
 2. IF the liquid level is **50% or less**,
THEN DOCUMENT the condition in the **Long Text** field of the EC tag.
 - a. **Long Text:** "Liquid level is 50% or less."
- Low, Missing, or Undetermined Liquid in **non-HFTD** areas.
 1. CREATE an EC tag with **Priority E (1 year)** to replace the liquid fuse element with an approved ELF-LR

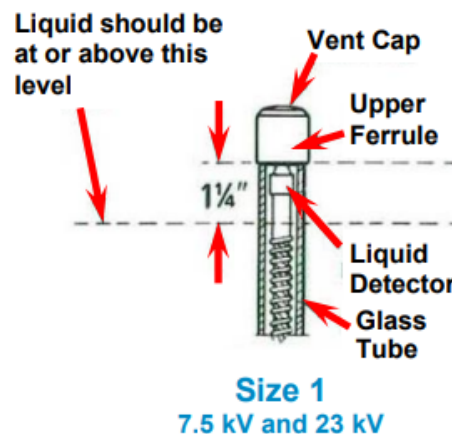



- SELECT the Priority due date based upon compelling abnormal conditions that may adversely impact public safety and/or service reliability.

b. Open Fuse Latches

General Guidance: Open fuse latches are a non-compelling abnormal condition.

Minor Work: No

EC Notification: No

Related Doc: [015225](#), [TD-2908P-01-JA260](#), [TD-2908P-01-JA261](#), [TD-2908P-01-JA243](#), [TD-2305M-JA02-B003](#)



Job Aid: Overhead Assessment







TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atrch02

Publication: 01/06/2025 Effective: 01/14/2025


Rev: 14

Examples

PART 63 POWER FUSE	PART 44/75 FAULT TAMER
	
<p>At this Location: Fiberglass layer exposed.</p> <p> </p>	<p>At this Location: Excessive cutout corrosion leading to corrosion on the metal components of the FT Fuse, deteriorated housing on the FT Fuse will not contain an arc withing the snuffing tube. Any reasonable suspicion of damage that will not be able to operate correctly.</p> <p> </p>
Perform Minor Work: No	Perform Minor Work: No
Write 3rd Party Notification: No	Write 3rd Party Notification: No
<p>Write EC Notification: Yes</p> <p>FDA = Cutout / Broken/Damaged / Replace</p> <p>And</p> <p>FDA= Fuse / Broken/Damaged / Replace</p> <p>Priority = E Tag, depending on exposure</p>	<p>Write EC Notification: Yes</p> <p>FDA = Cutout / Broken/Damaged / Replace</p> <p>And</p> <p>FDA= Fuse / Broken/Damaged / Replace</p> <p>Priority = E Tag, depending on exposure</p>

General Guidance: Inspect fuses, mountings, and end findings:

- If there are severe corrosion or wear on the metal components of the mounting or the end-fittings of the fuse unit, the mounting of the end-fittings must be replacing. The fuse unit should be removed from the mounting and inspected. If there is severe corrosion on the fuse unit, it must be removed from service and replaced with a new fuse unit.
- If the red rain cap is missing at the end of the fuse unit installed in outdoor applications, the fuse unit must be removed from service and be replaced with a new fuse unit.
- If a fuse unit's paint finish is flaking or has become cracked or if the underlaying fiberglass layer is exposed, the fuse unit must be removed from service and replaced with a new fuse unit.
- If fuse is hanging upside down (E fuse only), missing components, cracks, deterioration, burnt, charring or blown?
- Do liquid fuses have the appropriate fluid level?

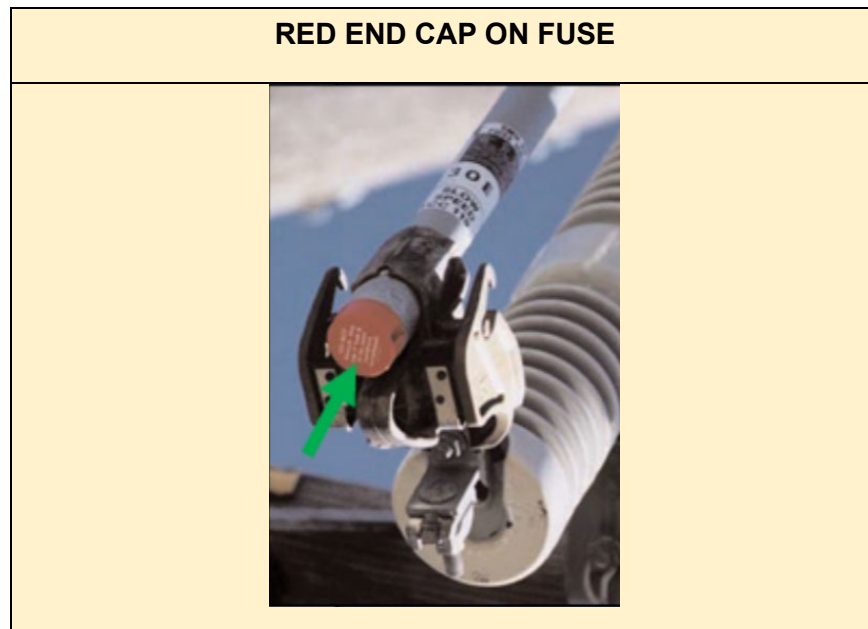






Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

FUSE	
	At this Location: Liquid fuse is low.
	 
	Perform Minor Work:
	Write 3rd Party Notification:
	Write EC Notification: Yes FDA = Cutout / Broken/Damaged / Replace And FDA= Fuse / Broken/Damaged / Replace Priority = E Tag, depending on exposure






Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

Arcing horn with burnt tip	
	At this Location: Arcing horn with burnt tip, also has broken insulator.
	 
	Perform Minor Work: No
	Write 3rd Party Notification: No
	Write EC Notification: No FOLLOW COE PROCESS

California Power Line Fire Prevention Field Guide

[California Power Line Fire Prevention Field Guide](#)



Miscellaneous Other Compelling Abnormal Conditions Guys / Anchors

Down Guy Preform Buried

General Guidance:

Top of anchor head must be above grade. Expose top of anchor head as minor work. Evaluate the unburied anchor guy pre-forms and visually inspect them.

Perform minor work to add extension or grade around anchor so the anchor head becomes visible.

If the pre-form cannot be unburied as minor work, create an EC notification.

Notes:

- A. If you cannot dig up the top of the anchor head, create an EC with a photo of a buried anchor **only**; you should make every effort to dig up the top of the anchor head to perform a complete assessment. If your photo is of a buried anchor head only, the general rule of thumb is that the EC will be created to **replace** the anchor.
- B. If you are performing an Overhead Inspection, and you cannot dig up a deeply buried anchor head, for example, cannot see the preform, the assumption is the anchor is too deep to expose. Create an EC to replace the anchor.
- C. The type of construction will determine the priority of the tag, for example:
 - Prioritize higher.
 - Large wire on a dead end or angle construction
 - Prioritize Lower
 - Small wire on dead end or angle construction

Minor Work: Yes





- Perform minor work if possible and if safe to do so.
- IF not able to perform minor work, THEN create EC notification.

EC Notification: Yes

Select the Priority and Due Date based upon compelling abnormal condition that may adversely impact public safety and/or service reliability.

Related Documents: [022221](#)

Examples

BURIED ANCHOR	
 <p>Before: Vegetation covers anchor</p>	 <p>After: Vegetation cleared from anchor</p>
<p>At this Location: Anchor head below grade overgrown with vegetation. After minor work inspector decides if the anchor can be adjusted or needs replaced.</p> <div>   </div>	
<p>Perform Minor Work: Yes, remove the vegetation. Yes, expose the top of the anchor head and evaluate condition/corrosion. Yes, preferred method is to adjust anchor by adding extension</p>	
<p>Write 3rd Party Notification: No</p>	
<p>Write EC Notification: Yes, if cannot be addressed as minor work. FDA= Anchor / Soil/Eroded/Graded / Replace (if the anchor cannot be adjusted)</p>	
<p>Priority= F Tag, depending on exposure.</p>	



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003A1ch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

ANCHOR EXTENSION



Anchor extension



Close-Up

At this Location: Inspector performed minor work, exposed anchor, evaluated anchor to be in good condition so that extension could be installed, then installed extension. (Back fill not shown)



Perform Minor Work: Yes

Write 3rd Party Notification: No

Write EC Notification: No



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

ANCHOR COVERED BY CONCRETE



At this Location: Anchor covered by concrete.



Perform Minor Work: No

Write 3rd Party Notification: No

Write EC Notification: Yes

FDA= Anchor / Soil / Eroded /Graded / Replace

Priority= F Tag, depending on exposure.

ANCHOR



At this Location: Anchor not buried.



Perform Minor Work: No

Write 3rd Party Notification: No

Write EC Notification: No



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003A1ch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

ANCHOR BURIED BY VEGETATION	
Anchor buried by tree	
	
At this Location: Anchor buried by ivy roots / tree.	
 	
Perform Minor Work: No	
Write 3rd Party Notification: No	
Write EC Notification: Yes	
FDA= Anchor / Soil / Eroded / Graded / Replace	
Priority= F Tag, depending on exposure.	



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

Visible Portion of Anchor Rod has Significant Corrosion

General Guidance: IF the visible portion of the anchor rod is significantly corroded, where there's loss of material or pitting, THEN create EC notification.





Minor Work: No

EC Notification: Yes

Select the Priority and Due Date based upon compelling abnormal condition that may adversely impact public safety and/or service reliability.

Related Documents: [025998](#)

Examples

ANCHOR ROD WITH SIGNIFICANT CORROSION	
Anchor above ground	Below
	
At this Location: Corroded Anchor, with material loss. See “pencil” in photo.  	
Perform Minor Work: No	
Write 3rd Party Notification: No	
Write EC Notification: Yes FDA= Anchor / Corroded / Replace Priority= E Tag, depending upon exposure	



Guy Broken / Slack / Corroded

General Guidance: Important: Before any work is performed on a down guy, inspect the guy insulator; if broken, check for presence of voltage (with dead tester). Pole must be straight with Guy no more than an arm's length (3ft) from taut, that does not have significant impact on the structural integrity of the pole. Tighten the guy as minor work if possible. If not possible, create an EC Notification.


If tightening the guy would exacerbate any pre-existing conditions on a facility (e.g., increase the lean of an already leaning pole, deform an already deforming pole), create an EC Notification with comments describing the situation.

Minor Work: Yes

EC Notification: Yes

Select the Priority and Due Date based upon compelling abnormal condition that may adversely impact public safety and/or service reliability.

Related Documents: [022178](#), [ATS Report: 006.4.2-23.9](#)

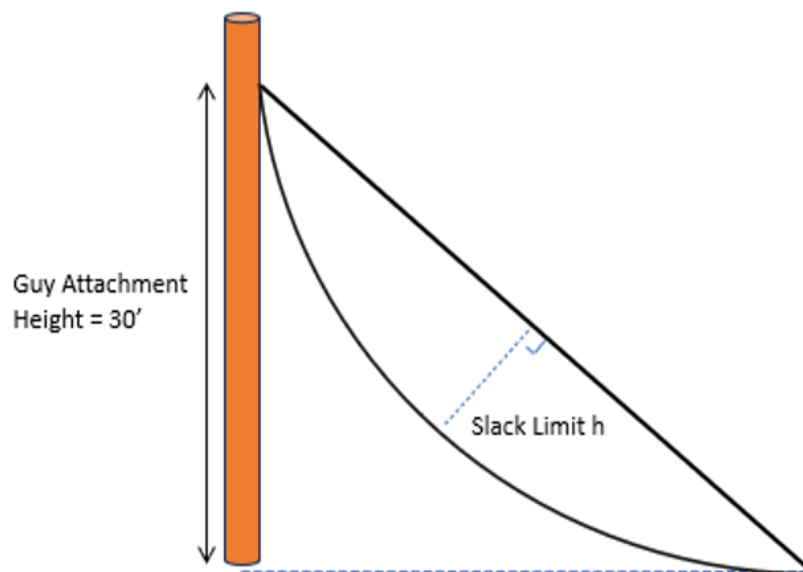



Job Aid: Overhead Assessment



TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

Examples


GUY SLACK	
	At this Location: Guy is slack more than arm length. Pole is affected by slack guy.
	 
	Perform Minor Work: Yes, if safe to do so and equipped with appropriate tools.
	Write 3rd Party Notification: No
	Write EC Notification: Yes, if not completed by minor work FDA= Guy / Loose / Adjust Priority= F Tag, depending on exposure.

Guy Clearance Issue

General Guidance: Guys in the cylinder of “proximity” to conductors less than 35kV:

Note: Items in **bold** are most applicable to GO 165 inspections.

- A guy is in “proximity” if any portion of the guy is both within a vertical distance of less than 8 feet from the level of the supply conductors, and a radial distance of less than 6 feet from the surface of a wood pole or structure.**
- A guy is “exposed” if any portion of the guy is less than 8 feet horizontally from the vertical plane of any supply conductor of more than 250 volts.**

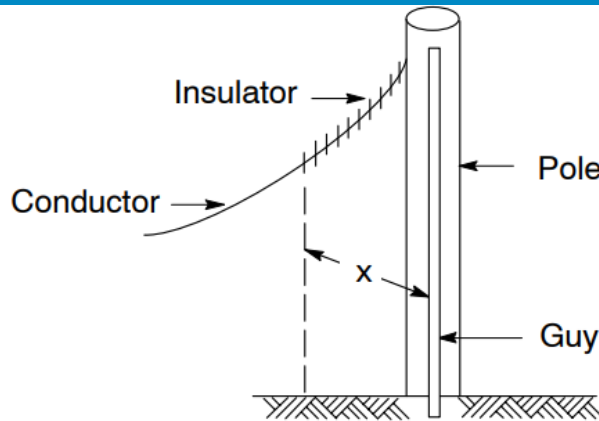

If distance "x" is less than 8', guy is exposed.

If a guy is exposed to any supply conductor of 22,500 volts or more, it will not be sectionalized and shall be securely grounded. All other guys, including overhead guys and guys in the proximity (i.e., cylinder of proximity), shall be sectionalized.

- c) **Any two anchor or overhead guys attached to the same wood pole, which are approximately parallel to each other and act in the same direction, should be separated at the points of attachment to the pole by approximately 12 inches if either of the guys is sectionalized. The purpose of this separation is to maintain a minimum separation of 3 inches between the surface of a strain insulator in one guy and the surface of the other guy. If this minimum separation of 3 inches is not obtained by the 12-inch separation at pole, use other means, such as greater separation than 12 inches, or attachment to separate anchors. This rule does not prohibit the two guys from contacting the same strain plate, nor does it prohibit attaching guys not acting in the same direction to the same through bolt.**
- d) **Not more than two guys, having a vertical separation of 18 inches or less, can be installed in any 4-foot section of climbing space.**
- e) **Overhead guys less than 17 feet long with neither end grounded, shall be sectionalized by installing one insulator approximately midway between points of attachment, in place of two insulators between 6 and 9 feet from each end.**
- f) **Place sectionalizing insulators in guys as high as permissible, giving due consideration to the future installation of additional supply circuits. This is necessary to prevent the grounding of the upper end of such guys by the future installation of grounded telephone cables, tree growth, etc.**
- g) **Guys may be grounded by connecting them to a metallic anchor rod, a securely grounded steel pole, a ground rod, or another grounded guy.**



- h) The requirements for grounding or sectionalizing sidewalk and truss guys, and the conditions under which they may be grounded, are the same as for anchor guys. Braces for these guys which fall within cylinders of proximity (i.e., braces that are less than 8 feet below supply conductors of 0–35,500 V), must not be grounded.
- i) **Those portions of guys that are more than 6 inches from the surface of wood poles or crossarms (measured from the point of attachment along the guy) shall clear transformer cases and hangers by not less than 4 inches. Those portions that are less than 6 inches from the surface of wood poles or crossarms shall clear transformer cases and hangers by not less than 1-1/2 inches.**
- j) **Guys in climbing space may not be closer than 1-1/2 inches to any through bolt that is mechanically connected to dead-end hardware. Guys and guy attachments shall clear ground wires and metal riser conduits for supply cables by 1-1/2 inches minimum.**

Minor Work: No

EC Notification: Yes

Select the Priority and Due Date based upon compelling abnormal condition that may adversely impact public safety and/or service reliability.

Related Documents: [022178](#)



Job Aid: Overhead Assessment







TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

Examples

GUY CLEARANCE	GUY DAMAGED REPAIR
	
At this Location: Acceptable solution through plastic barrier  	At this Location: Guy tail extends beyond the preform, <u>Near sidewalk, safety hazard.</u>  
Perform Minor Work: No	Perform Minor Work: Yes, if safe to do so
Write 3rd Party Notification: No	Write 3rd Party Notification: No
Write EC Notification: No	Write EC Notification: Yes, only if unable to perform minor work. FDA= Guy / Broken/Damaged / Repair Priority= E Tag, depending upon exposure









Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

OVERGROWN GUY	TREE GROWING AROUND GUY
	
<p>At this Location: Extensive dead ivy covering half of length of guy, below the bob. Write EC Notification if there is damage to the guy.</p>  	<p>At this Location: Tree growing around guy, below the bob.</p>  
Perform Minor Work: No	Perform Minor Work: No
Write 3rd Party Notification: No	Write 3rd Party Notification: No
<p>Write EC Notification: Yes</p> <p>FDA= Guy / Broken/Damaged / Replace</p> <p>Priority= Minimum F Tag, depending upon exposure</p>	<p>Write EC Notification: Yes</p> <p>FDA= Guy / Broken/Damaged / Replace</p> <p>Priority= Minimum F Tag, depending upon exposure</p>





Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atrch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

TREE LIMB GROWING AROUND GUY	
Guy through tree	Close-Up
	
At this Location: Tree limb growing around guy, below the bob	
Perform Minor Work: No	
Write 3rd Party Notification: No	
Write EC Notification: Yes	
FDA= Guy / Broken/Damaged / Replace	
Priority= F Tag, depending upon exposure	



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

BROKEN GUY INSULATOR

**At this Location:** Broken guy insulator**Perform Minor Work:** No**Write 3rd Party Notification:** No**Write EC Notification:** Yes**FDA=** Guy / Broken/Damaged / Replace**Priority=** E Tag, depending upon exposure

GUY CORRODED AND MISSING STRANDS

**At this Location:** Guy corroded and missing strands**Perform Minor Work:** No**Write 3rd Party Notification:** No**Write EC Notification:** Yes**FDA=** Guy / Corroded / Replace**Priority=** F Tag, depending on exposure.



Down Guy Grounded above Guy Insulator (vegetation or other)

General Guidance: Ensure that all guys are not grounded above the guy insulator. Remove any foreign objects (e.g., vegetation) contacting and grounding the guy above the insulator as minor work. Clear so that new growth will not contact or ground the guy.

Rule of thumb is that growth per year is 1 foot, so trim back 5 feet.

Minor Work: Yes

EC Notification: Yes

Select the Priority and Due Date based upon compelling abnormal condition that may adversely impact public safety and/or service reliability.

Related Documents: [022178](#)



Job Aid: Overhead Assessment







TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

Examples

DOWN GUY GROUNDED ABOVE GUY INSULATOR	DOWN GUY GROUNDED ABOVE GUY INSULATOR CAUSING STRAIN AND ABRASION
	
<p>At this Location: Vine growing up and across the guy insulator grounding the guy.</p>  	<p>At this Location: Tree grounding the guy above the guy insulator causing strain and abrasion.</p>  
Perform Minor Work: Yes	Perform Minor Work: Yes
Write 3rd Party Notification: No	Write 3rd Party Notification: No
<p>Write EC Notification: Yes, only if minor work cannot be performed.</p> <p>FDA=Guy / Overgrown / Trim</p> <p>Priority= F Tag, depending upon exposure</p> <p>*Note: If signs of burning/tracking or straining/abrasion, consider higher priority.</p>	<p>Write EC Notification: Yes, only if minor work cannot be performed.</p> <p>FDA=Guy / Strain/Abrasion / Remove</p> <p>FDA=Guy / Overgrown / Trim</p> <p>Priority= F Tag, depending upon exposure</p> <p>*Note: If signs of burning/tracking or straining/abrasion, consider higher priority.</p>








Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

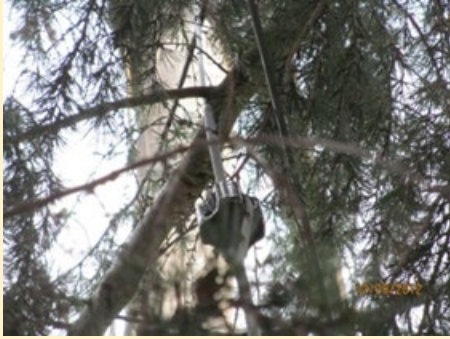Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

GUY GROUNDED BY VEGETATION		
Guy grounded. by vegetation	Guy grounded. by vegetation	Guy overgrown by vegetation
		
At this Location: Guy grounded by vegetation, above the bob.  		
Perform Minor Work: Yes		
Write 3rd Party Notification: No		
Write EC Notification: Yes, only if minor work cannot be performed. FDA= Guy / Overgrown / Trim Priority= F Tag, depending upon exposure *Note: If signs of burning/tracking or straining/abrasion, consider higher priority.		



Down Guy Marker Missing/Damaged

General Guidance: For poles installed with down guys:

- **After 1996**, Guy Markers are required on **all** down guys. The markers must be a minimum 8 ft. in length.
- **Prior to 1996**, guy markers are **only required** on poles which are exposed to traffic. Inspector should confirm the age of the pole via the date nail to verify the requirement.

Install a single guy marker on multiple guys which are clamped together. For guys that are not clamped together, but on the same anchor, consider separate guy markers on each guy if the separation is large.

Note 1: Installing yellow colored guy marker does not negate the need to install visibility strips on the markers. Install visibility strips around traffic areas, on state highways, near curbs, driveways, etc.

Note 2: For existing guy markers, ensure markers are in good condition and attached securely.

See details below:

Reflective visibility strips shall be installed on wood, fiberglass, or steel poles, streetlight poles, and guy markers as follows:

- A. On poles and guy markers installed on state highways.
- B. On poles and guy markers located within 15 feet from the paved surface or 15 feet from the edge of the traveled, unpaved portion of city or county roads (streets) where not protected by curbs.
- C. On poles and guy markers within 6 feet of an adjacent driveway, private roadway (street), turnaround, parking lot, or thoroughfare in rural district, capable of being traversed by vehicles, where these are not protected by curbs.

Note: Install a segment of guy marker above cattle guards to ensure a minimum 8 ft. of guarding.

Minor Work: Yes

EC Notification: Yes

Select the Priority and Due Date based upon compelling abnormal condition that may adversely impact public safety and/or service reliability.

Related Documents: [022178](#)



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

Examples

GUY MARKER MISSING	CATTLE GUARD LESS THAN 8 FT
	
At this Location: Guy marker missing. 	At this Location: Cattle guard is less than 8 feet in length. 
Perform Minor Work: Yes, install new guy marker	Perform Minor Work: Yes, lower cattle guard and add guy marker to meet 8 feet requirement.
Write 3rd Party Notification: No	Write 3rd Party Notification: No
Write EC Notification: No, perform minor work. If minor work cannot be performed FDA=: Guy Marker / missing / Install or replace Priority=: F Tag, depending on exposure	Write EC Notification: No, perform minor work. If minor work cannot be performed FDA= Guy Marker / missing / Install or replace Priority= F Tag, depending on exposure



MISSING MARKER AND VISUAL STRIPS





Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

At this Location: Missing marker and visual strips. After marker is fixed, visual strips are still missing. Evidence of tire marks on anchor.



Perform Minor Work: Yes, add guy marker and reflective vis strips (use standard language around minor work)

Write 3rd Party Notification: No

Write EC Notification: Yes, if cannot bring up to standard with minor work.

FDA= Guy Marker/Missing/Install

Priority= Minimum F tag, depending on exposure



Grounds / Ground Molding

Ground is considered exposed when:

- Can physically touch it with hand or tool.
- Can see the ground conductor.
- Covered ground situation where the insulation is cut into.

Exposed Ground Below 8'

General Guidance: Exposed PG&E owned grounds 8 feet or less from the ground must be covered.

- Inspectors must make every effort to cover the ground as minor work.
- If the exposed ground can be completed as minor work - preferred repair method is to use 1-1/2-inch plastic molding and not wood molding; if wood molding is used to make repair, use straps and not staples.
- Gaps in between molding segments should be covered if, in the inspector's judgment, they are large enough to allow human contact.

Consider a higher priority based on how much of the ground is exposed, and on the amount of public exposure. Inspector should “make safe” if cannot be addressed as minor work, based on location and exposure to the public.

The correct FDA is **Ground / Exposed / Repair** and **NOT** Molding Broken/damaged/repair or replace.

Minor Work: Yes

EC Notification: Yes

Select the Priority and Due Date based upon compelling abnormal condition that may adversely impact public safety and/o service reliability.

Related Documents: [TD-2990P-01](#)



Job Aid: Overhead Assessment




TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

Examples

EXPOSED GROUND	
	<p>At this Location: Exposed grounds near sidewalk.</p>
	 
	<p>Perform Minor Work: Yes</p>
	<p>Write 3rd Party Notification: No</p>
<p>Write EC Notification: Yes, only if minor work cannot be performed.</p> <p>FDA=Ground / Exposed / Repair</p> <p>Priority= A Tag, emergency – due to High public exposure at ground level. (Incorporate E tag if in areas of no or low public exposure.)</p>	



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

REPAIR WITH 1.5" MOLDING



Before: Copper Wire sticking out from under the wood molding



After: 1.5-inch u-shaped molding installed over existing wood molding

At this Location: Wood molding with ground exposed



Perform Minor Work: Yes

Write 3rd Party Notification: No

Write EC Notification: Only if not able to perform minor work.

FDA= Ground / Exposed / Repair

Priority = A Tag, Emergency due to High public exposure below 8' on sidewalk









Job Aid: Overhead Assessment




TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

REPAIR WITH 2" PLASTIC	REPAIR WITH WOOD MOLDING
	
At this Location: Condition acceptable after repair of exposed ground  	At this Location: Condition acceptable after repair with wood molding  

EXPOSED GROUND	
	<p>At this Location: Insulated grounds that does not need molding. Connector to driven ground is exposed.</p> <p> </p> <p>Perform Minor Work: Yes, if safe to do so.</p> <p>Write 3rd Party Notification: No</p> <p>Write EC Notification: Yes, only if minor work cannot be performed.</p> <p>FDA= Ground / Exposed / Repair</p> <p>Priority = Remote location: Minimum E tag, depending on exposure.</p>



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

Exposed Ground above 8' to the Communication Level

General Guidance: If there are communication facilities on the pole, exposed grounds above 8 feet to the communication level must be covered. Cover the ground as minor work if possible. If not, create an EC Notification.

Gaps in between molding segments should be covered if, in the inspector's judgment, they are large enough to allow human contact.

If ground is exposed above communication level, **no action required**.

If the pole is not a joint pole, **no action required**, because there is no exposure to the communication worker.

Minor Work: Yes

EC Notification: Yes

Select the Priority and Due Date based upon compelling abnormal condition that may adversely impact public safety and/or service reliability.

Related Documents: [021904](#), [036229](#)



Job Aid: Overhead Assessment







TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

Examples

EXPOSED GROUND AT COMMUNICATION LEVEL	EXPOSED GROUND DUE TO TWISTED MOLDING
	
<p>At this Location: Exposed ground at communications level. Wood molding broken in climbing space.</p>  	<p>At this Location: Exposed ground in wood molding.</p>  
Perform Minor Work: Yes, if safe to do so	Perform Minor Work: Yes, if safe to do so
Write 3rd Party Notification: No	Write 3rd Party Notification: No
<p>Write EC Notification: Yes, only if unable to perform minor work.</p> <p>FDA= Ground / Exposed / Repair</p> <p>Priority= F Tag At minimum – next inspection cycle; based on field condition and exposure, corrosion, etc.; prioritize as needed (A, B, E, or F)</p>	<p>Write EC Notification: Yes, only if unable to perform minor work.</p> <p>FDA=Ground / Exposed / Repair</p> <p>Priority= F Tag At minimum – next inspection cycle; based on field condition and exposure, corrosion, etc.; prioritize as needed (A, B, E, or F)</p>



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

Ground Molding Unsecured/Loose

General Guidance: Ensure that the molding is in good condition and secured to the pole.

- Look for unsecured and loose wood ground molding, unglued PVC ground molding joints, molding joints that have come apart exposing the ground wire, etc.
- Gaps in between molding segments should be covered if, in the inspector's judgment, they are large enough to allow human contact.

When making repairs - must meet construction standards.







Minor Work: Yes

EC Notification: Yes





Select the Priority and Due Date based upon compelling abnormal condition that may adversely impact public safety and/or service reliability.

Related Documents: [021904](#)

Examples

MOLDING SECURED	MOLDING SECURED
	
<p>At this Location: Molding adequately secured with staples upon arrival. No action is required.</p> <p>Note: Molding for phone ground installed on vis strips is non-compelling.</p>  	<p>At this Location: Molding adequately secured with straps spacing 36 inches or less upon arrival. No action required.</p>  



WOOD MOLDING ABOVE 8', NOT SECURE EXPOSING GROUND	PVC MOLDING ABOVE 8', NOT SECURE EXPOSING GROUND
	
<p>At this Location: PG&E solely owned pole, Wood molding is not secure allowing human contact.</p> 	<p>At this Location: At communication level, PVC molding not secure, due to failure of previous repairs, allowing human contact.</p> 
<p>Perform Minor Work: Yes, if safe to do so</p>	<p>Perform Minor Work: Yes, if safe to do so</p>
<p>Write 3rd Party Notification: No</p>	<p>Write 3rd Party Notification: No</p>
<p>Write EC Notification: No</p>	<p>Write EC Notification: Yes, only if unable to perform minor work.</p> <p>FDA= Ground / Exposed / Repair</p> <p>Priority= F Tag At minimum – next inspection cycle; based on field condition and exposure, corrosion, etc.; prioritize as needed (A, B, E, or F)</p>



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

Exposed Ground Rod

General Guidance: If the ground rod can be permanently covered as minor work, do so. If not, create EC notification.




Minor Work: Yes

EC Notification: Yes

Select the Priority and Due Date based upon compelling abnormal condition that may adversely impact public safety and/or service reliability.

Related Documents: None

Examples

EXPOSED GROUND ROD	
	At this Location: Exposed ground rod, public exposure.  
	Perform Minor Work: Yes, at minimum make safe
	Write 3rd Party Notification: No
	Write EC Notification: Yes FDA= Ground / Exposed / Repair Priority= A Tag, emergency – due to public exposure at ground level, if minor work not done. (Incorporate E tag if in areas of no or low public exposure.)



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

Broken Grounds

General Guidance: Inspector identifies a broken ground.

Minor Work: Yes

- Perform minor work if possible and if safe to do so.
- IF not able to perform minor work, THEN create EC notification.

EC Notification: Yes


Consider an emergency priority based on where the ground is exposed (Above / Below 8'), and on the amount of public exposure. Inspector should "make safe" if cannot be addressed as minor work, based on location and exposure to the public.

When there is confusion on a PG&E broken ground, contact the lead or supervisor for clarification.

Select the Priority and Due Date based upon compelling abnormal condition that may adversely impact public safety and/or service reliability.

Related Documents: [TD-2990P-01](#);

Examples

BROKEN GROUND RUN	
	<p>At this Location: Pole ground has broken, above 8', on a Common Neutral 1000' ground.</p> <p> </p>
	<p>Perform Minor Work: Yes, if safe to do so, Refer to TD-2990P-01 for repair.</p>
	<p>Write 3rd Party Notification: No</p>
	<p>Write EC Notification: Yes, if not able to be performed under minor work</p>
	<p>FDA= Ground / Broken/Damaged / Replace or Repair</p> <p>Priority= B Tag, depending on exposure</p>



BROKEN GROUND RUN



At this Location: Transformer ground has broken, below 8', in the sidewalk, exposed to the public.



Perform Minor Work: Yes, if safe to do so, Refer to [TD-2990P-01 for repair.](#)

Write 3rd Party Notification: No

Write EC Notification: Yes, if not able to be performed under minor work

FDA= Ground / Broken/Damaged / Replace or Repair

Priority= Due to public exposure, A Tag, Follow the emergency procedure If there is low to no public exposure, may use X priority.

Markings

High Voltage Sign Not Installed as Required

General Guidance: Inspectors are required to look for missing or clearly illegible high voltage signs during inspections. If an inspector finds only one high-voltage sign within 40" below the lowest 750V or greater conductor or 6" below the equipment, the inspector is not required to install or create an EC notification for a second sign.

When performing work at the lowest crossarm level, a second sign must be installed.
Follow standard: 002168

If inspectors find missing or clearly illegible signs, they should install new signs as minor work if they have the appropriate materials and equipment and can perform the work safely.

Minor Work: Yes


EC Notification: Yes, if cannot be completed as minor work.

Select the Priority and Due Date based upon compelling abnormal condition that may adversely impact public safety and/or service reliability.

Related Documents: [022168](#)

High Voltage Sign Requirements (if Minor Work is performed):

When installing *new* high voltage signs using one option, inspectors are not required to remove signs previously installed under different options.

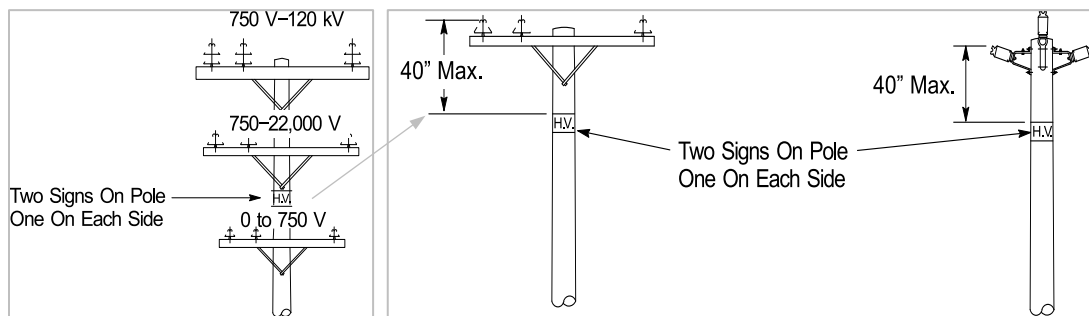



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02
Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

Examples

BROKEN HIGH SIGN



At this Location: Broken High Sign



Perform Minor Work: No

Write 3rd Party Notification: No

Write EC Notification: No



Operating Number Incorrect / Illegible / Missing

General Guidance:

IF the operating number on the field equipment does **not** match the operating number printed on inspection map:

THEN **contact the local Distribution Operation (DO)** to confirm the discrepancy and to get further instructions.

Note: Best practices install a caution tag at structure.

- I. Equipment has a number, does not match GIS mapping records.
 - A. DO confirms the field equipment number is **correct**; then complete a **map correction**.
 - Field employee confirmed with DO the field equipment number is correct.
 - Mapping corrects number in GIS.
 - B. DO confirms the field equipment number is **not correct**; then **perform minor work to correct the operating numbers** on the field equipment.
 - Field employee has the ability to perform the minor work.
 - If minor work cannot be performed, create EC to install correct operating number.
 - FDA = Operating Number / Broken / Replace
 - or
 - FDA = Operating Number / Missing / Install
 - Priority "E" 12 months
- II. Equipment does not have a number.
 - A. DO **cannot confirm the operating number**.
 - Get a PIN from DO
 - Create EC Notification to get an operating number assigned.
 - FDA = Operating Number / Missing / Install
 - Priority "E" 12 months

(Estimating will assign number, crew to complete, and mapping to update GIS)



B. DO **confirms** the operating number for the field equipment then:

- **complete minor work to install the equipment number.**
OR if unsafe to complete
- Create EC notification for M&C to install number.
 - FDA = Operating Number / Missing / Install
 - Priority "E" 12 months
- Create a RW for a mapping change, for either minor work or EC.
- Inspector or crew will install operating number in the field, mapping will update GIS.

Notes:

- Alpha characters may differ between divisions. Be sure to confirm the "number" with the local DO.
- Operating number should be installed in the operating position; if missing, they should be installed on the operating position, not at the 6' level. Consider also adding the # at the 6' level for ease of identification for field EE's.
- If operating number exists, is it legible (faded, etc.); if not legible replace them as minor work or create an EC notification.
- If operating number is not installed in the field, but on the inspection map - call the DO to confirm the correct number before installing.
- If confirmed that the field is wrong, correct as minor work or create an EC to have corrected.
- If confirmed that the operating number is mapped but not installed in the field, install the operating number as minor work.
- If operating number is not installed in the field, but on the inspection map and/or in GIS - call the team lead who will contact the DO to confirm the correct number before installing.
- If confirmed that the number is mapped but not installed in the field, or the field is incorrect, correct as minor work if possible, or write EC notification.
- Please include detailed comments on what is needed at location.

Minor Work: Yes

Map Correction: Yes, if operating number needs to be corrected.

EC Notification Yes, if you cannot perform minor work.

Select the Priority and Due Date based upon compelling abnormal condition that may adversely impact public safety and/or service reliability.

Related Documents: [057352](#)



Job Aid: Overhead Assessment






TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

Example

FADED OPERATING NUMBER		
Before: Faded operating number	Close Up	After: Minor work completed, operating number applied below operating position.
		
At this Location: Operating number is faded.  		
Perform Minor Work: Yes		
Write 3rd Party Notification: No		
Write EC Notification: Yes, only if minor work cannot be performed. FDA= Operating Numbers / Broken/Damaged / Replace Priority= E Tag, depending on exposure.		



Damaged or Missing Visibility Strips on Poles / Guy Markers

General Guidance: Reflective visibility strips shall be installed on wood, fiberglass, or steel poles, streetlight poles, and guy markers as follows:

- A. On poles and guy markers installed on state highways.
- B. On poles and guy markers located within 15 feet from the paved surface or 15 feet from the edge of the traveled, unpaved portion of city or county roads (streets) where not protected by curbs.
- C. On poles and guy markers within 6 feet of an adjacent driveway, private roadway (street), turnaround, parking lot, or thoroughfare in rural district, capable of being traversed by vehicles, where these are not protected by curbs.

Notes:

Visibility strips are not required on poles or guy markers behind a curb, approximately 5-1/2" x 5-1/2" and 90 degrees to the surface.

Visibility strips should not be installed if there is no reasonable expectation of traffic. For example: Cross country poles, poles through waterways or wetlands, rear easements poles, poles behind guardrails, or poles on embankments that are well above or below the road.

Reminders:

- Do not install visibility strips on top of the old one. Inspectors must remove the old strip first.
- If the old strip is in good condition, but became loose, re-secure the strip to the structure.
- Do not install metal visibility strips over any vertical molding/riser.
- If any visibility strip work is required, bring the location up to the current visibility strip standard (all must be the same color – yellow)
- Install visibility strips on the side facing oncoming traffic when known.
- Do not install metal visibility strips within 1-1/2" of hardware that is grounded or may become energized.
- Metal Visibility strips cannot be installed above/beneath wood molding, including third party installations.
- Molding for phone ground installed above/beneath visibility strips alone is non-compelling.
- If existing visibility strips become damaged or otherwise do not serve their intended purpose, they shall be replaced.
- If unable to install at time of inspection due to lack of material, create EC notification.



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atrch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14







Minor Work: Yes

EC Notification: Yes, if cannot be completed as minor work.

Select the Priority and Due Date based upon compelling abnormal condition that may adversely impact public safety and/or service reliability.

Related Documents: [022168](#), GO 95 Rule 56.9 (1964, 1990, 1996 Change to Guy Marker)

Examples

ACCEPTABLE	
ADHESIVE VISIBILITY STRIPS	CLEARANCE FROM GROUND
	
<p>At this Location: Acceptable application of plastic and adhesive visibility strips.</p> <p>Note: Molding for phone ground installed on vis strips is non-compelling.</p>  	<p>At this Location: Acceptable metal visibility strips attached 1 ½ "from ground.</p>  



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

INADEQUATE VISIBILITY STRIPS



At this Location: Pole with vehicular exposure. Two small sections of yellow adhesive visibility strips.



Perform Minor Work: Yes

apply 3 adhesive visibility strips on the pipe.
apply 3 adhesive visibility strips to the plastic molding.

Write 3rd Party Notification: No

Write EC Notification: Yes, if minor work cannot be performed.

FDA= Vis-Strips / Broken/Damaged / Replace

Priority= F Tag, depending on exposure

VISIBILITY STRIPS PAINTED OVER NO LONGER REFLECTIVE



At this Location: Visibility strips painted brown (3PrdP visibility strip located above not shown in picture).



Perform Minor Work: Yes

Remove old visibility strips and install new

Write 3rd Party Notification: No

Write EC Notification: Yes, if minor work cannot be performed.

FDA= Vis-Strips / Broken/Damaged / Replace

Priority= F Tag, depending on exposure







Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

METAL OVER MOLDING	
Before	After
	
<p>At this Location: Metal visibility strips under wood molding and over wood molding with protruding edge.</p> <p> </p>	
<p>Perform Minor Work: Yes, remove old metal visibility strips and apply new visibility strips; visibility strips installed in “after” photo are fiber, not metal (coded item)</p>	
<p>Write 3rd Party Notification: No</p>	
<p>Write EC Notification: Yes, only if minor work cannot be performed.</p> <p>FDA= Vis-Strips / Broken/Damaged / Replace</p> <p>Priority= F Tag, depending on exposure</p>	









Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atrch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

OLD METHOD VISIBILITY STRIPS NOT YELLOW	OLD AND NEW VISIBILITY STRIPS NOT YELLOW
	
At this Location: Aged visibility strips have lost reflectivity.  	At this Location: Yellow visibility strips mounted over old white visibility strips.  
Perform Minor Work: Yes, Replace with 3 yellow visibility strips	Perform Minor Work: Yes, remove old visibility strips
Write 3rd Party Notification: No	Write 3rd Party Notification: No
Write EC Notification: Yes, if minor work cannot be performed. FDA= Vis-Strips / Broken/Damaged / Replace Priority= F Tag, depending on exposure	Write EC Notification: Yes, if minor work cannot be performed. FDA= Vis-Strips / Broken/Damaged / Replace Priority= F Tag, depending on exposure





Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

GRAFFATI ON VISIBILITY STRIPS	
	<p>At this Location: Visibility strips have spray paint.</p> <p> </p>
	<p>Perform Minor Work: Yes, replace vis strips.</p>
	<p>Write 3rd Party Notification: Yes</p>
	<p>Write EC Notification: Yes, if cannot complete minor work.</p> <p>FDA= Visibility Stripe / Broken/Damaged / Replace</p> <p>Priority= F Tag, depending on exposure</p> <p>Note: Molding for phone ground installed vis strips alone is non-compelling.</p>



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003A1ch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

Streetlights

Broken or Damaged Streetlight Pole

General Guidance: While streetlights aren't part of an inspection list, if one is seen with a compelling abnormal condition, then create EC notification.

Minor Work: No

EC Notification: Yes

Related Documents: TD-2309S, [TD-2307M](#)



Job Aid: Overhead Assessment







TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

Example

MISSING STREET LIGHT	LEANING AGGREGATE POLE
	
<p>At this Location: Cone indicates location of missing decorative streetlight and pole. Exposed wire is de-energized.</p> <p> </p>	<p>At this Location: Leaning aggregate pole more than 10% out of plumb. Pole is broken at base and not stable. Light still working.</p> <p> </p>
<p>Perform Minor Work: Yes, make safe</p>	<p>Perform Minor Work: No</p>
<p>Write 3rd Party Notification: No</p>	<p>Write 3rd Party Notification: No</p>
<p>Write EC Notification: Yes, only if minor work cannot be performed.</p> <p>FDA= Decorative Streetlight / Broken/Damaged / Replace</p> <p>Priority= E Tag, add in field comment section – describe if pole is missing.</p>	<p>Write EC Notification: Yes</p> <p>FDA= Pole / Broken/Damaged / Replace</p> <p>Priority= B Tag, depending on exposure</p>



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

Day Burner

General Guidance: **Do not** create an EC Notification for a day burner. Call Restoration Dispatch or PBX hotline internal non-emergency 1-415-973-7000 to get a T-Man to respond. This is to ensure correct accounting for streetlight work (depending on the rate that the customer is one, etc.).

Minor Work: Yes, if you have the materials on your truck.

EC Notification: No

Related Documents: Utility S2309

Missing Streetlight Head

General Guidance: If the inspector notices that a missing streetlight, first, make safe then create EC notification to install a missing streetlight.

Minor Work: No

EC Notification: Yes

Related Documents: Utility S2309



Wildlife Protection

Existing Migratory Bird Protection Damaged

General Guidance: Evaluate locations where bird protection has previously been installed to assess if it is adequate or is missing or broken. If not adequate or needs repair, create EC notification to repair or install.

When in doubt reach out to Supervisor / Lead to reach out to avian specialist.

Note: If there is a nest at the location, write EC Notification to install bird protection if nest is already abandoned.

Minor Work: No

Related Documents: [Utility S2321](#), [061149](#)

Reference: [066209 – Repair of Damaged Pole Tops](#)

Per [066209](#):

Active Nests:

- Active Nests are ones with eggs or young in them.
- Do not disturb active nests unless they present an immediate safety or operating hazard.

Contact Lead / Supervisor or the avian program management personnel or the Bird Hotline at (415) 973-9453 for assistance with an active nest removal or relocation.

Inactive Nests:

- Inactive nests are those nests without viable eggs or young.
- Inactive nests, except eagle nests or T&E (threatened and endangered) species' nests, can be removed; however, do not keep an inactive nest without notifying avian program management personnel or governmental agencies. Nests may be difficult to identify.

If there is any uncertainty about the type of nest, contact Lead / Supervisor or the avian program management personnel or the Bird Hotline at (415) 973-9453 for assistance with an active nest removal or relocation.



Job Aid: Overhead Assessment




TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

Examples

BIRD NEST ON TRANSFORMER	
	At this Location: Bird Nest on transformer, abandoned, touching high side jumper.  
	Perform Minor Work: No
	Write 3rd Party Notification: No
	Write EC Notification: Yes FDA= Overhead facility / Obstruction / Remove FDA= Bird protection / Bird protection Deteriorated / Install Priority= X Tag







Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

BROKEN INSULATOR COVERS		
<div></div> <div></div>	At this Location: Broken insulator covers.	
	<div></div> <div></div>	
	Perform Minor Work: No	
	Write 3rd Party Notification: No	
	Write EC Notification: Yes FDA= Bird Protection / Bird Protection / Install or Replace <i>Whichever FDA is applicable.</i> Priority= E Tag, depending on exposure	

Exiting Wildlife Protection Damaged

General Guidance: Inspector should create EC notification to replace damaged or missing existing wildlife protection installed in the field (e.g., Cattle Guard, Squirrel Guard).

Minor Work: No

EC Notification: Yes

FDA: Animal Mitigation / Broken/Damaged / Replace

Related Documents: [061149](#)

Note: For these kinds of conditions, use



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

Examples

Bird protection



Center phase cover installed on conductor.



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

Riser Molding

Broken/Missing Riser Ground

General Guidance: See 'Ground / Ground Molding in this job Aid.

Minor Work: None

Related Documents: [027742](#)

U-Shape Riser Molding Broken/Damaged or Unsecured

General Guidance – Existing Molding:

Ensure bottom section of ground molding is flush against the pole.

IF molding is NOT firmly attached to pole

THEN Perform Minor Work to secure molding to pole by attaching all lags **OR** Create EC Notification

Address any gaps identified via minor work or create an EC notification.

General Guidance if Installing New Molding or Repairing Existing Molding:

- **Below 8 feet:** Both sides of the molding must be secured to the pole at least every 18 inches (a lag in every hole).
- **Above 8 feet:** Both sides of the molding must be secured to the pole at least every 36 inches.

Minor Work: Yes

EC Notification: Yes

Related Documents: [021924](#)



Job Aid: Overhead Assessment


TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

Example

CRACKED RISER BOOT	BROKEN RISER
 <p>A photograph of a white riser boot with a red circle highlighting a crack at the base. A white tag with red text is placed below the boot, reading 'CRACKED BOOT EC TAG'.</p>	 <p>A photograph of a broken riser with a large tear in the white protective sleeve, revealing the internal components. A white tag with green text is placed above the damage, reading 'Broken riser'.</p>
At this Location: Cracked riser boot	At this Location: Broken riser
 	 
Perform Minor Work: Yes, if safe to do so.	Perform Minor Work: Yes, if safe to do so.
Write 3rd Party Notification: No	Write 3rd Party Notification: No
Write EC Notification: Yes, only if minor work cannot be performed. FDA= Molding / Broken/Damaged / Repair Priority= F Tag, depending on exposure	Write EC Notification: Yes, only if minor work cannot be performed. FDA= Molding / Broken/Damaged / Replace Priority= F tag, depending on exposure. Consider A Tag, follow emergency process based on public exposure.






Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

BROKEN RISER	
	At this Location: Riser molding is broken exposing conductors.  
	Perform Minor Work: Yes, if safe to do so.
	Write 3rd Party Notification: No
	Write Vegetation Notification: No
	Write EC Notification: Yes, if minor work cannot be completed. FDA= Molding / Broken/Damaged / Replace Priority= F Tag, depending on exposure. Consider a higher priority based on public exposure.

Pole Steps

General Guidance: Remove any pole steps less than 8 feet 6 inches above the ground or any other accessible surface; this allows for grading, landscaping, etc.

Minor Work: Yes

EC Notification: Yes, if above 7.5 feet and cannot be completed as minor work.

3rd Party Notification: Yes, if below 7.5 feet.

Select the Priority and Due Date based upon compelling abnormal condition that may adversely impact public safety and/or service reliability.

Related Documents: [022616](#) page 2, section 5 [027911](#)



Declaration Items

Trees

Trees within 4 Feet of a Primary Line

General Guidance: If you have any questions about the integrity of tree that could impact electric facilities, (causing damage to our facilities, dead or dying, causing conductor height issue, could fall into line etc.), write a Vegetation Notification to remove dead/dying tree.

Broken Limb on Conductor that has potential to cross-phase or has strain:

Remove the limb as minor work with a hot stick if it is safe to do so. If minor work cannot be completed, and has potential to cross phase or strain, then create EC Notification X tag.

Vegetation Touching Bare Primary Conductor or Signs of Burning or Arcing:

Create an emergency Priority "A" Vegetation Management Tag and call supervisor or lead for assistance in contacting vegetation management. Wait at the location until relieved.

Vegetation Not Touching Bare Conductor and No Signs of Burning or Arcing:

Create a Vegetation Management notification.

Minor Work: Yes

EC Notification: Yes

Related Documents: GO 95 Rule 35



Job Aid: Overhead Assessment




TD- 2305M-JA02




WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

Examples

LARGE BRANCH BROKEN	
	At this Location: Large branch broken on cross-arm. Cross-arm in poor condition. No charring visible.  
	Perform Minor Work: No
	Write 3rd Party Notification: No
	Write Vegetation Notification: No
	Write EC Notification: Yes FDA= Cross-arm / Broken/Damaged / Replace FDA= Tree / clearance / Remove Priority= Minimum X Tag, depending on exposure.

DEAD TREE BRANCH FELL INTO PRIMARY	
	At this Location: Dead tree branch fell into primary. No charring visible.  
	Perform Minor Work: No
	Write 3rd Party Notification: No
	Write Vegetation Notification: No
	Write EC Notification: Yes FDA= Tree / clearance / Remove Priority= Minimum X Tag, depending on exposure.









Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

SMALL BRANCHES ON PRIMARY AND SECONDARY	LONG TREE BARK HANGING ON PRIMARY CONDUCTOR
	
<p>At this Location: Small branches (foreign debris) on primary and secondary. Too small to cause a cross-phase or damage.</p> <p> </p>	<p>At this Location: Long tree bark strands (foreign debris), hanging from bare primary conductor, phase separation on single phase cross-arm far enough not to cause cross-phase.</p> <p> </p>
Perform Minor Work: Yes, if possible	Perform Minor Work: Yes, if possible
Write 3rd Party Notification: No	Write 3rd Party Notification: No
Write EC Notification: No	<p>Write EC Notification: Yes, only when minor work not performed.</p> <p>FDA= Tree / Clearance / Remove</p> <p>Priority= B Tag, depending on exposure</p>



Trees Causing Strain or Abrasion to a Secondary Conductor or Service

General Guidance:

If vegetation is:

- A. Causing damage to the conductor insulation due to friction (Note: scuffing and polishing is NOT damaged) **OR**
- B. Causing strain on the conductor that is moving the conductor outside of normal slack or pushing wires closer together.

Note: The inspector should clear the vegetation or move the conductor as minor work if possible. Inspectors should leave the trimmings at the location; use door hanger to notify customer.

If the inspector cannot clear the vegetation or move the conductor:

- For service drops: Create an EC notification.
 - When PGE becomes aware of strain or abrasion on service wire, it is PGE's responsibility to clear the condition, not the customers. (Rule 16)
 - If we become aware of an actual strain or abrasion, then we must mitigate it. We need to notify the customer of the issue in order to mitigate. If the customer doesn't allow us to mitigate then shutting off power is an option.
- For secondary conductor spans serving 2 or more customers: Write a Vegetation Management notification with priority based on severity.

Note: Vegetation Management considers secondary as conductor that feeds more than one physical address (per Rule 16); i.e., multiple "service" conductors feeding the **same customer/property are considered service**, not secondary; Inspector will need to **create an EC** in this scenario.

If the inspector sees a hazardous vegetation issue on communication facilities, create a third- party notification.

Minor Work: Yes

EC Notification: Yes

Related Documents: GO 95 Rule 35 and Rule 16



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

Examples

TREE STRAIN ON SERVICE DROP



At this Location: Tree strain on service drop.



Perform Minor Work: No

Write 3rd Party Notification: No

Write Vegetation Notification: No

Write EC Notification: Yes

FDA= Tree / Vine / Overgrown / Trim

Priority= E Tag, depending on exposure

PHONE TREE CONDITION



At this Location: Tree putting strain on the pole, due to communication line.



Perform Minor Work: No

Write 3rd Party Notification: Yes

Write EC Notification: No



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

SECONDARY HARD AGAINST TREE



SECONDARY OVERGROWN REDUCING CONDUCTOR CLEARANCES



At this Location: Secondary conductor resting on tree/vegetation. Tree causing strain on open wire secondary, **feeding more than one customer.**



Perform Minor Work: No

Write 3rd Party Notification: No

Write Vegetation Notification: Yes

FDA= Tree / Strain or Abrasion Secondary / Trim

Priority= E Tag, depending on exposure



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

Trees Overgrown, NOT Causing Strain or Abrasion to a Secondary Conductor or Service

General Guidance: If trees are in contact with secondary conductor serving multiple customers or a covered service conductor **not** causing strain or abrasion, no EC tag or minor work is necessary.


Minor Work: No

EC Notification: No

Related Documents: GO 95 Rule 35 and Rule 16

Examples

TREE GROWING INTO BARE OPEN WIRE SECONDARY OR BARE OPEN WIRE SERVICE, NO STRAIN OR ABRASION

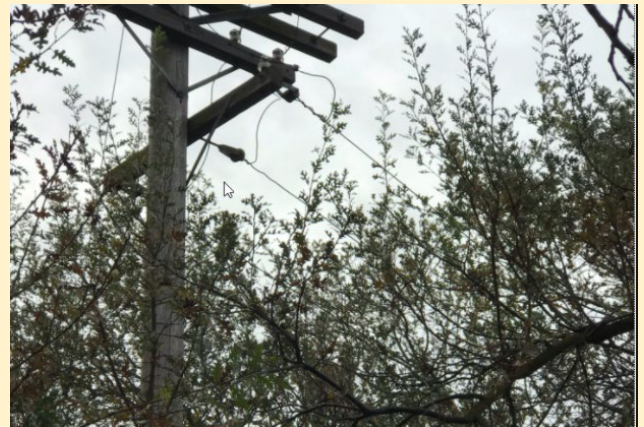

At this Location: Tree grown around bare open wire secondary, no strain or abrasion. Spreader bracket already installed.



Perform Minor Work: No

Write 3rd Party Notification: No

Write Vegetation Notification: No

Write EC Notification: No



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

TREE GROWING AROUND SERVICE, NO STRAIN OR ABRASION



At this Location: Tree grown around service, no strain or abrasion.



Perform Minor Work: No

Write 3rd Party Notification: No

Write Vegetation Notification: No

Write EC Notification: No



Idle Facilities

Identifying and Documenting Idle Facilities

- a. Inspectors identify and document idle lines as they would for any other field condition found, per the requirements and procedures in the Electric Distribution Preventative Maintenance (EDPM) Manual [TD-2305M](#).

Notes:

- 1) Whether a line is idle or not, continue to create EC notifications to document safety, reliability, and/or regulatory issues and create EC notifications for Vegetation Issues.
- 2) All vegetations issues on idle facilities shall be written up on an EC tag. Do not create Veg only notifications for idle lines. Vegetation management personnel do not patrol or maintain vegetation on de-energized tap lines.
- b. Compliance Inspections follow the Idle Facility Program as documented in [TD-2459P-01](#) and use the annual Detailed Overhead Inspection Checklist to indicate when an Idle condition is present for the inspection location by checking the observed an Idle Facility box.
- c. When an idle condition is selected, the inspector shall select from 4 reasons:
 1. Pole is not mapped idle. It is de-energized.
 - Create IF Notification (using the Inspect App)
 2. Pole is not mapped idle. It is energized.
 - Create IF Notification (using the Inspect App)
 - Create EC Notification (to de-energize)
 3. Pole is mapped idle. It is de-energized.
 - No further action required.
 4. Pole is mapped idle. It is energized.
 - Create EC Notification (to de-energize)
- d. **Inspect App:** Use the IF Notification in the Inspect App to document an observed Idle Facility field condition. These include asset information, location information, facility type, field conditions, and comments and photos. Compliance Inspectors will select the appropriate Priority as follows:
- e.
 1. High Priority
 - Location is associated with a new or existing EC Notification B Priority for maintenance work at this location.

NOTE: Excludes “Idle Facility/De Energize”



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

2. Medium Priority

- Transformer Present (Suspect PCB could elevate this to high priority depending on field conditions or exposure)
- HFTD T3/T2
- Oil Filled Equipment
- Modesto Irrigation District (60 days)

3. Low Priority

- All other conditions

This listing is an overall summary of the guidance for IF Priority selection. For more detailed guidance please refer to the table below also included in TD-2459P-01

f. At a **minimum**, attach the following three images to each IF Notification:

- Two field photos of the field condition
- Screenshot of Map with the idle area clearly identified.

In addition, please include any other photos that may be useful to the investigation e.g., photo of the meter or a panel with no meter.

Notes:

- 1) Continue to document safety, reliability, and/or regulatory issues for EC and Vegetation Notifications. Vegetation management personnel **do not** patrol or maintain vegetation on de-energized tap lines.
- 2) Use Table 1 from [TD-2459P-01](#) to help in understanding the various priorities.
- 3) Mapping resources are an additional tool help to identify idle facilities but should **NOT** be solely relied on to create EC Notifications to de-energize. Be sure to field confirm.

Pacific Gas and
Electric Company®

Utility Procedure: TD-2459P-01

Publication Date: 03/03/2022, Effective Date: 03/03/2022, Rev: 4

Idle Facility Program

Table 1. Idle Facility Field Conditions and Investigation Priorities

Condition	Action	Investigation Priority
Safety situation/risk.	<ul style="list-style-type: none"> Mitigate hazard and make safe, which may include de-energizing. Initiate an IF notification for investigation. Initiate an electric corrective (EC) notification to document any other abnormal conditions to resolve. Initiate a Priority B, 3-month EC notification to de-energize the facility. 	<ul style="list-style-type: none"> High Submit to supervisor by end of day. Enter in SAP and communicate to idle facility investigation personnel within two business days.
<p>Idle transformers that do not have a blue sticker indicating a polychlorinated biphenyl (PCB) content of less than 5 parts per million (ppm) may be classified as high, medium, or low priority.</p> <p>Consider current field conditions¹, the transformer condition, and if the following sensitive locations are nearby:</p> <ul style="list-style-type: none"> Surface or ground waters Sewers or sewage treatment systems Private or public drinking water sources or distribution systems Grazing lands Vegetable gardens or agricultural areas Daycare centers and schools 	<p>If high priority, then mitigate hazard and make safe, which may include de-energizing.</p> <ul style="list-style-type: none"> Initiate an IF notification for investigation; priority is dependent on field and equipment conditions. Note the specific field conditions, transformer condition, and transform locations (see "Condition" column notes) in the Comments section Initiate a Priority B, 3-month EC notification to de-energize the facility 	<ul style="list-style-type: none"> High – Medium – Low To designate as high priority, consider the identified idle transformer locations, current condition of the transformer (see "Condition" column notes), and current condition of associated facilities (pole, crossarm, etc.)
Future work required to maintain existing idle facility (EC notifications to repair/replace/relocate facilities).	<ul style="list-style-type: none"> Initiate an IF notification for investigation and ensure the Future Work Requested field is checked Initiate a Priority B, 3-month EC notification to de-energize the facility 	High – Medium – Low
PG&E and Modesto Irrigation District (MID) service areas.	<ul style="list-style-type: none"> Initiate an IF notification for investigation Initiate a Priority B, 3-month EC notification to de-energize the facility 	Medium
<p>Idle facilities in raptor concentration zones (RCZs) with suitable habitat to support threatened or endangered raptors.</p> <p>Oil-filled equipment considerations:</p> <ul style="list-style-type: none"> Surface or ground waters Sewers or sewage treatment systems Private or public drinking water sources or distribution systems Grazing lands Vegetable gardens or agricultural areas Daycare centers and schools 	<ul style="list-style-type: none"> Initiate an IF notification for investigation. Initiate a Priority B, 3-month EC notification to de-energize the facility. Initiate an IF notification for investigation. For idle transformers, note the absence or presence of a blue sticker on the IF notification; a blue sticker indicates a PCB content of less than 5 ppm Initiate a Priority B, 3-month EC notification to de-energize the facility. 	<p>Medium – Low</p> <p>Medium</p>
Idle facility in Tier 2 & 3 fire zone.	<ul style="list-style-type: none"> Initiate an IF notification for investigation. Initiate a Priority B, 3-month EC notification to de-energize the facility. 	Medium
Potential use for agricultural pumps or vacant buildings.	<ul style="list-style-type: none"> Initiate an IF notification for investigation. Initiate a Priority B, 3-month EC notification to de-energize the facility 	Low
Entire primary tap is identified as idle and is unused. No future work is required to maintain the existing idle facility.	<ul style="list-style-type: none"> Initiate an IF notification for investigation. Initiate a Priority B, 3-month EC notification to de-energize the line. 	Low



- 4) **You may find coding already annotated on the maps when inspecting idle lines.** Use Table 2 to help in understand the mapping annotations.

Note: When using the Inspect App, ensure that “feature note” is enabled to see annotations on maps.

Table 2. TOS/TIF Classifications

Temporary Out of Service (TOS) De-Energized Temporary Idle Facility (TIF) Energized		
Facilities with a future use are grouped into one of the following classifications:		
TOS-AG	Potential agricultural use	De-energized
TIF-AG	Potential agricultural use	Energized
TOS-V	Potential service to an existing vacant building	De-energized
TIF-V	Potential service to an existing vacant building	Energized
TOS-CAP	Potential PG&E use for capacity or reliability	De-energized
TIF-CAP	Potential PG&E use for capacity or reliability	Energized
TOS-F	Future customer use identified by service planning	De-energized
TIF-F	Future customer use identified by service planning	Energized
TOS-MLX	Current Main Line Extension Agreement	De-energized
TIF-MLX	Current Main Line Extension Agreement	Energized
TOS-SFA	Current Special Facilities Agreement	De-energized
TIF-SFA	Current Special Facilities Agreement	Energized

- 5) When new maintenance is identified on energized idle facilities, write **THREE** notifications:
- One IF Notification ([TD-2459S-F01](#)) for the entire idle line
 - One EC Notification to de-energize the entire idle line.
 - One EC Notification per location requiring maintenance or veg work.
- 6) After identifying pending maintenance on idle facilities, ensure that the IF Notification has the Field Condition box “Future work required to maintain existing idle facility” checked.
- Enter the following note in the EC Notification comments section: “IDLE notification created.”
 - Enter a note in both IF Notification and EC Notification comments with corresponding notification numbers, when available.
- 7) Always ask your PG&E Lead, IRS, or Supervisor for help in determining priority, creating the IF Notification, and creating an EC Notification to de-energize the idle line.



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

Energized Electric Line Facility No Longer Used to Serve Customer Load

General Guidance: It may be necessary to de-energize the idle facility:

- If primary lines are energized, de-energize line sections by opening cut-outs when possible and safe to do so. If you are unable to safely de-energize OR you are in raptor concentration zones (RCZs) with inadequate protection or exposed conductors OR if the primary tap line is unfused, create a Priority B, 3-month Electric Corrective (EC) Notification to de-energize the facilities (AND de-energize jumpers if in RCZ).

NOTE:

When idle transformers or sections of the line de-energized by cut-outs, are located in non-raptor areas, an EC Notification is **NOT REQUIRED** to de-energize the jumpers.

Do not initiate an IF Notification or an EC Notification when attachments to poles (cross-arms, miscellaneous hardware, brackets, insulators, etc.) do not pose a safety or reliability risk to an idle facility. If it is not necessary to de-energize the idle facility, create a Priority "F" EC Notification.

Continue to document safety or reliability issues that meet criteria for vegetation notifications.

Minor Work: No

EC Notification: Yes, to de-energize.

Idle Facility Form: Yes

Related Documents: [TD-2459P-01](#)



De-Energized Electric Line Facility Already Identified on a Pending EC Notification but Not Mapped

General Guidance: Create a map change request if the facility is not mapped as idle. Also, if a facility is mapped as idle but serves customer load, create a map change.

Note: Do not de-energize active customers.

Minor Work: No

Map Correction: Yes

Related Documents: [TD-2459P-01](#)

Idle Hardware

General Guidance:

When a field employee encounters extra unused hardware on a pole (cross-arms, miscellaneous hardware, brackets, insulators, etc.), if hardware poses no safety or reliability issue, then no action required.

If hardware poses or could pose safety or reliability issue create an EC Tag. Do not write up IF notification solely due to "idle hardware."

Minor Work: Yes, if safe to remove.

EC Notification: Yes, if cannot complete minor work.

Select the Priority and Due date based upon compelling abnormal condition that may adversely impact public safety and/or service reliability.

Abandoned Pole Butt

General Guidance: If there is any compelling safety related issue regarding an abandoned pole butt, not just the existence of an abandoned pole butt, write EC notification.

Minor Work: No

EC Notification: Yes

Select the Priority and Due Date based upon compelling abnormal condition that may adversely impact public safety and/or service reliability.



Job Aid: Overhead Assessment




TD- 2305M-JA02




WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

Example

ABANDONED POLE BUTT – HOLLOWED OUT BELOW GROUND LEVEL	
	At this Location: Abandoned Pole Butt with a safety issue such as a tripping hazard, hollowed out below ground level.  
	Perform Minor Work: Yes, make safe if possible.
	Write 3rd Party Notification: No
	Write EC Notification: Yes, if cannot be completed as minor work. FDA= Relinquished Pole / Decayed / Rotten / Remove
	Priority= E Tag, depending on exposure

RELINQUISHED POLE	
	At this Location: Relinquished Pole, no compelling abnormal conditions  
	Perform Minor Work: No
	Write 3rd Party Notification: No
	Write EC Notification: No



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

ABANDONED POLE BUTT



At this Location: Abandoned Pole Butt, low risk



Perform Minor Work: No

Write 3rd Party Notification: No

Write EC Notification: No



3rd Party Notification

Utility – Cable, Phone, and other Electric Utility Partners

General Guidance: If safety or reliability issues are encountered with joint utility or tenant facilities on structures, create a 3rd party utility notification. For emergencies contact your supervisor or Lead.

Inspectors should specifically look for the items in the referenced standard.

- 1) Safety Hazards (Strict definition of Level 1 conditions)
- 2) Third party issues that impact PG&E facilities.

We should not write TPs with lower priority items; this is not the intent. For example, by this definition, slack TP guys would not hit the threshold unless they impact PG&E facilities.

Comcast Dispatch - 1-888-824-8219 (for level 1 priorities)

AT&T Emergency Dispatch: 1-888-978-3889 (level 1 priorities)

Note: When filling out form, choose either phone or cable. Only choose “unknown,” if unsure whether phone or cable.

Minor Work: No

EC Notification: No

3rd Party Utility Notification: Yes

References: [TD-2014P-01](#)



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

Example

3rd PARTY CABLE LOOSE LASHING LONG ENOUGH TO WHIP INTO POWER LINES



Before



After - Snip Lashing and Tape

At this Location: 3rd party communication line has a loose lashing long enough to whip into power lines. Stand-by situation.



Perform Minor Work: Yes, if safe to do so

Write 3rd Party Notification: Yes

Priority= Level 1

Write EC Notification: Yes, if minor work cannot be completed.

FDA= Conductor / Broken / Repair

Priority= Minimum X Tag, depending on exposure.

*Contact Lead/Supervisor for guidance



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

COMMUNICATION LINE EXTREMELY SAGGED



At this Location: Comm sag 6' above the road, off the road, no potential for vehicle contact.



Perform Minor Work: No

Write 3rd Party Utility Notification: Yes

Priority: Level 2

Write EC Notification: No



Job Aid: Overhead Assessment



TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

ABANDONED PHONE DROP

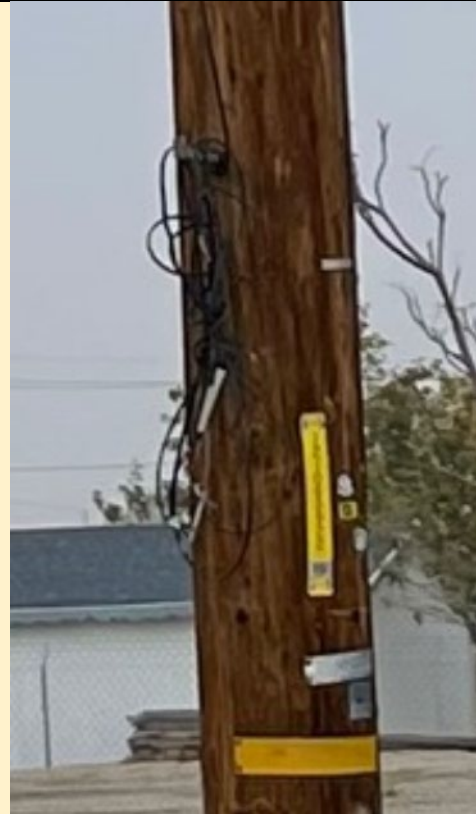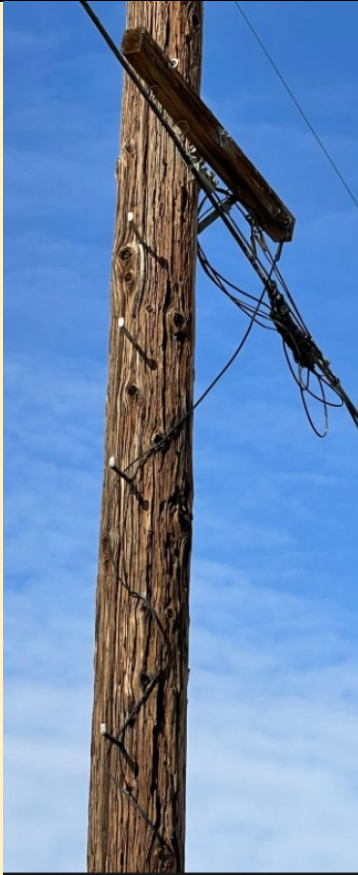

At this Location: Abandoned Phone Drop with potential of public safety exposure.



Perform Minor Work: No

Write 3rd Party Notification: Yes

Priority= Level 3

Write EC Notification: No



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atrch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

Antennas - Third Party Communication

A. Broken/Damaged Cellular Antenna

General Guidance: If the broken antenna is creating a non-emergency safety or reliability issue, create a third-party notification.

If the antenna is causing an emergency safety or reliability issue, contact your supervisor for instructions. Do not leave the location until it is made safe.

Minor Work: No

EC Notification: No

Third Party Notification: Yes

Related Documents: [027911](#)

B. Third Party Communication Antenna - Inadequate Clearance

General Guidance: Create a third-party notification if a cellular antenna does not have adequate clearance from supply lines or equipment.

If the antenna is causing an emergency safety or reliability issue, contact your supervisor for instructions. Do not leave the location until it is made safe.

Minor Work: No

EC Notification: No

Third Party Notification: Yes

Related Documents:

C. Third Party Communication Antenna - Inadequate Clearance

General Guidance: Create a third-party notification if a cellular antenna does not have adequate clearance from supply lines or equipment.

If the antenna is causing an emergency safety or reliability issue, contact your supervisor for instructions. Do not leave the location until it is made safe.

Minor Work: No

EC Notification: No

Third Party Notification: Yes

Related Documents: [027911](#)



Non - Utility

General Guidance: Unauthorized attachment installed on a PG&E pole such as a mailbox, basketball hoops, etc. Prioritize based on risk and exposure.

Note: If the unauthorized attachment causes electrical hazard, or immediate risk to the pole, assign Level 1 priority and contact Supervisor.

Minor Work: Yes, as long as it can be done safely and doesn't create a safety hazard, **DO NOT** remove mirrors on windy roads/driveways, street/stop signs, camera equipment, etc.

EC Notification: No

3rd Party Non-Utility Notification: Yes, comments need to be created and will be attached to the letter to the customer / homeowner.

References: TD-2015P-01



Job Aid: Overhead Assessment


TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

Example

UNAUTHORIZED ATTACHMENT	
	At this Location: Basketball Hoop Installed on a PG&E pole.
	Perform Minor Work: No
	Write 3rd Party Notification: Yes, Level 3 priority.
	Write EC Notification: No




Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

METAL POLE IN FENCE	
	At this Location: Metal attachment on metal structure. Fence can become energized.
	Perform Minor Work: Work with Supervisor to resolve immediate hazard.
	Write 3rd Party Notification: Yes, Level 1 priority.
	Write EC Notification: No



FDA - Distribution OH Facility Damage Action Table

Table 1

Overhead Facility	Damage	Action	Work Type Codes	Default Priority
Anchor	Broken/Damaged	Repair	540	E
		Replace	511/605	E
	Corroded	Repair	540	E
		Replace	511/605	E
	Missing	Install	511	F
	Soil/Eroded/Graded	Adjust	540	F
		Replace	511/605	F
Animal Mitigation	Broken/Damaged	Replace	540	E
	Mitigation Missing	Install	540	E
Bird Protection	Bird Protection Deteriorated	Replace	540	E
		Install		E
Bonding	Broken	Repair		E
	Broken	Replace		E
Booster/Regulator	Broken/Damaged	Repair	540	E
		Replace	511	E
	Burnt	Repair	540	E
	Excessive Operation	Overhaul	466	E
	Leaks/Seeps/Weeps	Clean	540	E
		Repair	540	E
		Replace	540	E
Buddy Pole	Improperly Supported	Repair		E
Capacitor	Broken/Damaged	Repair	540	E
		Replace	511	E
	Burnt	Repair	540	E
		Replace	511	E
	Leaks/Seeps/Weeps	Clean	540	B
		Repair	540	E
		Replace	511	E
CB Pole	Broken/Damaged	Replace	307	F
	Burnt	Replace	307	E
	Decayed/Rotten	Replace	307	F
Climbing Space	Obstructed	Adjust	540	F
Conductor	Broken/Damaged	Repair	540	E
		Replace	511/605	E



		Burnt	Repair	540	E
			Replace	511/605	E
		Clearance Impaired	Adjust	540	E
			Install CI Pole	511	E
			RayChem	540	E
		Floater	Repair	540	E
		Idle Facility	Remove	451	E
		Improper Connection	Adjust	540	E
		Overloaded	Test	540/541	E
		Sag/Clearance	Adjust	540	E
			Install Spreader Bracket	540	E
			Replace	511/605	E
		Loose Lashing	Repair		E
		Broken Splice	Replace		B
		Splice Tied In	Replace		E
Connector		Burnt	Replace	540	E
		Corroded	Repair	540	E
			Replace	540	E
		Incorrectly Installed	Replace	540	E
		Temp Differential	Replace	540	E
Crossarm		Broken/Damaged	Repair	540	E
			Replace	605	E
		Burnt	Repair	540	E
			Replace	605	E
		Decayed/Rotten	Repair	540	E
			Replace	605	E
Cutout		Broken/Damaged	Repair	540	E
			Replace	511	E
		Clearance Impaired	Adjust	540	E
		Flashed	Repair	540	E
			Replace	511	E
Decorative Streetlight		Broken/Damaged	Replace	511/605	E
		Missing	Install	511/605	E
Dead-End Cover (DCOV)		Broken/Damaged	Replace		F
		Broken/Damaged	Repair		F
Fault Indicators		Broken/Damaged	Replace	605/606	E
Fuse		Flashed	Repair		E



	Flashed	Replace		E
	Clearance Impaired	Adjust		E
	Broken	Repair		E
	Broken	Replace		E
Ground	Broken/Damaged	Repair	540	B
		Replace	540	B
	Exposed	Repair	540	F
	Missing	Install	540	E
Guy	Broken/Damaged	Repair	540	E
		Replace	540	E
	Clearance Impaired	Adjust	540	F
	Corroded	Repair	540	E
		Replace	540	E
	Loose	Adjust	540	F
	Missing	Install	540	F
	Overgrown	Trim	540	E
	Strain/Abrasion	Adjust	540	F
		Remove	540	F
Guy Marker	Missing	Install	540	F
		Replace		F
Hardware/Framing	Bird Prot. Required	Install	617	E
	Birdcage	Install		E
	Broken/Damaged	Repair	540	E
		Replace	540	E
		Remove		E
	Loose	Adjust	540	E
	Missing	Install	540	E
High Sign	Missing	Install	540	F
	Broken	Replace		F
Insulator	Broken/Damaged	Replace	540	E
	Flashed	Replace	540	E
	Primary Squatter	Repair	540	E
		Replace	540/605	E
	Secondary Squatter	Repair	540	E
		Replace	540/605	E
Jumper	Burnt	Replace	540	E
	Clearance Impaired	Adjust	540	E
		Replace		E
LAPP Insulator	Broken/Damaged	Replace	605	E
Lightning Arrester	Broken/Damaged	Repair		E



			Replace	540/605	E
		Flashed	Repair		E
			Replace	540/605	E
Marking	Broken/Damaged		Replace	540	F
	Missing		Install	540/676	F
Molding	Broken/Damaged		Repair	540	F
			Replace	540	F
	Loose		Adjust	540	F
	Missing		Install	540	F
OH Facility	Bird Prot. Required		Install	516/524/617	E
	Customer Related		Access	540	B
			Appointment	540	B
			Refusal	540	B
	Graffiti		Paint	540	E
	Idle Facilities		De-Energ	540	E
			Remove	451/540	F
			Transfer	540	F
	Limited Access		Inspect	540	B
			Patrol	540	E
			Remove	540	E
	Obstructed		Inspect	540	B
			Remove	540	E
			Replace		B
	Transmission Issue		Create LC	540	B
	Bird Nest		Remove		E
Operating Number	Broken/Damaged		Replace		E
	Missing		Install		E
Pole	Broken/Damaged		Pole Stub	540	E
			Re-Frame	605	E
			Repair	540	E
			Replace	311/511	E
	Burnt		Pole Stub	540	E
			Repair	540	E
			Replace	311	E
	Clearance Impaired		Repair	540	E
			Replace	511	E
	Decayed/Rotten		Pole Stub	540	E
			Pole Top Repair	540	E
			Repair	540	E
			Replace	311/511	E



	Idle Facilities	Remove		F
	Leaning	Adjust	540	E
		Replace	511	E
	No Safe Access	Inspect	540	B
	Overloaded	Replace	311	E
		Test	582	E
	Woodpecker Damage	Assessment	540	E
	Woodpecker Damage	Repair		E
	Woodpecker Damage	Replace		E
Soil Eroded	Replace		E	
Pole Step	Clearance Impaired	Remove	540	F
Recloser/Sectionalizer	Broken/Damaged	Repair	540	E
		Replace	511	E
	Excessive Operation	Overhaul	466	E
	Flashed	Repair	540	E
		Replace	511	E
	Leaks/Seeps/Weeps	Clean	540	E
		Repair	540	E
Replace		511	E	
Relinquished Pole	Decayed / Rotten	Remove		E
Riser/Pothead	Broken/Damaged	Repair	540	E
		Replace	540	F
	Flashed	Repair	540	E
		Replace	540	F
	Installed in Error	Relocate		E
Road	No safe access to pole	Repair	540	B
RTVI	Interference	Repair	540	E
		Replace	605	E
SCADA/PDAC	Broken/Damaged	Repair	540	F
		Replace	540	F
	Leaks/Seeps/Weeps	Repair	540	F
		Replace	511	F
		Test	540	B
Secondary Service Conductor (SEC SVC Conductor)	Splice Installed	Replace		F
Steel Lattice Pole	Guarding Missing	Install	540	E
Steel Lattice Tower	Broken/Damaged	Replace	311L	E



Overhead Assessment

Rev: 14

Streetlight	Broken/Damaged	Repair	540	E
		Replace	605	E
	Missing	Install	605	E
Switch	Broken/Damaged	Repair	540	E
		Replace	611	E
Tree Wire	Exposed	Repair		F
Tie Wire	Broken/Damaged	Replace	540	E
	Loose	Replace	540	E
	Improperly Installed	Replace		E
	Corroded	Replace		E
Trans_Dist Pole	Bridging Broken	Repair	979	E
	Bridging Missing	Install		E
Transformer	Broken/Damaged	Repair	540	E
		Replace	511	F
	Corroded	Replace	511	E
	Flashed	Repair	540	E
		Replace	511	E
	Idle Facilities	Remove	451	F
	Leaks/Seeps/Weeps	Clean	540	B
		Repair	540	F
		Replace	511	E
		Re-Check		B
	No Common Neutral	Relocate	540	E
	Overloaded	Test	540	E
	Parallel	Replace	511	E
Tree/Vine	Clearance Impaired	Remove	540	E
		Trim	540	E
	Decayed/Rotten	Install CI Pole	311	E
	Overgrown	Remove	540	E
		Trim	540	E
Trip Saver	Broken/Damaged	Repair	540	E
		Replace	605	E
Under-Arm Bus	Broken/Damaged	Repair	540	F
Vis-Strips	Broken/Damaged	Replace		F



2025 Change log for OH Job Aid

Section	2024 Page Number	2023 Page Number	Change
Introduction	5	5	Added verbiage to supporting ability to change priority of EC tag
Use of Priority X Tag	6	6	Added section title "use of priority x tag"
Requirement for Minor Work	10	10	Reorganized FDA, removed month timeline for B Tag
Leaning Pole - Examples	N/A	29	Added example: Stubbed Pole Does not need repair
Cross Section or Horizontal Crack	31	29	Added verbiage regarding long text for EC notification
Cross Section or Horizontal Crack	31	29	Updated Process Flow
Cross Section or Horizontal Crack	35	33	Updated example details: Significant Arc Length Damage (Tractor Damage)
Woodpecker	55	52	Updated Process Flow
Woodpecker	N/A	53	Added example: Pole Cross Section Distance Example
Woodpecker	60	54	Updated example details: Woodpecker Damage 1-3 example 1.
Intumescent Pole Covers	73	67	Updated example details: Damaged Intumescent Pole Wrap
Tree Attachments "Found in Field Procedure"	75	69	Updated Section
Oil Filled Equipment	81	78	Updated: Spill Matrix tables and link to standard
Corrosion	85	84	Updated example details: Transformer Corrosion
Corrosion	N/A	85	Added Example: Transformer Not Corroded
Corrosion	88	86	Updated example details: Transformer Internal Fault Device Activated
Corrosion	N/A	86	Added Section: Shipping Lock Present on Transformer
Switch Handle/Control Box is Not Locked	93	91	Added FDA
Loose Hardware	95	92	Updated: General Guidance
Loose Hardware	95	92	Added example: Missing Hardware Impacting Integrity



Bare Primary & Secondary Conductor	96	94	Updated: General guidance to include "necking of conductor"
Bare Primary & Secondary Conductor	N/A	95	Added examples: Necking of Conductor
Bare Primary & Secondary Conductor - Part 1 - Category 2	100	100	Added Note: Exposed primary covered conductor tree wire, burnt conductor example
Bare Primary & Secondary Conductor - Part 1 - Category 2	105	106	Updated general guidance - (A tag; X tag; B tag; No tag)
Bare Primary & Secondary Conductor - Part 1 - Category 2	106	106	Updated Process Flow - included automatic dead-end & Yes = A tag
Bare Primary & Secondary Conductor - Part 1 - Category 2	106	107	Updated example details: Damaged, Corroded, cracked splices or automatic dead-ends.
Bare Primary & Secondary Conductor - Part 1 - Category 2	N/A	108	Added new examples
Bare Primary & Secondary Conductor - Part 1 - Category 2- G.	107	111	Add new example: Connector with deteriorated tape
Bare Primary & Secondary Conductor - Part 1 - Category 4 - L.	115	117	Updated Process flow
Bare Primary & Secondary Conductor - Part 1 - Category 4 - M	117	119	Updated general guidance.
Bare Primary & Secondary Conductor - Part 1 - Category 4 - M	117	119	Updated example details: Aluminum over copper
Bare Primary & Secondary Conductor - Part 1 - Category 4 - N.	N/A	120	Added example: Spiral Dampener
Bare Primary & Secondary Conductor - Part 2 - Category 6 - T.	130	132	Updated example details - Floater - Conductor touching crossarm
Bare Primary & Secondary Conductor - Part 2 - Category 6 - T.	N/A	133	Added example: Common neutral floater
Bare Primary & Secondary Conductor - Part 2 - Category 7 - W.	140	139	Updated: Guidance



Bare Primary & Secondary Conductor - Part 2 - Category 7 - X.	142	141	Updated process flow
Service Conductor - Category 1	144	143	Updated: General guidance
Service Conductor - Category 1. E	151	149	Updated verbiage added to process flow
Service Conductor - Category 1. E	151	149	Updated example details: Exposed Service Connector
Service Conductor - Category 1. E	152	150	Updated example details: Exposed Conductor
Service Conductor - Category 1. E	153	150	Updated example details: Exposed Conductor
Service Conductor - Category 1. E	N/A	151	Added new example: Insulation deteriorated
Service Conductor - Category 3 - I.	157	156	Updated Process flow verbiage
Framing - Crossarm Broken/Deteriorated	N/A	181	Added new example: Crossarm does not need replacement
Framing - Crossarm Broken/Deteriorated	N/A	182	Added new examples
Insulators - Damaged Insulators	193	189	Updated General guidance
Insulators - Damaged Insulators	194	N/A	Removed Example: Contaminated Insulator
Insulators - Damaged Insulators	N/A	193	Added new example: Contaminated insulator
Insulators - Cotter Key	199	195	Updated: General Guidance updated
Insulators - Cotter Key	N/A	196	Added examples: Pin fully seated/cotter key partially backed out
Insulators - Cotter Key	201	197	Updated example details: Retainer Pin Coming Loose, almost pulled out.
Insulators - Cotter Key	N/A	198-199	Added new examples
Fuses - Liquid Fuses	204	202-203	Updated general guidance.
Fuses - Open Fuse Latches	N/A	203	Added section and general guidance
Fuses	205	204	Updated example details: Part 63 & Part 44/75
Guys/Anchors - Down Guy Preform Buried	210	209	Updated example details: Buried Anchor
Guys/Anchors - Down Guy Preform Buried	212	210	Updated example details: Anchor Covered by Concrete



Guys/Anchors - Down Guy Preform Buried	N/A	210	Added new example - anchor
Guys/Anchors - Down Guy Preform Buried	213	212	Updated example details: Anchor Buried by Vegetation
Guys/Anchors - Down Guys Grounded Above Guy Insulator	224	223	Updated example details.
Guys/Anchors - Down Guys Grounded Above Guy Insulator	225	224	Updated example details.
Grounds/Ground Marking - Exposed Ground Below 8'	231	230	Updated example details: Exposed Ground
Grounds/Ground Marking - Exposed Ground Below 8'	N/A	232	Added new example: Exposed Ground
Markings - High Voltage Signs Not Installed as required	242	239	Updated general guidance
Markings - High Voltage Signs Requirements	243	239	Updated guidance
Markings - High Voltage Signs Requirements	245	241	Updated example details: Broken High Sign
Markings - Operating Number Incorrect/illegible/missing	246	242	Added Note in General Guidance
Markings - Operating Number Incorrect/illegible/missing	248	244	Updated example details: Fading Operating Number
Markings - Damaged or Missing Visibility Strips on Poles/Guy Markers	249	245	Updated "Reminders" bullets 7 and 8.
Wildlife Protection - Existing Migratory Bird Protection Damaged	259	255	Updated example details (FDA): Bird Nest on Transformer
Wildlife Protection - Existing Migratory Bird Protection Damaged	260	256	Updated example details (FDA): Broken Insulator Covers
Riser Molding - U-Shape Riser	263	259	Updated example details: Broken Riser
Riser Molding - U-Shape Riser	N/A	260	Added new example: Broken Riser
Trees - Trees within 4ft of Primary	267	262	Updated example details: Small Branches & Long Tree Bark



Job Aid: Overhead Assessment

TD- 2305M-JA02

WMP-Discovery2023-2025 DR SPD 024-Q003Atch02

Publication: 01/06/2025 Effective: 01/14/2025

Rev: 14

Trees -Trees Causing Strain or Abrasion to Secondary	268	264	Updated: General guidance (for service drops).
Idle Facilities - Energized Electric Line Facility No Longer Used to Serve Customers	274	272	Updated: General guidance
Idle Facilities - Abandoned Pole Butt	280	275	Updated example details: Abandoned Pole Butt - Hollowed Out
3rd Party Utility Cable, phone and other	282	278	Updated example details (FDA): 3rd party cable loose lashing long enough to whip
FDA - Distribution OH Facility Damage Action Table	290-295	285-290	Added Column: Work Type Codes