



Job Aid: Overhead Inspection

Summary

This job aid is designed to assist Electric Distribution Compliance Inspectors in assessing and prioritizing **compelling abnormal conditions** on overhead facilities during scheduled GO 165 Inspections.

It is meant to provide guidance on issues that Inspectors may encounter most frequently during an inspection and is not intended to be an all-inclusive listing of all abnormal conditions or corrective actions.

Field assessments are activities performed by Inspectors to identify Compelling Abnormal Conditions.

Compelling Abnormal Condition is defined as being any electric distribution pole, equipment, component, conductors, vegetation, or third-party condition that cause a safety or fire ignition risk that may adversely impact public safety and/or service reliability in the next five (5) years.

Overhead Job Aid Training

- **Refresher Training** The Annual Refresher Training program is designed for PG&E's Compliance Inspectors who conducted detailed inspections in the previous year. Content includes explanations of changes to the annual inspection program, mobile applications, and the checklist. A review of this Job Aid is included in this course.
- **New Inspector Training** The New Inspector Training program is a 3-day training program designed for new Compliance Inspectors and Canus contractors who may be assigned Electric Distribution GO165 Overhead/Underground inspection and patrol work. A review of this Job Aid is included in this course.
- **New Contractor Training** The New Contractor Training program is a 3-day training program, followed by an assessment day plus a 2 day in-the-field-training. It is designed for new contractors who will be assigned Electric Distribution GO165 Overhead inspection work. A review of this Job Aid is included in this course.

Target Audience

- Qualified Electrical Workers (QEW)

Before You Start

- Follow all applicable safety rules, procedures, and protocols.
- Wear appropriate personal protective equipment (PPE) for specific tasks and work area.

Table of Contents

2022 Detailed Overhead Inspection Checklist	5
1. Asset Details – Displays asset data	5
2. Access & Confirmations	5
3. Structure	6
4. Conductor	9
5. Equipment	10
6. Anchor & Guys	11
7. Hardware Framing.....	12
8. Vegetation	13
9. Other Required Data.....	14
10. Attach Photos	15
11. Declarations.....	16
Antennas - Third Party Communication	17
1. Broken/Damaged Cellular Antenna	17
2. Third Party Communication Antenna - Inadequate Clearance.....	17
Climbing Space	18
1. Climbing Space - Obstructed	18
2. Climbing Space – Obstructed by Vegetation	19
Conductor	21
1. Conductor Broken/Damaged.....	21
2. Connector Broken/Damaged.....	35
3. Tie Wire Damaged.....	37
4. Floaters	38
5. Broken or Unsecured Service Bob.....	39
6. Conductor Clearances (Refer to Clearance Job Aid)	39
7. Conductor: Uneven, Improper Sag or Diminished Clearance.....	39
Cutouts / Fuses / Switches	41
1. Damaged Arcing Horns	41
2. Cutouts	42
3. Jumpers	43
4. Switch Handle/Control Box is not Locked	43
Distribution Towers / Steel Lattice.....	44

Framing	44
1. Crossarm Broken/Deteriorated	44
2. Bridging Exists and Needs to be Repaired.....	44
3. Underarm Bus Not Securely Attached	45
4. Wood Pin Burnt/Tracking or Broken	47
Grounds / Ground Molding	49
1. Exposed Ground below 8'	49
2. Exposed Ground above 8' to the Communication Level	51
3. Ground Molding Unsecured/Loose	52
4. Exposed Ground Rod	54
5. Broken Ground	55
Guys / Anchors	55
1. Down Guy Preform Buried	55
2. Visible Portion of Anchor Rod has Significant Corrosion	59
3. Guy Broken/Slack	60
4. Guy Insulator Broken/Missing	64
5. Down Guy Grounded above Guy Insulator (vegetation or other)	65
6. Down Guy Marker Missing/Damaged	66
Idle Facilities	68
1. Identifying and Documenting Idle Facilities	68
2. Energized Electric Line Facility No Longer Used to Serve Customer Load	71
3. De-Energized Electric Line Facility Already Identified on a Pending EC Notification but Not Mapped.....	71
Insulators	72
1. Arcing or Tracking on Insulators	72
2. Damaged Insulators	72
3. Squatters – Primary or Secondary	76
4. Flying Bells.....	78
Lightning / Surge Arrestors	79
1. Broken or Flashed	79
Markings.....	80
1. High Voltage Sign Not Installed as Required	80
2. Operating Number Incorrect / Illegible/ Missing	83
3. Damaged or Missing Visibility Strips on Poles/Guy Markers	85
Oil-filled Equipment	88
1. Equipment Oil: Leaking/Weeping Stain	88
2. Corrosion	90
3. Transformer – Blue Sticker.....	92
4. Transformer – Parallel	93

Poles	95
1. Solely-Owned Poles with Third-Party Attachments	95
2. Broken, Deteriorated, Deformed Poles	95
3. Leaning Pole	105
4. Deformed Pole	108
5. Soil Excessively Eroded or Washed Away at Base of Pole	110
6. Pole Steps.....	111
7. Mud sill	111
8. Transmission Poles	112
9. Transmission Pole with Distribution Underbuild.....	113
Riser Molding.....	116
1. Broken/Missing Riser Ground	116
2. U-Shape Riser Molding Broken/Damaged or Unsecured	116
SmartMeter/SCADA Equipment/Other Equipment on Poles	117
1. Broken/Damaged SmartMeter Relay/Access Point/Data Collector Unit or SCADA Equipment	117
Streetlights.....	118
1. Broken or Damaged Streetlight Pole.....	118
2. Day Burner.....	119
3. Missing Streetlight.....	119
Trees.....	120
1. Trees within 4 Feet of a Primary Line	120
2. Tree Attachments	120
3. Trees Causing Strain or Abrasion to a Secondary Conductor or Service.....	120
Wildlife Protection	122
1. Existing Migratory Bird Protection Damaged	122
2. Existing Wildlife Protection Damaged	123
 Clearance Evaluation Job Aid	 124
 Crossarm Evaluation Job Aid.....	 133

2022 Detailed Overhead Inspection Checklist

1. Asset Details – Displays asset data

2. Access & Confirmations

Use this section to (a) select the role for which you are performing the inspection work, (b) indicate if gained access to the inspection location, (c) confirm you achieved a visual 360-degree inspection of the structure, and (d) confirm you achieved a visual 360-degree inspection of this structure's conductors.

Access & Confirmations

In what role are you performing this work?

GO165 Compliance Inspector

Did you gain access to the structure?

Yes No

Is this asset approved for an inspection?

Approved assets are as follows:

- (1) Distribution Pole/Tower
- (2) Transmission Pole with Distribution Under-Build (steel or wood)
- (3) Idle Pole
- (4) Streetlight on Distribution Pole
- (5) Tree Connect

Yes No

Did you perform a visual 360-degree inspection of this structure?

Yes No

Did you perform a visual inspection of all associated conductor(s) from structure to mid-span in all directions or to the weather-head or to the termination point?

Yes No

3. Structure

All Compliance Inspectors are required to apply pole number tags (barcodes) to distribution structures with missing or damaged pole number tags and to document that activity using the checklist. The checklist provides a safety reason when this requirement cannot be performed during a detailed inspection.

Use this section to identify compelling abnormal conditions related to the structure.

Structure

Select type of structure

Distribution Pole

Transmission with Distribution Underbuild

Distribution Pole with Streetlight Luminaire

Tree Connect

3.1 Distribution Pole

Structure

Select type of structure

Distribution Pole

Barcode

Is there a pole number on this structure?

Yes

No

Structure (Distribution Pole)

☐ Pole broken, damaged, burnt, deformed, corroded, gunshot, or showing signs of cracking, rotten or decay

☐ Pole leaning or out of plumb by more than 10% of its height above the ground

☐ Wood pole failed the hammer test

☐ Select if there are risks, hazards or other maintenance conditions not previously captured in the checklist above for the pole

No structure damage or compelling abnormal conditions to report

3.2 Transmission with Distribution Underbuild

Structure	Structure
Select type of structure <div>Transmission with Distribution Underbuild</div>	Select type of structure <div>Transmission with Distribution Underbuild</div>
What kind of transmission structure is present? <div>Steel Transmission Structure</div>	What kind of transmission structure is present? <div>Non-Steel Transmission Structure</div>
Structure (Transmission with Distribution Underbuild - Steel)	Structure (Transmission with Distribution Underbuild - Non-Steel)
<input type="checkbox"/> Pole broken, damaged, burnt, deformed, corroded, gunshot, or showing signs of cracking, rotten or decay	<input type="checkbox"/> Pole broken, damaged, burnt, deformed, corroded, gunshot, or showing signs of cracking, rotten or decay
<input type="checkbox"/> Pole leaning or out of plumb by more than 10% of its height above the ground	<input type="checkbox"/> Pole leaning or out of plumb by more than 10% of its height above the ground
<input type="checkbox"/> Distribution Riser on Structure	<input type="checkbox"/> Missing or broken distribution bridging or bonding
<input type="checkbox"/> Distribution transformer serving an external customer installed without a common neutral present	<input type="checkbox"/> Wood pole failed the hammer test
<input type="checkbox"/> Missing or broken distribution bridging or bonding	<input type="checkbox"/> Select if there are risks, hazards or other maintenance conditions not previously captured in the checklist above for the pole
<input type="checkbox"/> Select if there are risks, hazards or other maintenance conditions not previously captured in the checklist above for the pole	
<div>No Structure damage or compelling abnormal conditions to report</div>	<div>No structure damage or compelling abnormal conditions to report</div>

3.3 Distribution Pole with Streetlight Luminaire

Structure
Select type of structure <div>Distribution Pole with Streetlight Luminaire</div>
Barcode <div></div>
Structure (Streetlight)
<input type="checkbox"/> Pole broken, damaged, burnt, deformed, corroded, gunshot, or showing signs of cracking, rotten or decay
<input type="checkbox"/> Pole leaning or out of plumb by more than 10% of its height above the ground
<input type="checkbox"/> Streetlight luminaire is broken, damaged, leaning or corroded
<input type="checkbox"/> Climbing space obstructed
<input type="checkbox"/> Select if there are risks, hazards or other maintenance conditions not previously captured in the checklist above for the pole
<div>No structure damage or compelling abnormal conditions to report</div>

3.4 Tree Connect

Structure

Select type of structure

Tree Connect

Select one option for the current field condition, then create the required notification

Tree is in good condition. Tree is green.

Tree is NOT in good condition; non-emergency compelling conditions, hazards, or risks are present. Tree may be dead, dying or green.

An immediate emergency hazard exists. Tree may be dead, dying or green.

Tree condition cannot be adequately assessed.

4. Conductor

Use this section to identify compelling abnormal conditions related to conductors.

Conductor

Does this structure have PG&E owned conductor?

Yes

No

Provide Comments about wire configuration (i.e. Line & Buck, 4-way corner, tangent, etc.)

Conductor Issues

☐ Primary, secondary, and/or service conductors broken, damaged, burnt, corroded, loose, frayed or bird caging

☐ Conductor has splices tied in proximity to insulator preventing free movement of splice with conductor

☐ Primary or secondary conductor has diminished clearance mid span or uneven conductor sag

☐ Open wire secondary conductor with rack construction has missing spreader brackets for spans > 135'

☐ Hand or preform tie wire broken, damaged, burnt, loose, showing signs of wearing, missing, or missing armor rod

☐ Jumper burnt or jumper clearance issues

☐ Service conductor has diminished clearance

☐ Select if there are risks, hazards or other maintenance conditions not previously captured in the checklist for this conductor

No Conductor damage or compelling abnormal conditions to report

5. Equipment

Use this section to identify compelling abnormal conditions related to transformers, other equipment and Critical Operating Equipment (COE) field conditions.

Equipment

Does this structure have PG&E equipment?

Yes

No

Transformers

☐ Transformer/line protection cutouts broken, damaged, cracked, loose, or flashed

☐ Transformer flashed or corroded, e.g. integrity of the metal is breached – holes in metal, cover not securable, metal is damaged, separation, layering, or bubbling

☐ Transformer shows signs of leaking, seeping, or weeping oil

☐ Transformer has cracked or broken bushings

☐ Internal Fault Device has activated (overheated) on the transformer (orange band is visible)

☐ Obvious paralleled transformer condition at this location

☐ Select if there are risks, hazards or other maintenance conditions not previously captured in the checklist above for the equipment

No equipment damage or compelling abnormal conditions to report (Transformers)

Other Equipment

☐ Lightning arresters broken, damaged, flashed, or the ground lead disconnect activated

☐ Other equipment leaking/seeping/weeping oil or corroded

☐ Radial/EOL (End-Of-Line) configuration riser/pothead broken, damaged, loose, or flashed

☐ Select if there are risks, hazards or other maintenance conditions not previously captured in the checklist above for the equipment

No equipment damage or compelling abnormal conditions to report (Other Equipment Issues)

Follow the Critical Equipment (COE) Process

☐ Line protection cutouts for loop configurations broken, damaged, cracked, loose, or flashed

☐ The critical operating equipment has visible signs of rust, corrosion, cracking, arcing, tracking, contamination, or damaged components

☐ Loop configuration riser/pothead broken, damaged, loose, or flashed

No equipment damage or compelling abnormal conditions to report (Critical Equipment)

6. Anchor & Guys

Use this section to identify compelling abnormal conditions related to anchor and guys.

Anchor & Guys

Does or should this location have a Guy?

Yes

No

Anchor & Guys Issues

☐ Necessary guys missing or loose

☐ Guy wire broken, damaged, clearance issues, corroded, covered by vegetation, overgrown, strain or abrasion

☐ Guy bob or strain insulator (aka "Fish Stick") broken or missing

☐ Anchor rod broken, damaged, corroded, covered by vegetation/overgrown, soil-eroded, graded, or buried

☐ Select if there are risks, hazards, or other maintenance conditions not previously captured in the checklist for Anchor & Guys section

No Anchor/Guy damage or compelling abnormal conditions to report

7. Hardware Framing

Use this section to identify compelling abnormal conditions related to hardware and framing issues.

Hardware Framing

Is hardware framing present on this structure?

☒ Yes ☐ No

Hardware Framing Issues

- ☐ Secondary connectors (mini wedge and Insulink) installed on primary conductor
- ☐ Tap clamps installed incorrectly
- ☐ Connector connections made with dissimilar metals installed incorrectly
- ☐ Connector(s) excessively corroded or damaged (potential to drop conductor)
- ☐ Crossarm integrity compromised by any of the following; damaged, broken, burnt, decayed, rotten, loose, missing hardware or showing severe signs of bent bolts or brackets, damaged bracing, gun shots, insect damage or woodpecker damage, splitting, or fails to meet clearance requirements
- ☐ Crossarm bridging is missing or needs to be repaired
- ☐ Animal mitigation broken, damaged, or missing (if required)
- ☐ Bird protection broken, damaged, deteriorated, or missing (if required)
- ☐ Steel lattice tower guard missing
- ☐ Molding missing, broken, damaged, or loose
- ☐ Insulators or king pin chipped, cracked, corroded, contaminated, flashed, have signs of tracking, broken or damaged
- ☐ Insulators or conductor squatting or floating
- ☐ Grounds exposed, broken, damaged, disconnected, unsecured, or missing (if required)
- ☐ Select if there are risks, hazards or other maintenance conditions not previously captured in the checklist for hardware framing at this location

☐ No hardware framing damage or compelling abnormal conditions to report

8. Vegetation

Use this section to identify compelling abnormal conditions related to vegetation issues.

The screenshot shows a mobile application interface for a checklist. At the top, the status bar shows 8:44 AM, Tue Jan 11, and 59% battery. The app title is "100926650 2022 OH Checklist" with a "Close" button. The "Vegetation" section is expanded, showing two sub-sections: "Vegetation - EC Specific Notifications" and "Vegetation - Vegetation Specific Notifications". Each sub-section has a list of checkboxes and a summary button.

Vegetation

Vegetation - EC Specific Notifications

- ☐ Tree causing strain or abrasion to single-service service drop (open-wire/triplex/quadplex)
- ☐ Structure, climbing space, or equipment is overgrown with vegetation
- ☐ Down guy above insulator is overgrown with vegetation and needs trimming
- ☐ Open-wire Secondary or Open-wire Service Conductor(s) are overgrown with vegetation (no strain or abrasion present)

No vegetation issues or compelling abnormal conditions to report for the EC in accordance with GO165

Vegetation - Vegetation Specific Notifications

- ☐ Tree causing strain or abrasion to secondary (open-wire, rack or AWAC feeding more than one service OR open-wire secondary between two primary poles)
- ☐ Trees/Branches aloft are dead or broken and can strike facilities (structure and/or conductor)
- ☐ Distribution facility/pole located in Local Responsibility Area (LRA) with vegetation within 18" of primary conductor or PG&E equipment

No vegetation issues or compelling abnormal conditions to report for the EC in accordance with GO95, PRC 4292, PRC 4293

Save as Draft Review Inspection Details

The items in this sub-section change based upon High Fire Threat District and Fire Seasons

9. Other Required Data

Use this section to provide specific field information which will be used by PG&E's Asset Strategy team to build improvements in PG&E's asset management program. Below are the 2022 topics that require field information from every compliance inspector while performing a Detailed Overhead Inspection.

This section, like all other sections, is required when the checklist item is observed in the field.

Other Required Data

Other Required Data Items

☐ Tree anchor installed in tree by design

☐ Open wire service (to weatherhead) or open wire secondary at this location

☐ Transformer is suspect of having PCB (guidance: look for blue sticker or indicator for no PCB)

☐ Pole wrapped at ground-line at this location

☐ 3 or more primary splices present in one phase of the span

☐ Non-exempt equipment present at the inspection location

- (1) Universal or open link fuse
- (2) Solid blade or in-line disconnect
- (3) Lightning or surge arrestor
- (4) Hot tap clamp or split bolt connector
- (5) Switch (grasshopper)
- (6) Other

☐ Additional inspector comments

☐ Support structure or stub present


No other required data items to report

10. Attach Photos


Use this section to attach all mandatory inspection photos.

Attach Photos


Attach 2 photos of the entire pole from 2 locations

 Attach Photos


Attach photo of the top 1/3 of the pole

 Attach Photos

Attach photo of the middle 1/3 of the pole

 Attach Photos

Attach photo of the bottom 1/3 of the pole

 Attach Photos

Mandatory Photo Requirements: Reference material shown below originates from GOV-1038S and has been adjusted in ELEC-1000-B and ELEC-0314 Process Training. It is enforced within the iOS Inspect Application, Detailed Inspection Overhead Checklist.

Mandatory Requirements / Photo requirements

- (1) Attach 2 Photos of the entire pole from 2 locations
 - Take the first photo showing the entire pole (top to bottom) and the structure's surrounding environment.
 - Take the second photo while standing at the different location. This location should be approximately 90° or more from the 1st photo's location. The second photo must show the entire pole (top to bottom) and the structure's surrounding environment.
 - The photos must show equipment, third-party attachments, ground molding, guys and anchors, if any.
- (2) Attach Photo of the top 1/3 of the pole
 - Take one photo showing the top 1/3 of the pole including equipment, if any.
- (3) Attach Photo of the middle 1/3 of the pole
 - Take one photo showing the middle 1/3 of the pole including third-party attachments, if any.
- (4) Attach Photo of the bottom 1/3 of the pole
 - Take one photo showing the base of the pole meeting the soil, cement, etc.
 - The photo should include guys and anchors, if any.

Failure to comply with these requirements mean that the inspection is invalid and would have to be reinspected.

11. Declarations

Use this section to identify field conditions that are reported on the following forms:

- Idle Facility
- Minor Work
- Third-Party Utility
- Third-Party Non-Utility
- Raptor Program
- PG&E Transmission Line
- Map Corrections

Declarations

Declaration Items

☐ Observed an idle facility

☐ Minor work performed at this location

☐ Third party utility infraction at this location

☐ Third party non-utility infraction at this location

☐ Observed dead or dying raptor at this location

☐ Observed a transmission issue on a transmission structure with distribution underbuild

☐ Location requires a map correction

No declarations items to report

Antennas - Third Party Communication

1. Broken/Damaged Cellular Antenna

General Guidance: If the broken antenna is creating a non-emergency safety or reliability issue, create a third-party notification.

If the antenna is causing an emergency safety or reliability issue, contact your supervisor for instructions. Do not leave the location until it is made safe.

Minor Work: No

Related Documents: 027911

2. Third Party Communication Antenna - Inadequate Clearance

General Guidance: Create a third-party notification if a cellular antenna does not have adequate clearance from supply lines or equipment.

If the antenna is causing an emergency safety or reliability issue, contact your supervisor for instructions. Do not leave the location until it is made safe.

Minor Work: No

Related Documents: 027911, T&D Bulletin 2009-20

Climbing Space

1. Climbing Space - Obstructed

General Guidance: Evaluate pole to determine whether there is an obstruction caused by PG&E facilities or by third party facilities that is causing a compelling safety issue – based on the location of the pole and exposure to the worker - that needs to be addressed in 5 years.

Example: Equipment pole that cannot be accessed in a bucket truck.

Example: Pole in rear easement with secondary or service connection failures.

Example where the climbing space **is not** a compelling condition: Equipment pole that is accessible 100% of the time in a bucket.

For PG&E obstructions: Create an EC notification.

For third party obstructions: Create a third-party notification if they pose a significant safety hazard.

If a third-party obstruction is causing an emergency safety or reliability issue, contact your supervisor for instructions.

Minor Work: No

EC Form: Yes, if not able to perform minor work

- Select the Priority and Due Date based upon compelling abnormal condition that may adversely impact public safety and/or service reliability in the next five (5) years.

Related Documents: 066210

COMMUNICATION IN CLIMBING SPACE




At this Location: Obstructed climbing space, access via bucket truck from street below. Also, look for clearance issues between communications facilities and the PG&E down guys.

Perform Minor Work: No

Write Third Party Notification: No

Write EC Form: No

CLIMBING SPACE OBSTRUCTED

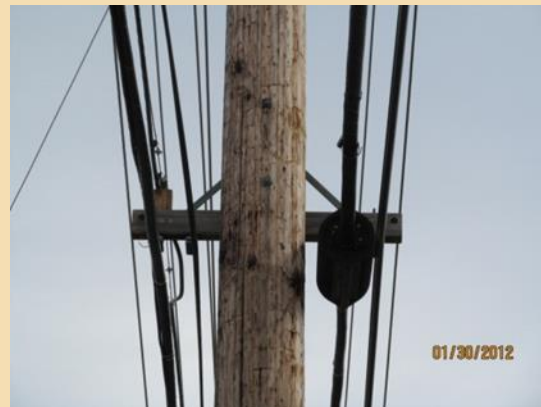

At this Location: Climbing space obstruction by communication facilities on pole with equipment. Communication messengers are too close. No bucket truck access.

Perform Minor Work: No

Write Third Party Notification: Yes

Write EC Form: No

2. Climbing Space – Obstructed by Vegetation

General Guidance: For incidental vegetation in climbing space that can be moved when climbing, or quickly cleared prior to climbing, no action is required.

For major vegetation that cannot be quickly cleared or moved prior to climbing, evaluate the pole:

- Is there supply equipment on the pole that may need to be operated during emergency conditions?
- Should the obstruction be cleared for any other safety or reliability reason in the veg

If the answer is yes to any of these questions, the inspector will need to create an EC Notification to clear vegetation unless it can be addressed as minor work.

Minor Work: Yes

EC Form: Yes, if not able to perform minor work

- Select the Priority and Due Date based upon compelling abnormal condition that may adversely impact public safety and/or service reliability in the next five (5) years.

Related Documents: 066210

OBSTRUCTED CLIMBING SPACE	CLIMBING SPACE OBSTRUCTED
 <p>At this Location: Obstructed climbing space. Inspector cannot see enough of the pole to complete Inspection (heavy vegetation, cannot see through) No equipment on pole. The only reason to address is to complete the inspection.</p> <hr/> <p>Perform Minor Work: No</p> <hr/> <p>Write Third-Party Notification: No, only need clearing to perform inspection</p> <hr/> <p>Write EC Form: Yes</p> <ul style="list-style-type: none"> • FDA=OH Facility / Limited Access/Obstruct / Inspect (Primary) • FDA=OH Facility / Limited Access/Obstruct / Remove • Priority "B", 0-3 months depending upon exposure; must complete before CPUC due date for map 	 <p>At this Location: Climbing space obstruction, able to perform inspection, no equipment on pole (able to see guys, able to see up the pole under tree)</p> <hr/> <p>Perform Minor Work: No</p> <hr/> <p>Write Third Party: No</p> <hr/> <p>Write EC: No, not compelling</p>

POLE WITH VEGETATION



At this Location: 360° pole inspection not possible

Perform Minor Work: No

Write Third-Party Notification: No

Write EC Form: Yes

- FDA= OH Facility / Limited Access/Obstruct / Inspect (Primary)
- FDA=OH Facility / Limited Access/Obstruct / Remove
- Priority "B", 0-3 months depending upon exposure; must complete before CPUC due date for map

IVY COVERED POLE



At this Location: 360° pole inspection not possible

Perform Minor Work: No

Write Third-Party Notification: No

Write EC Form: Yes

- FDA= OH Facility / Limited Access/Obstruct / Inspect (Primary)
- FDA=OH Facility / Limited Access/Obstruct / Remove
- Priority "B", 0-3 months depending upon exposure; must complete before CPUC due date for map

Conductor

1. Conductor Broken/Damaged

General Guidance:

2022 Detailed Inspection Checklist Content

Visually check all conductors (primary/secondary/service), associated attachments and dead-ends for damage from the structure being inspected to mid-span in all directions or the weather-head or to the conductor's termination point. [Refer to GOV-1038S]

1 of 8: Primary, secondary, and/or service conductors that are broken, damaged, burnt, corroded, loose, frayed or bird caging. Guidance: If observed, create EC Notification to replace the conductor.

2 of 8: Conductor has splices tied in proximity to insulator preventing free movement of splice with conductor.

Guidance: Create EC to replace conductor whenever when (A) the conductor has splices tied in proximity to insulator (less than 2 ft. from insulator, armor rod or dead end) preventing free movement of splice with conductor; and (B) you observe older grey AWAC service drops and service drops where new service drop cable has been spliced with older, grey AWAC.

3 of 8: Primary or secondary conductor has diminished clearance mid-span or uneven conductor sag. Guidance: Refer to Clearance Job Aid in this document. If observed, create EC Notification to adjust clearance or to recommend a clearance pole.

4 of 8: Open wire secondary conductor with rack construction has missing spreader brackets for spans > 135'. Guidance: If observed, create EC Notification to have spreader brackets installed where bucket truck accessible; use line of sight and if available, foreman-cane or range-finder. If no access due to excessive vegetation, create EC Notification to remove vegetation and install spreaders.


5 of 8: Hand or preform tie wire broken, damaged, burnt, loose, showing signs of wearing, missing, or missing armor rod. Guidance: Create EC Notification to replace tie wire and/or armor rod.

6 of 8: Jumper burnt or jumper clearance issues. Guidance: If observed, create EC Notification to replace burnt jumper or to adjust clearance issues.


7 of 8: Service conductor has diminished clearance. Guidance: Refer to Clearance Job Aid in this document. If observed, create EC Notification to adjust clearance or to recommend a clearance pole.

8 of 8: Select if there are risks, hazards, or other maintenance conditions not previously captured in the checklist for this conductor.

Note 1: Look for vegetation in the open-wire secondary conductor. Look for grey wire AWAC service drops issues like deteriorated insulation and outdated connections. Guidance: If observed, create EC Notification to replace conductor with covered conductor and include vegetation trimming.

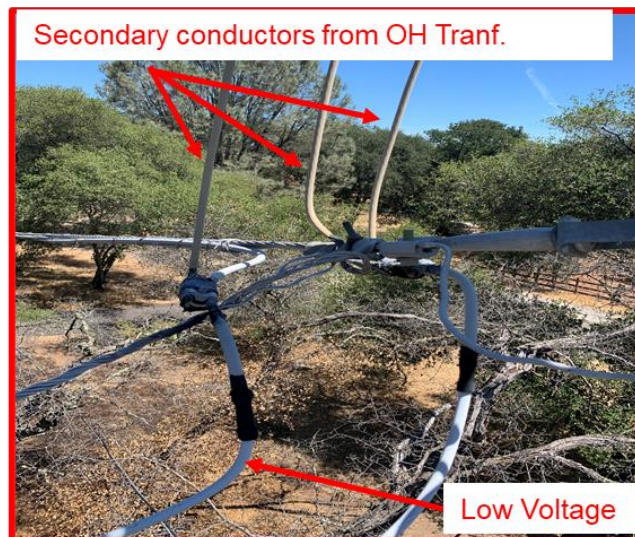

PG – Black tape
used for insulation

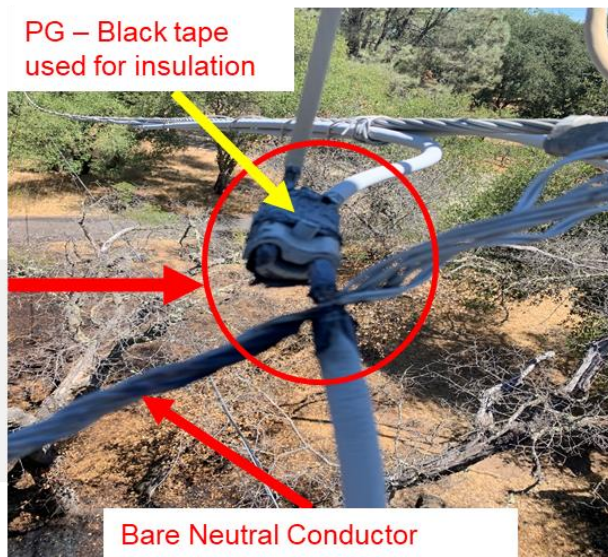

Neutral conductor
overlay on the service
drop caused direct short.
Low voltage insulation
failed and caused
arcing.

- Note 2:** Visually check for excessively corroded or damaged connectors and dead-end hardware which has a potential to drop conductor. Guidance: If observed, create EC Notification to replace connectors or dead-end hardware.
- Note 3:** Visually check all conductors, connectors, and splices under existing bird protection. Guidance: Use binoculars. If observed, create EC Notification to replace conductors and/or connectors.
- Note 4:** Visually check all splices in a span. Guidance: Follow the detailed splice training guidance. Use binoculars. If observed, create EC Notification to replace conductors with damaged, corroded, tie in too close to the insulator, preventing free movement of the splice with the conductor.
- Note 5:** Is the service conductor cracked, exposing the hotleg. Guidance: Use binoculars. Evaluate service drops looking for cracked or damaged insulation exposing hotlegs. If insulation is cracked or damaged to the point where hotleg is exposed, this is an Emergency/Standby condition. When service conductors go into riser, especially at the the bend radius and cable grip, observe potential fraying of the conductor insulation. Look for failures at the entry point to the molding or conduit.

Minor Work: Yes

- Repair damaged conductor as minor work if possible and if safe to do so.

EC Form: Yes, if not able to perform minor work


- Select the Priority and Due Date based upon compelling abnormal condition that may adversely impact public safety and/or service reliability in the next five (5) years.

Visual examples of types of conductor damage referenced under conductor general guidance

Example: Bird-caged conductor



Example: Open wire rack construction

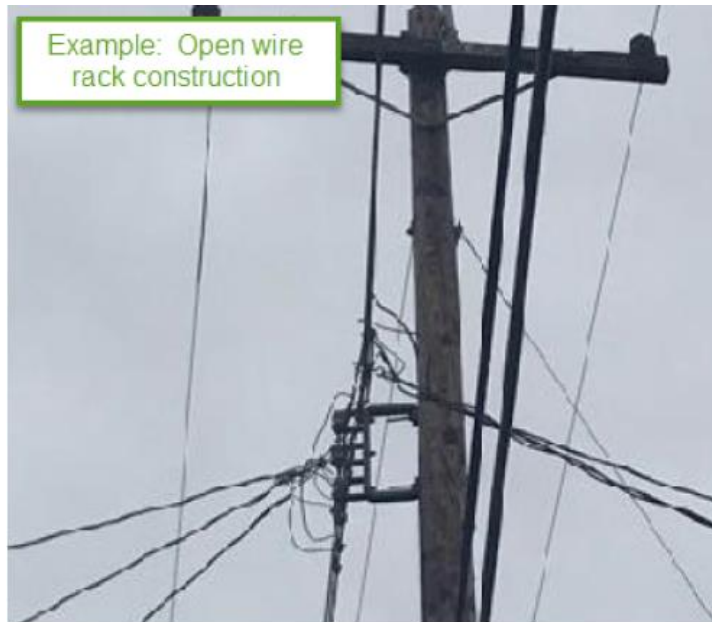


Example: Open wire on crossarm




Example: Gun-shot conductor



Example: Bad service conductor with exposed hot leg

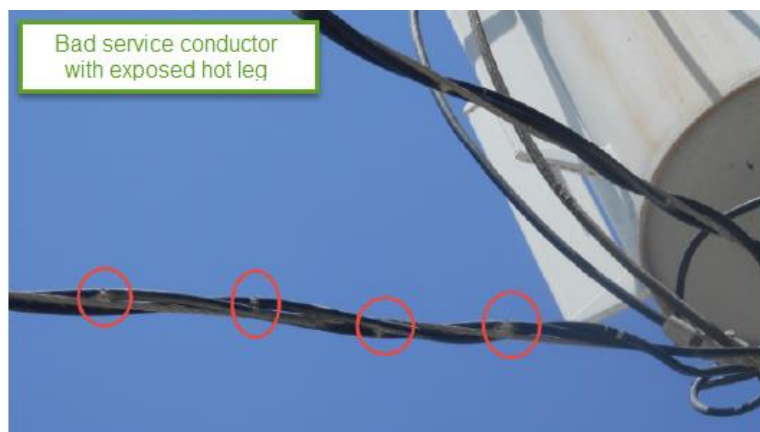


Example: Bare neutral coming into contact with hotleg

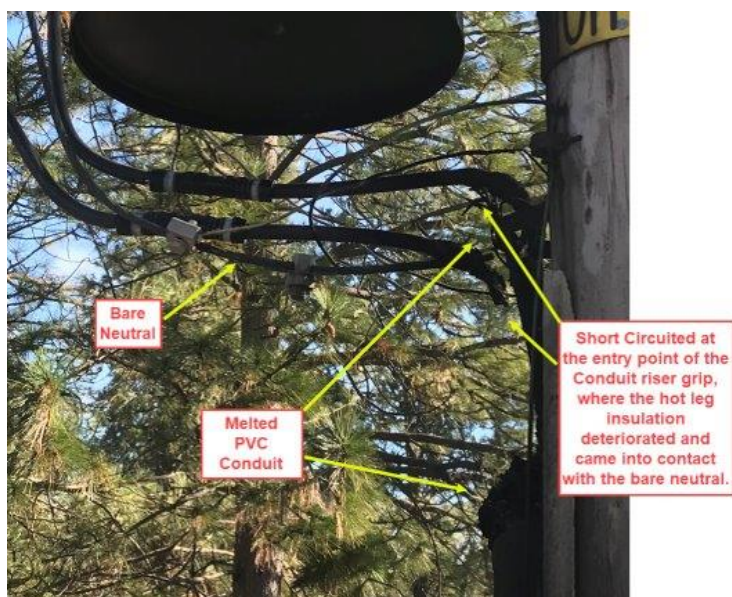


Example: Secondary Service Riser Drops




Example: Vibration Damper

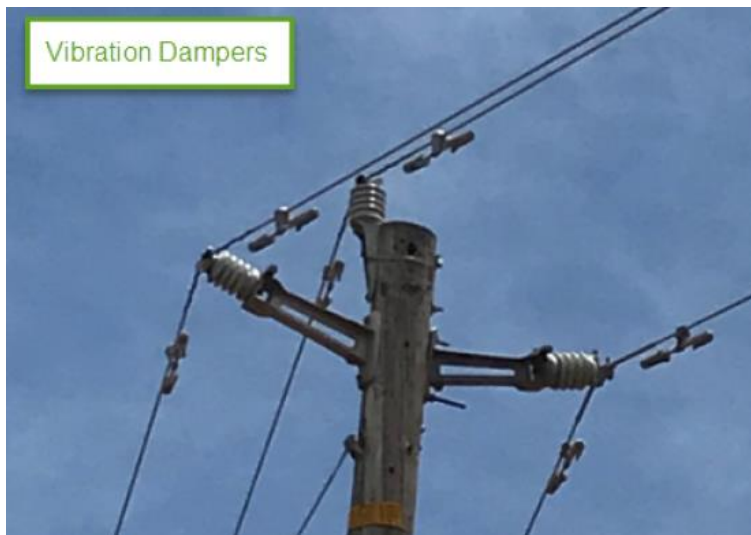

Example: Broken strands under vibration damper

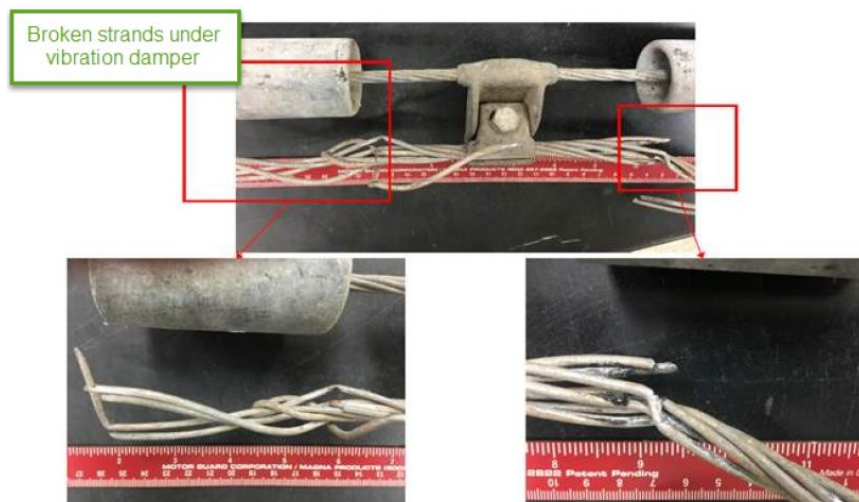

Example: Splice tied into insulator

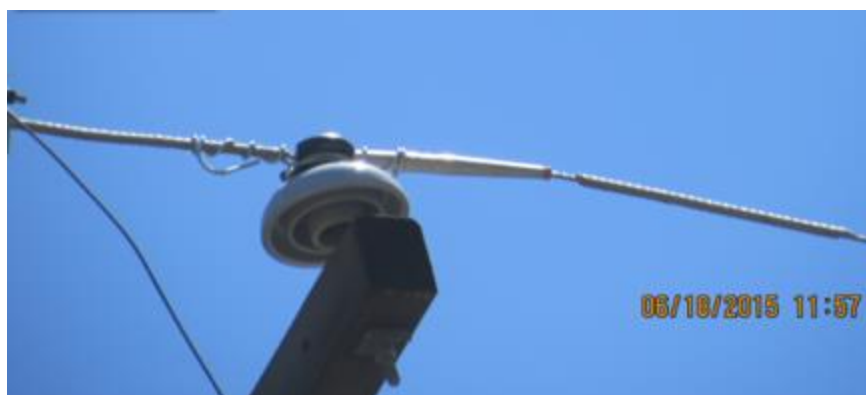

Example: Less than 2' from point of support




Example: Splice tied into insulator



Example: Loose primary neutral ground:



Example: Preform:

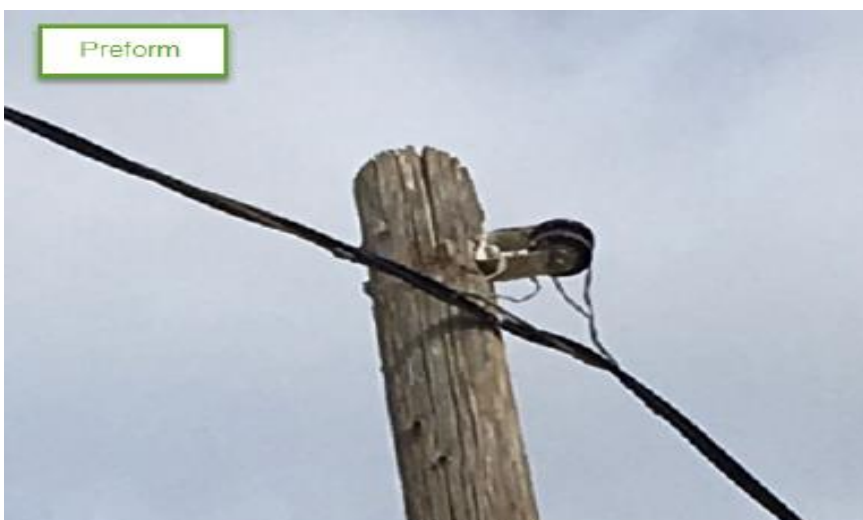




Example: Burnt conductor



Example: Bird protection installed on conductor



BROKEN SERVICE NEUTRAL	DAMAGED/CRACKED GREY SERVICE
	
<p>At this Location: Broken service neutral</p>	<p>At this Location: Cracked grey service. Older grey services tend to crack and will appear to have rings around the insulation.</p>
<p>Perform Minor Work: Yes, if safe to do so. If you replace the service conductor, this is capital Minor Work.</p> <p>Fill out EC Form to account for this minor work; charge time to your Division standing order</p>	<p>Perform Minor Work: Yes, if safe to do so. If you replace the service conductor, this is capital Minor Work.</p> <p>Fill out EC Form to account for this minor work; charge time to your Division standing order</p>
<p>Write Third Party Notification: No</p>	<p>Write Third Party Notification: No</p>
<p>Write EC Form: Yes, if minor work is not possible, or to document completed capital minor work</p> <ul style="list-style-type: none"> • FDA=Conductor / Broken/Damage / Repair or Replace • Priority "A", follow Emergency Process 	<p>Write EC Form: Yes, if minor work is not possible, or to document completed capital minor work</p> <ul style="list-style-type: none"> • FDA=Conductor / Broken / Replace - OR • FDA=Conductor / Damaged / Replace - OR • FDA=Conductor / Burnt / Replace • Priority "A", emergency, due to exposed hotleg.

DAMAGED SECONDARY	EXPOSED SERVICE CONNECTOR
 <p>At this Location: Damaged strands</p> <hr/> <p>Perform Minor Work: No</p> <hr/> <p>Write Third Party Notification: No</p> <hr/> <p>Write EC Form: Yes</p> <ul style="list-style-type: none"> • FDA= Conductor / Damage / Repair • Priority "E", 3-12 months depending upon exposure 	 <p>At this Location: Exposed conductors</p> <hr/> <p>Perform Minor Work: Yes, if safe to do so.</p> <hr/> <p>Third-Party Notification: No</p> <hr/> <p>Write EC Form: Yes, if minor work is not possible</p> <ul style="list-style-type: none"> • FDA= Conductor / Broken/Damage / Repair • Priority "E", 3-12 months depending upon exposure

CONDUCTOR TEARING APART



At this Location: Primary conductor damage (possibly shotgun)

Perform Minor Work: No

Third-Party Notification: No

Write EC Form: Yes

- FDA= Conductor / Broken/Damage / Repair
- Priority "B", 0-3 months depending upon exposure

HARDWARE BROKEN



At this Location: The #6 solid copper is broken causing strain on the conductor. Unsecured service.

Perform Minor Work: Yes, if safe to do so

Write Third-Party Notification: No

Write EC Form: Yes, if minor work is not possible

- FDA= Hardware/Framing / Broken/Damaged / Repair
- Priority "E", 3-12 months depending upon exposure

OVERHEAD SERVICE STRAIN ABRASION



At this Location: Service strain abrasion, with possible burning at some sections. Damaged insulation.

Perform Minor Work: Yes, if safe to do so. If you replace the service conductor, this is capital Minor Work.

Fill out EC Form to account for this minor work; charge time to your Division standing order.

Write Third Party Notification: No

Write EC Form: Yes, if minor work is not possible, or to document completed capital minor work

- FDA=Conductor / Broken/Damaged/ Repair or Replace
- Priority "E", 3-12 months depending upon exposure, in comments add note about strain abrasion burnt conductor
- If abrasion has caused an exposed hotleg, assign Priority A, emergency, and stand-by.

OVERHEAD SERVICE STRAIN ABRASION



At this Location: Service strain abrasion, no slack remaining

Perform Minor Work: Yes, if safe to do so. If you replace the service conductor this is capital Minor Work.

Fill out EC Form to account for this minor work; charge time to your Division standing order.

Write Third Party Notification: No

Write EC Form: Yes, if minor work is not possible, or to document completed capital minor work

- FDA=Conductor / Broken/Damaged/ Repair or Replace
- Priority "E", 3-12 months depending upon exposure, in comments add note about strain abrasion burnt conductor
- If abrasion has caused an exposed hotleg, assign Priority A, emergency, and stand-by.

2. Connector Broken/Damaged

General Guidance:

Visually check all connectors for signs of damage, corrosion, or incorrect installation.

Are secondary connectors (mini wedge and Insulink) installed on primary conductor? Guidance: If yes, write EC notification to replace connector.

Are connections made with dissimilar metals installed incorrectly? Guidance: Proper installation is Aluminum over Copper. Guidance: If yes, write EC notification to replace connector.

Are tap clamps installed incorrectly? Guidance: If yes, write EC notification to replace connector.

Guidance: Identify improperly installed tap clamps (aka chance clamps); e.g.

- No tap guards installed on conductor smaller than 1/0 Al and/or smaller than #2 Cu
- Installed on tap lines (jumpers) feeding more than 2 transformer banks.
- Installed on armor rod (used for tying in conductor with hand ties; not an appropriate method of attaching tap clamps)
- Used on any other type of equipment (recloser, capacitor, regulator, risers, etc.) other than a transformer.

Is the connector excessively corroded or damaged (potential to drop conductor)? If yes, write EC notification to replace connector.

Reference: Chance Clamp is a brand name; this is also known as a hot-line clamp.

Example: Incorrectly installed chance clamp



Example: Secondary connector installed in primary



Example: Insufficient clearance



3. Tie Wire Damaged

General Guidance:

Ensure splices are not located under tie wires. Repair damaged secondary tie wire as minor work if possible.

Visually inspect hand ties to identify wear prior to failure; utilize bucket truck, binoculars, or camera to get a closer look - especially on older installations.

If damage to primary, create EC notification.

Minor Work: Yes, on secondary only

- Repair damage to secondary as minor work if possible and if safe to do so.
- IF not able to perform minor work, THEN create EC notification.

EC Form: Yes, only if not able to perform minor work on secondary or primary damaged/broken.

- FDA: Tie Wire/ Broken/Damaged / Repair or Replace
- Select the Priority and Due Date based upon compelling abnormal condition that may adversely impact public safety and/or service reliability in the next five (5) years.

Related Documents: 021439, 057855

4. Floaters

General Guidance: Does primary or secondary conductor(s) float? A floater is when the conductor is not attached to the crossarm/pole. Floaters are **always** an Emergency/Standby condition. Create EC Notification using FDA Conductor / Floater / Repair.

Minor Work: No

Related Documents: 022088

FLOATER



At this Location: Floater, conductor is not contacting the arm. Rotten crossarm.

Perform Minor Work: No

Write Third Party Notification: No

Write EC Form: Yes

- FDA=Crossarm / Decayed/Rotten/ Replace
- Priority "A", follow Emergency Process

5. Broken or Unsecured Service Bob

General Guidance: Repair or Replace broken insulator, wires, pins, etc.

Minor Work: Yes


- Make repairs as minor work if possible and if safe to do so.
- IF not able to perform minor work, THEN create EC notification.

EC Form: Yes

- FDA: Hardware / Broken/Damaged / Repair or Replace
- Select the Priority and Due Date based upon compelling abnormal condition that may adversely impact public safety and/or service reliability in the next five (5) years.

Related Documents: None

Example: Broken service bob

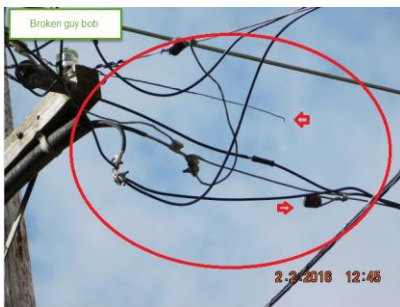

6. Conductor Clearances (Refer to Clearance Job Aid)

7. Conductor: Uneven, Improper Sag or Diminished Clearance

General Guidance: Check for primary or secondary conductor with improper sag or diminished clearance midspan or uneven conductors, phases touching, or broken at dead end supported by jumper. Guidance: Any spans with uneven conductor - different tension, "bellies" (one is lower than the conductor next to it - when wind blows it may sway at different rates, etc.), then re-sag or install spreader brackets.

Look for damaged dead-end hardware that may cause uneven sag. Look for signs of annealing, excessive sag, splices, or discoloration that can result in failed conductor.

Identify clearance requirements utilizing the Clearance Evaluation Job Aid.

Minor Work: Yes.

- Make repairs as minor work if possible and if safe to do so. Re-sag or install spreader brackets.
- IF not able to perform minor work, THEN create EC notification.

EC Form: Yes


- FDA: Conductor / Sag / Adjust
- Select the Priority and Due Date based upon compelling abnormal condition that may adversely impact public safety and/or service reliability in the next five (5) years.

Related Documents: TD-7103P-09 pg16, appendix B, table 1

Example: Secondary sagging conductor



Example: Sagging conductor

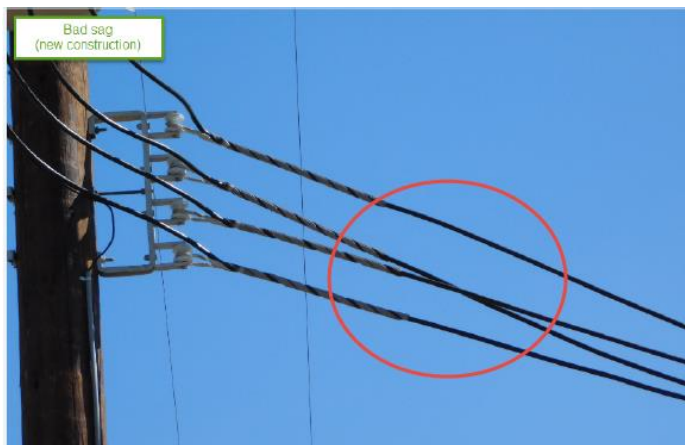

Example: Sagging primary conductor




Cutouts / Fuses / Switches

1. Damaged Arcing Horns

General Guidance: Call Restoration Dispatch to get a T-Man dispatched to the location to create a COE (CE) notification. Consider installing a warning tag on the pole.

Example: Arcing horn with burnt tip

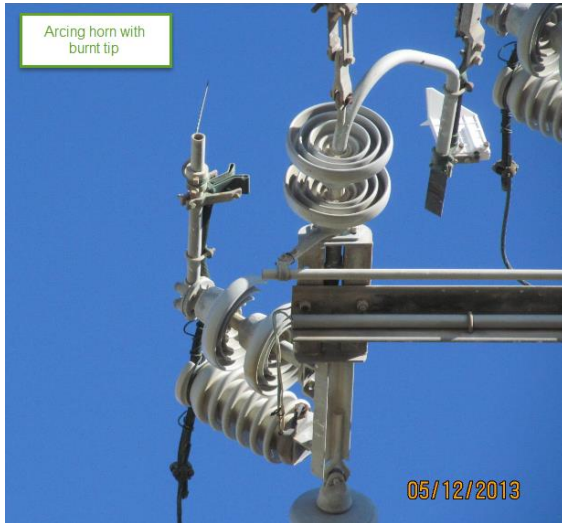

Minor Work: No

EC Form: Yes

- Select the Priority and Due Date based upon compelling abnormal condition that may adversely impact public safety and/or service reliability in the next five (5) years.

Related Documents: 015225

2. Cutouts

General Guidance: Are cutouts broken, damaged, cracked, loose, or flashed? Yes/No, if yes, THEN create an EC Notification.

Minor Work: No

EC Form: Yes

- Select the Priority and Due Date based upon compelling abnormal condition that may adversely impact public safety and/or service reliability in the next five (5) years.

Related Documents: 056425

BROKEN DAMAGED CROSSARM MOUNTED CUTOUT



At this Location: Broken/Flashed cutout

Perform Minor Work: No

Write Third-Party Notification: No

Write EC Form: Yes

- FDA=Cutout / Broken/Damaged / Replace
- Priority "E", 3-12 months depending upon exposure
- COE = No

BROKEN INSULATOR ON AIR SWITCH



At this Location: Broken insulator on air switch

Perform Minor Work: No

Write Third-Party Notification: No

Write EC Form: Yes

- FDA=Cutout / Broken/Damaged / Replace
- FDA Switch / Broken/Damaged / Replace
- Priority "E", 3-12 months depending upon exposure
- COE = Depending on voltage & Insulation value remaining if not operable

3. Jumpers

General Guidance: Are jumpers burnt or are there clearance issues? If yes, create EC notification.

Minor Work: No

EC Form: Yes

- Select the Priority and Due Date based upon compelling abnormal condition that may adversely impact public safety and/or service reliability in the next five (5) years.

Example: Jumper



4. Switch Handle/Control Box is not Locked

General Guidance: Ensure that boxes or enclosures located 8 feet or less above the ground are locked.

Minor Work: Yes

- Perform minor work if possible and if safe to do so.
- IF not able to perform minor work, THEN create EC notification.

EC Form: Yes, only if not able to perform minor work

- FDA: Switch / Broken / Repair or Hardware / Missing / Install
- Select the Priority and Due Date based upon compelling abnormal condition that may adversely impact public safety and/or service reliability in the next five (5) years.

Related Documents: 066195

Distribution Towers / Steel Lattice

General Guidance: Inspectors are required to inspect distribution towers / lattices for the following:

- Steel Covered by Earth
- Rust or Corrosion at Tower Footings
- Tower Footing Damaged
- Tower Member Loose
- Marking Hi-Sign Missing/Not Legible
- Guarding - Tower Not Guarded (Where Applicable)
- Guy Attachment, Turn Buckles, or Preformed Guys Loose
- Tower Rusty – Needs Paint

Minor Work: No

Related Documents: 022168, Utility Standard

Framing

1. Crossarm Broken/Deteriorated

General Guidance: Refer to TD-2305M-JA_07 “Crossarm Evaluation” Job Aid in this job aid.

2. Bridging Exists and Needs to be Repaired

General Guidance: Visual observation of broken / unattached bridge wire on a Distribution-only wood pole. Create EC notification.

Minor Work: No

Related Documents: 056845

BRIDGING



At this Location: Pole, burnt, pole failed

Perform Minor Work: No

Write Third-Party Notification: No

Write EC Form:

- FDA = Hardware/Framing / Broken/Damaged / Replace
- Priority "E", 3-12 months depending upon exposure

3. Underarm Bus Not Securely Attached

General Guidance:

It is a requirement to have at least two attachment points, secured to an underarm bus, one on each side.

It is a requirement to use the following corrosion resistant materials for attaching the underarm bus to the crossarm: straps, plumber's tape, lags, galvanized nails, staples, screws, bolts, zip ties, etc.

If an inspector finds an underarm bus secured with non-authorized material, such as duct tape, electrical tape, or rope, it must be secured by at least two additional approved attachment points.

When an inspector re-secures a bus, it must be brought up to construction standards; four attachment points using corrosion resistant materials.

Complete as minor work/re-secure the bus. IF it cannot be completed as minor work, then create EC notification if compelling and needs to be addressed within 5 years.

Minor Work: Yes

EC Form: Yes, only if not able to perform minor work

- Select the Priority and Due Date based upon compelling abnormal condition that may adversely impact public safety and/or service reliability in the next five (5) years.

Related Documents: 021924, Crossarm Evaluation TD-2305M-JA_07

UNDER-ARM BUS LOOSE AND DETERIORATED



Side View



Front View

At this Location: UAB deteriorated, partial repair with rope, secured with one strap.

Perform Minor Work: No

Write Third-Party Notification: No

Write EC Form: Yes

- FDA=Under-Arm Bus / Broken/Damaged / Repair
- At minimum – must write up as Priority "F-R", next inspection cycle; based on field condition and exposure, corrosion, etc.; prioritize as needed (A, B, E, or F)

UNDER-ARM BUS LOOSE



At this Location: UAB Loose

Perform Minor Work: Yes

Write Third-Party Notification: No

Write EC Form:

- FDA=Under-Arm Bus / Broken/Damaged / Repair
Priority "E", 3-12 months depending upon exposure

4. Wood Pin Burnt/Tracking or Broken

General Guidance:

Primary wood pins: If the primary wood pin is leaning or broken, or if there are signs of burning or tracking, create a 0-3 month Priority "B" EC Form.



Primary or Secondary wood pins: If wood pin is broken or "floating", create emergency EC to address immediately.

Minor Work: No

EC Form: Yes

- Select the Priority and Due Date based upon compelling abnormal condition that may adversely impact public safety and/or service reliability in the next five (5) years

Related Documents: 015202, G12021, TD-2305M-JA_07 Crossarm Evaluation

PIN BROKEN	PIN BROKEN (FLOATER)
	
<p>At this Location: Primary wood pin is broken, and the conductor is laying on the crossarm. Wood pin arm replace with Composite arm</p>	<p>At this Location: Secondary wood pin is broken, and the conductor is laying on the crossarm. Woodpin arm. Replace arm.</p>
<p>Perform Minor Work: No</p>	<p>Perform Minor Work: Yes, replace wooden pin with steel pin.</p>
<p>Write Third-Party Notification: No</p>	<p>Write Third-Party Notification: No</p>
<p>Write EC Form: Yes</p> <ul style="list-style-type: none"> FDA=Hardware/Framing / Broken/Damage / Replace FDA= Crossarm/Broken Damaged/Replace Priority "A", follow Emergency Process 	<p>Write EC Form: Yes</p> <ul style="list-style-type: none"> FDA= Conductor / Floating / Repair FDA= Crossarm/Broken Damaged/Replace Priority "A", follow Emergency Process

PRIMARY WOOD PIN AT ANGLE

At this Location: Deteriorated primary wood pin at angle. All insulators need to be replaced. Replace the crossarm with a composite arm.

Perform Minor Work: No

Write Third-Party Notification: No

Write EC Form: Yes

- FDA= Crossarm/Broken Damaged/Replace
- FDA=Hardware/Framing / /Broken/Damaged / Replace
- Priority "B", 0-3 Months depending on exposure.

PRIMARY WOOD PIN SQUATTER

At this Location: Primary wood pin squatter. Replace Crossarm. No armor rod with hand-tie.

Perform Minor Work: No

Write Third-Party Notification: No

Write EC Form: Yes

- FDA= Crossarm/Broken Damaged/Replace
- FDA=Insulator / Primary Squatter/ Replace
- Priority "E", 3-12 months depending upon exposure

Grounds / Ground Molding

1. Exposed Ground below 8'

General Guidance: Exposed grounds 8 feet or less from the ground must be covered. Inspectors must make every effort to cover the ground as minor work. If the exposed ground can be completed as minor work - preferred repair method is to use 1-1/2 inch plastic molding and not wood molding; if wood molding is used to make repair, use straps and not staples.

Consider a higher priority based on how much of the ground is exposed, and on the amount of public exposure. Inspector should "make safe" if cannot be addressed as minor work, based on location and exposure to the public.

The correct FDA is Ground/Exposed/Repair and not Molding Broken/damaged/ repair or replace.

Gaps in between molding segments should be covered if, in the inspector's judgment, they are large enough to allow human contact.

Minor Work: Yes

EC Form: Yes

- Select the Priority and Due Date based upon compelling abnormal condition that may adversely impact public safety and/or service reliability in the next five (5) years

Related Documents: Utility Bulletin TD-2990P-01

EXPOSED GROUND



At this Location: Exposed grounds near sidewalk

Perform Minor Work: Yes, at a minimum make safe

Write Third-Party Notification: No

Write EC Form: Only if not able to perform minor work

- FDA=Ground / Exposed / Repair
- Priority "A", emergency – due to public exposure at ground level.

REPAIR WITH 1.5" MOLDING



Before: Copper Wire sticking out from under the wood molding



After: 1.5 inch u-shaped molding installed over existing wood molding

At this Location: Wood molding with ground exposed

Perform Minor Work: Yes

Write Third-Party Notification: No

Write EC Form: Only if not able to perform minor work

REPAIR WITH 2" PLASTIC



At this Location: Condition acceptable after repair of exposed ground

REPAIR WITH WOOD MOLDING



At this Location: Condition acceptable after repair with wood molding

2. Exposed Ground above 8' to the Communication Level

General Guidance: If there are communication facilities on the pole, exposed grounds above 8 feet to the communication level must be covered. Cover the ground as minor work if possible. If not, create an EC Notification.

Gaps in between molding segments should be covered if, in the inspector's judgment, they are large enough to allow human contact.

If the pole is not a joint pole, no action required, because there is no exposure to the communication worker.

Minor Work: Yes

EC Form: Yes

- Select the Priority and Due Date based upon compelling abnormal condition that may adversely impact public safety and/or service reliability in the next five (5) years

Related Documents: 021904, 036229

EXPOSED GROUND AT COMMUNICATION LEVEL



At this Location: Exposed ground at communications level. Wood molding broken in climbing space.

Perform Minor Work: Yes, if safe to do so.

Write Third-Party Notification: No

Write EC Form: Only if unable to perform minor work.

- FDA=Ground / Exposed / Repair
- At minimum – must write up as Priority "F-R", next inspection cycle; based on field condition and exposure, corrosion, etc.; prioritize as needed (A, B, E, or F)

EXPOSED GROUND DUE TO TWISTED MOLDING



At this Location: Exposed ground in wood molding.

Perform Minor Work: Yes, when safe to do so.

Write Third-Party Notification: No

Write EC Form: Only if unable to perform minor work.

- FDA=Ground / Exposed / Repair
- FDA=Molding / Broken/Damaged / Repair
- At minimum – must write up as Priority "F-R", next inspection cycle; based on field condition and exposure, corrosion, etc.; prioritize as needed (A, B, E, or F)

3. Ground Molding Unsecured/Loose

General Guidance: Ensure that the molding is in good condition and secured to the pole.

Look for unsecured and loose wood ground molding, unglued PVC ground molding joints, molding joints that have come apart exposing the ground wire, etc.

Gaps in between molding segments should be covered if, in the inspector's judgment, they are large enough to allow human contact.

When making repairs - must meet construction standards.

Minor Work: Yes

EC Form: Yes

- Select the Priority and Due Date based upon compelling abnormal condition that may adversely impact public safety and/or service reliability in the next five (5) years

Related Documents: 02904

**WOOD MOLDING NOT SECURE
EXPOSING GROUND**

At this Location: Wood molding not secure, allowing human contact.

Perform Minor Work: Yes

Write Third-Party Notification: No

Write EC Form: Only if unable to perform minor work.

- FDA=Ground / Exposed / Repair

At minimum – must write up as Priority "F-R", next inspection cycle; based on field condition and exposure, corrosion, etc.; prioritize as needed (A, B, E, or F)

**PVC MOLDING NOT SECURE EXPOSING
GROUND**

At this Location: PVC molding not secure, due to failure of previous repairs, allowing human contact.

Perform Minor Work: Yes

Write Third-Party Notification: No

Write EC Form: Only if unable to perform minor work.

- FDA=Ground / Exposed / Repair

At minimum – must write up as Priority "F-R", next inspection cycle; based on field condition and exposure, corrosion, etc.; prioritize as needed (A, B, E, or F)

PVC MOLDING SECURED

At this Location: PVC molding adequately secured with staples upon arrival. No action is required.

WOOD MOLDING SECURED

At this Location: Wood molding adequately secured with straps spacing 36 inches or less upon arrival. No action required.

4. Exposed Ground Rod

General Guidance: If the ground rod can be permanently covered as minor work, do so. If not, create EC notification.

Minor Work: Yes

EC Form: Yes

- Select the Priority and Due Date based upon compelling abnormal condition that may adversely impact public safety and/or service reliability in the next five (5) years

Related Documents: None

EXPOSED GROUND ROD



At this Location: Exposed ground rod

Perform Minor Work: Yes

Write Third-Party Notification: No

Write EC Form:

- FDA=Ground / Exposed / Repair
At minimum – must write up as Priority "F-R", next inspection cycle; based on field condition and exposure, corrosion, etc.; prioritize as needed (A, B, E, or F)

5. Broken Ground

General Guidance: Inspector identifies a broken ground; refer to bulletin [TD-2999B-024](#) for specific guidance about testing/replacing grounds

Minor Work: Yes

- Perform minor work if possible and if safe to do so.
- IF not able to perform minor work, THEN create EC notification.

EC Form: Yes

- Select the Priority and Due Date based upon compelling abnormal condition that may adversely impact public safety and/or service reliability in the next five (5) years

Related Documents: Utility Bulletin TD-2990P-01; TD-2999B-024

Guys / Anchors

1. Down Guy Preform Buried

General Guidance:

Top of anchor head must be above grade. Expose anchor as minor work. Evaluate the unburied anchor guy pre-forms and visually inspect them.

Perform minor work to add extension or grade around anchor so the anchor head becomes visible.

If the pre-form cannot be unburied as minor work, create an EC notification.

Note 1: If you cannot dig up the anchor and create an EC with a photo of a buried anchor **only** - the Gatekeeper will **not know** if the anchor can be replaced or if an extension can be installed; you should make every effort to dig up the anchor to perform a complete assessment. If your photo is of a buried anchor only, the general rule of thumb is that the EC will be created to **replace** the anchor.

Note 2: If you **cannot** dig up the anchor, but you can see most of the pre-form - an extension can *usually* be added (only one extension can be installed)

Note 3: If you are performing an Overhead Inspection, and you cannot dig up a deeply buried anchor, consider this a CGI (Cannot Get In) location because you could not confirm the condition of the buried anchor.

Minor Work: Yes

- Perform minor work if possible and if safe to do so.
- IF not able to perform minor work, THEN create EC notification.

EC Form: Yes

- Select the Priority and Due Date based upon compelling abnormal condition that may adversely impact public safety and/or service reliability in the next five (5) years

Related Documents: 022221

BURIED ANCHOR



Before: Vegetation covers anchor



After: Vegetation cleared from anchor

At this Location: Anchor below grade overgrown with vegetation. After minor work inspector decides if the anchor can be adjusted or needs replaced.

Perform Minor Work: Yes, remove the vegetation

Yes, expose anchor and evaluate condition/corrosion

Yes, preferred method is to adjust anchor by adding extension

Write Third-Party Notification: No

Write EC Form: If cannot be addressed as minor work

- FDA=Anchor / Soil/Eroded/Graded / Replace (if the anchor cannot be adjusted)
- At minimum – must write up as Priority "F-R", next inspection cycle; based on field condition and exposure, corrosion, etc.; prioritize as needed (A, B, E, or F)

ANCHOR EXTENSION



Anchor extension



Close-up

At this Location: Inspector performed minor work, exposed anchor, evaluated anchor to be in good condition so that extension could be installed, then installed extension. (Back fill not shown)

Perform Minor Work: Yes

Write Third-Party Notification: No

Write EC Form: No

ANCHOR COVERED BY CONCRETE



At this Location: Anchor covered by concrete

Perform Minor Work: No

Write Third-Party Notification: No

Write EC Form: Yes

FDA=Anchor /Soil/Eroded/Graded / Replace
At minimum – must write up as Priority "F-R",
next inspection cycle; based on field
condition and exposure, corrosion, etc.;
prioritize as needed (A, B, E, or F)

ANCHOR BURIED BY VEGETATION



Anchor buried by roots



Anchor buried by tree

At this Location: Anchor buried by ivy roots / tree

Perform Minor Work: No

Write Third-Party Notification: No

Write EC Form: Yes

- FDA=Anchor / Soil/Eroded/Graded / Replace
- At minimum – must write up as Priority "F-R", next inspection cycle; based on field condition and exposure, corrosion, etc.; prioritize as needed (A, B, E, or F)

2. Visible Portion of Anchor Rod has Significant Corrosion

General Guidance: IF the anchor rod is significantly corroded, THEN create EC notification.

Minor Work: No

EC Form: Yes, only if not able to perform minor work

- FDA: Anchor Corroded Replace
- Select the Priority and Due Date based upon compelling abnormal condition that may adversely impact public safety and/or service reliability in the next five (5) years

Related Documents: 025998

ANCHOR ROD WITH SIGNIFICANT CORROSION



Anchor above ground



Below

At this Location: Corroded Anchor

Perform Minor Work: No

Write Third-Party Notification: No

Write EC Form: Yes

- FDA=Anchor / Corroded / Replace
- Priority "E", 3-12 months depending upon exposure

3. Guy Broken/Slack

General Guidance: Important: Before any work is performed on a down guy, inspect the guy insulator; if broken, check for presence of voltage. Guys must be taut (straight, no belly). Tighten the guy as minor work if possible. If not possible, create an EC Notification.

If tightening the guy would exacerbate any pre-existing conditions on a facility (e.g. increase the lean of an already leaning pole, deform an already deforming pole), create an EC Notification with comments describing the situation.

Minor Work: Yes

EC Form: Yes

- Select the Priority and Due Date based upon compelling abnormal condition that may adversely impact public safety and/or service reliability in the next five (5) years

Related Documents: 022178

GUY CLEARANCE



At this Location: Acceptable solution through plastic barrier.

GO 95 requires 3" of radial clearance. Plastic barriers can be installed if less than 3" of clearance.

GUY DAMAGED REPAIR



At this Location: Guy tail extends beyond the preform near sidewalk, safety hazard.

Perform Minor Work: Yes

Write Third-Party Notification: No

Write EC Form: Only if minor work cannot be performed.

- FDA Guy / Broken/Damaged/ Repair
- Priority "E", 3-12 months depending upon exposure

OVERGROWN GUY



At this Location: Extensive dead ivy covering half of length of guy.

Perform Minor Work: No

Write Third-Party Notification: No

Write EC Form: Yes

- FDA=Guy / Broken/Damaged / Replace
- Priority "E", 3-12 months depending upon exposure

TREE GROWING AROUND GUY



At this Location: Tree growing around guy

Perform Minor Work: No

Write Third-Party Notification: No

Write EC Form: Yes

- FDA=Guy / Broken/Damaged / Replace
- Priority "E", 3-12 months depending upon exposure

SLACK GUY




At this Location: Loose guy on left side

Perform Minor Work: Yes

Write Third-Party Notification: No

Write EC Form: Yes, only if minor work is not possible


- FDA=Guy / Loose / Adjust
- At minimum – must write up as Priority "F-R", next inspection cycle; based on field condition and exposure, corrosion, etc.; prioritize as needed (A, B, E, or F)

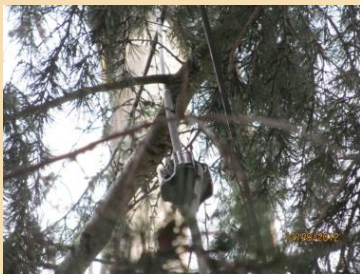GUY GROUNDED BY VEGETATION

**Guy grounded
by vegetation**



**Guy grounded
by vegetation**

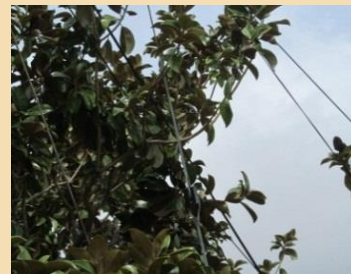

**Guy overgrown
by vegetation**

At this Location: Guy grounded by vegetation, above the bob.

Perform Minor Work: Yes

Write Third-Party Notification: No

Write EC Form: Yes, only if minor work cannot be performed

- FDA=Guy / Overgrown / Trim
- Priority "E", 3-12 months depending upon exposure

IVY ON GUY AND PRIMARY

At this Location: Ivy on guy and on primary. Safety issues, possible energized guy and pole, transformer weeping – no oil on ground, evaluate per oil spill matrix.

Perform Minor Work: No

Write Third-Party Notification: No

Write EC Form: Yes

- FDA=Transformer / Leaks/Seeps/Weeps / Replace (primary)
- FDA=Guy / Overgrown / Trim
- Priority "B", 3 months or less depending upon exposure

TREE LIMB GROWING AROUND GUY



Guy through tree



Close-up

At this Location: Tree limb growing around guy, below the bob.

Perform Minor Work: No

Write Third-Party Notification: No

Write EC Form: Yes


- FDA=Guy / Strain/Abrasion / Remove
- Priority "E", 3-12 months depending upon exposure

4. Guy Insulator Broken/Missing

General Guidance: Guys in the cylinder of “proximity” to conductors less than 35kV:

- 8 ft. or less above or below the conductor level
- 6 ft. or less horizontally from the surface of the pole

Example: Broken guy insulator

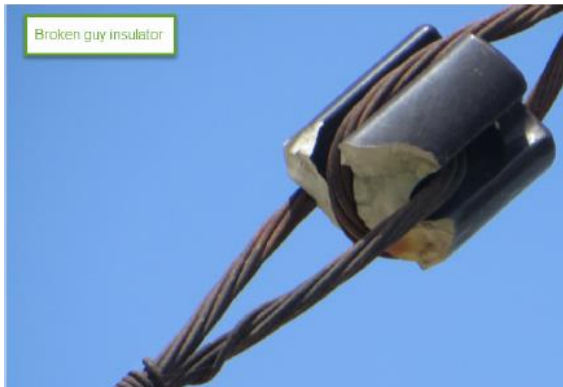

Must be sectionalized and ungrounded. Ensure there is an intact guy insulator.

Minor Work: No

EC Form: Yes

- FDA: Guy / Broken/Damaged / Replace or Guy / Missing / Install
- Select the Priority and Due Date based upon compelling abnormal condition that may adversely impact public safety and/or service reliability in the next five (5) years

Related Documents: 022178

5. Down Guy Grounded above Guy Insulator (vegetation or other)



General Guidance: Ensure that all guys are not grounded above the guy insulator. Remove any foreign objects (e.g. vegetation) contacting and grounding the guy above the insulator as minor work. Clear so that new growth will not contact or ground the guy. (Rule of thumb is that growth per year is 1 foot, so trim back 5 feet.)

Minor Work: Yes

EC Form: Yes

- Select the Priority and Due Date based upon compelling abnormal condition that may adversely impact public safety and/or service reliability in the next five (5) years

Related Documents: 022178

DOWN GUY GROUNDED ABOVE GUY INSULATOR	DOWN GUY GROUNDED ABOVE GUY INSULATOR CAUSING STRAIN AND ABRASION
	
<p>At this Location: Vine growing up and across the guy insulator grounding the guy.</p>	<p>At this Location: Tree grounding the guy above the guy insulator causing strain and abrasion.</p>
<p>Perform Minor Work: Yes</p>	<p>Perform Minor Work: Yes, if minor work not possible</p>
<p>Write Third-Party Notification: No</p>	<p>Write Third-Party Notification: No</p>
<p>Write EC Form: Yes, only if minor work cannot be performed</p> <ul style="list-style-type: none"> • FDA=Guy / Overgrown / Trim • Priority "E", 3-12 months depending upon exposure 	<p>Write EC Form: Yes, only if minor work cannot be performed</p> <ul style="list-style-type: none"> • FDA=Guy / Strain/Abrasion / Remove • FDA=Guy / Overgrown / Trim • Priority "E", 3-12 months depending upon exposure

6. Down Guy Marker Missing/Damaged

General Guidance: For poles installed **after 1996**, Guy Markers are required on **all** down guys. The markers must be a minimum 8 ft. in length. For poles installed **prior to 1996**, guy markers are **only required** on poles which are exposed to traffic. **Inspector should confirm the age of the pole via the date nail to verify the requirement.**

Install a single guy marker on multiple guys which are clamped together. For guys that are not clamped together, but on the same anchor, consider separate guy markers on each guy if the separation is large.

Note: Installing yellow colored guy marker does not negate the need to install visibility strips on the markers. Install visibility strips around traffic areas, on state highways, near curbs, driveways, etc. See visibility strip entry for more details.



Note: Install a segment of guy marker above cattle guards to ensure a minimum 8 ft. of guarding.

Minor Work: Yes

EC Form: Yes

- Select the Priority and Due Date based upon compelling abnormal condition that may adversely impact public safety and/or service reliability in the next five (5) years

Related Documents: 06542, 022178, 99-34

GUY MARKER MISSING	CATTLE GUARD LESS THAN 8 FT
	
<p>At this Location: Guy marker missing</p>	<p>At this Location: Cattle guard is less than 8 feet in length</p>
<p>Perform Minor Work: Yes, install new guy marker</p>	<p>Perform Minor Work: Yes, lower cattle guard and add guy marker to meet 8 feet requirement.</p>
<p>Write Third-Party Notification: No</p>	<p>Write Third-Party Notification: No</p>
<p>Write EC Form: No, perform minor work</p>	<p>Write EC Form: No, perform minor work</p>

DOWN GUY: MARKER NOT REQUIRED



At this Location: Acceptable down guy attached to building, no marker required.



At this Location: Acceptable down guy in marsh, no marker required.

Idle Facilities

1. Identifying and Documenting Idle Facilities

Inspectors identify and document idle lines as they would for any other field condition found, per the requirements and procedures in the Electric Distribution Preventative Maintenance (EDPM) Manual.

Compliance Inspections follow the Idle Facility Program as documented in TD-2459P-01 and use the annual Detailed Overhead Inspection Checklist to indicate when an Idle condition is present for the inspection location by checking the observed an Idle Facility box.

When an idle condition is selected, the inspector shall select from 4 reasons:

1. Pole is not mapped idle. It is de-energized.
 - Create IF Notification (using the Inspect App)
2. Pole is not mapped idle. It is energized.
 - Create IF Notification (using the Inspect App)
 - Create EC Notification (to de-energize)
3. Pole is mapped idle. It is de-energized.
 - No further action required
4. Pole is mapped idle. It is energized.
 - Create EC Notification (to de-energize)

Inspect App: Use the IF Notification in the Inspect App to document an observed Idle Facility field conditions. These include asset information, location information, facility type, field conditions, and comments and photos. Compliance Inspectors will select the appropriate Priority as follows:

1. High Priority
 - Pending EC Notification B Priority (not de-energize FDA) at this location
2. Medium Priority
 - Transformer Present
 - HFTD T3/T2
 - Oil Filled Equipment
 - Modesto Irrigation District (60 days)
3. Low Priority
 - All other conditions


At a **minimum**, attach the following three images to each IF Notification:

- Two field photos of the field condition
- Screenshot of Map with the idle area clearly identified

Example: If there is an idle line with five poles, only one IF Notification is required for the entire section of line. **Do not create an IF Notification for each pole.**

Note 1: Continue to document safety, reliability, and/or regulatory issues for EC and Vegetation Notifications. Vegetation management personnel **do not** patrol or maintain vegetation on de-energized tap lines.

Note 2: Use Table 1 to help in understanding the various priorities.

 Pacific Gas and Electric Company®		Utility Procedure: TD-2459P-01 Publication Date: 03/03/2022, Effective Date: 03/03/2022, Rev: 4
Idle Facility Program		
Table 1. Idle Facility Field Conditions and Investigation Priorities		
Condition	Action	Investigation Priority
Safety situation/risk.	<ul style="list-style-type: none"> Mitigate hazard and make safe, which may include de-energizing. Initiate an IF notification for investigation. Initiate an electric corrective (EC) notification to document any other abnormal conditions to resolve. Initiate a Priority B, 3-month EC notification to de-energize the facility. 	<ul style="list-style-type: none"> High Submit to supervisor by end of day. Enter in SAP and communicate to idle facility investigation personnel within two business days.
<p>Idle transformers that do not have a blue sticker indicating a polychlorinated biphenyl (PCB) content of less than 5 parts per million (ppm) may be classified as high, medium, or low priority.</p> <p>Consider current field conditions¹, the transformer condition, and if the following sensitive locations are nearby:</p> <ul style="list-style-type: none"> Surface or ground waters Sewers or sewage treatment systems Private or public drinking water sources or distribution systems Grazing lands Vegetable gardens or agricultural areas Daycare centers and schools 	<p>If high priority, then mitigate hazard and make safe, which may include de-energizing.</p> <ul style="list-style-type: none"> Initiate an IF notification for investigation; priority is dependent on field and equipment conditions. Note the specific field conditions, transformer condition, and transform locations (see "Condition" column notes) in the Comments section Initiate a Priority B, 3-month EC notification to de-energize the facility 	<ul style="list-style-type: none"> High – Medium – Low To designate as high priority, consider the identified idle transformer locations, current condition of the transformer (see "Condition" column notes), and current condition of associated facilities (pole, crossarm, etc.)
Future work required to maintain existing idle facility (EC notifications to repair/replace/relocate facilities).	<ul style="list-style-type: none"> Initiate an IF notification for investigation and ensure the Future Work Requested field is checked Initiate a Priority B, 3-month EC notification to de-energize the facility 	High – Medium – Low
PG&E and Modesto Irrigation District (MID) service areas.	<ul style="list-style-type: none"> Initiate an IF notification for investigation Initiate a Priority B, 3-month EC notification to de-energize the facility 	Medium
<p>Idle facilities in raptor concentration zones (RCZs) with suitable habitat to support threatened or endangered raptors.</p> <p>Oil-filled equipment considerations:</p> <ul style="list-style-type: none"> Surface or ground waters Sewers or sewage treatment systems Private or public drinking water sources or distribution systems Grazing lands Vegetable gardens or agricultural areas Daycare centers and schools 	<ul style="list-style-type: none"> Initiate an IF notification for investigation. Initiate a Priority B, 3-month EC notification to de-energize the facility. Initiate an IF notification for investigation. For idle transformers, note the absence or presence of a blue sticker on the IF notification; a blue sticker indicates a PCB content of less than 5 ppm Initiate a Priority B, 3-month EC notification to de-energize the facility. 	<p>Medium – Low</p> <p>Medium</p>
Idle facility in Tier 2 & 3 fire zone.	<ul style="list-style-type: none"> Initiate an IF notification for investigation. Initiate a Priority B, 3-month EC notification to de-energize the facility. 	Medium
Potential use for agricultural pumps or vacant buildings.	<ul style="list-style-type: none"> Initiate an IF notification for investigation. Initiate a Priority B, 3-month EC notification to de-energize the facility 	Low
Entire primary tap is identified as idle and is unused. No future work is required to maintain the existing idle facility.	<ul style="list-style-type: none"> Initiate an IF notification for investigation. Initiate a Priority B, 3-month EC notification to de-energize the line. 	Low

Note 3: Use Table 2 to help in understand the mapping annotations.

Table 2. TOS/TIF Classifications

Temporary Out of Service (TOS) De-Energized Temporary Idle Facility (TIF) Energized		
Facilities with a future use are grouped into one of the following classifications:		
TOS-AG	Potential agricultural use	De-energized
TIF-AG	Potential agricultural use	Energized
TOS-V	Potential service to an existing vacant building	De-energized
TIF-V	Potential service to an existing vacant building	Energized
TOS-CAP	Potential PG&E use for capacity or reliability	De-energized
TIF-CAP	Potential PG&E use for capacity or reliability	Energized
TOS-F	Future customer use identified by service planning	De-energized
TIF-F	Future customer use identified by service planning	Energized
TOS-MLX	Current Main Line Extension Agreement	De-energized
TIF-MLX	Current Main Line Extension Agreement	Energized
TOS-SFA	Current Special Facilities Agreement	De-energized
TIF-SFA	Current Special Facilities Agreement	Energized

Note 4: When new maintenance is identified on energized idle facilities, write **THREE** notifications:

- One IF Notification (TD-2459S-F01) for the entire idle line
- One EC Notification to de-energize the entire idle line
- One EC Notification per location requiring maintenance

Note 5: After identifying pending maintenance on idle facilities, ensure that the IF Notification has the Field Condition box “Future work required to maintain existing idle facility” checked.

- Enter the following note in the EC Notification comments section: “IDLE notification created.”
- Enter a note in both IF Notification and EC Notification comments with corresponding notification numbers, when available.

Note 6: Always ask your PG&E Lead, IRS, or Supervisor for help in determining priority, creating the IF Notification, and creating an EC Notification to de-energize the idle line.

Raptor Concentration Zone (RCZ) Guidance: In the Inspect App, do the following:

1. Go to Map Preferences
2. Set the Raptor Concentration Zone “ON”
3. View the map with purple RCZ layer displayed
4. The IF Program administrators use all the information you provide on the IF Notification in conjunction with RCZ flag indicating if this location is or is not in an RCZ area to further assess risk.

Related Documents: TD-2459P-01

2. Energized Electric Line Facility No Longer Used to Serve Customer Load

General Guidance: It may be necessary to de-energize the idle facility:

If primary lines are energized, de-energize line sections by opening cut-outs. In raptor concentration zones (RCZs) or if the primary tap line is unfused, create a Priority E, 3-month Electric Corrective (EC) Notification to de-energize the jumpers.

NOTE

When idle transformers or sections of line de-energized by cut-outs are located in non-raptor areas, an EC Notification is **not** required to de-energize the jumpers.

Do not initiate an IF Notification or an EC Notification when attachments to poles (cross-arms, miscellaneous hardware, brackets, insulators, etc.) do not pose a safety or reliability risk to an idle facility. If it is not necessary to de-energize the idle facility, create a Priority “F” EC Notification.

Continue to document safety or reliability issues that meet criteria for vegetation notifications.

Minor Work: No

EC Form: Yes, to de-energize

- FDA: OH Facility Idle De-Energize
- Select the Priority “E”
- Select the 0-3 month Due Date

Idle Facility Form: Yes

Related Documents: TD-2459P-01

3. De-Energized Electric Line Facility Already Identified on a Pending EC Notification but Not Mapped

General Guidance: Create a map change request if the facility is not mapped as idle.

Minor Work: No

Map Correction: Yes

Related Documents: TD-2459P-01

Insulators

1. Arcing or Tracking on Insulators

General Guidance: If there is evidence of arcing or tracking on a primary insulator, call the construction supervisor, create Emergency EC notification, and follow emergency EC processes.

Note: Inspector should always consider replacing wood crossarm with composite crossarm.

Construction Note: Cannot mix insulator types, always replace full set of insulators.

Minor Work: No

EC Form: Yes, create an Emergency EC Notification

Related Documents: Utility S2405

2. Damaged Insulators

General Guidance Are Insulators chipped, cracked, corroded, contaminated, flashed, have signs of tracking, broken, or damaged? If yes, create EC notification.

Replace ALL insulators if one is chipped, cracked, contaminated, broken, or damaged.

Note for construction: If an insulator is damaged due to gunshot, replace with epoxy or polymer insulators.

Note for construction: Cannot mix insulator types, always replace full set of insulators.

Note: Inspector should always consider replacing wood crossarm with composite crossarm, based on condition of crossarm.

Minor Work: No

EC Form: Yes

- FDA: Insulator Broken Replace
- Select the Priority and Due Date based upon compelling abnormal condition that may adversely impact public safety and/or service reliability in the next five (5) years

Related Documents: 022088, 068180 (composite crossarm), TD-2305M-JA_07 Crossarm Evaluation job aid

DAMAGED INSULATOR



At this Location: Damaged insulator with an insulator that I no longer approved. Replace all insulators and the arm

Perform Minor Work: No

Write Third-Party Notification: No

Write EC Form: Yes

- FDA= Crossarm / Decayed/Rotten / Replace
- FDA=Insulator / Broken/ Damage / Replace
- Priority "E", 3-12 months depending upon exposure

INSULATOR LAYING ON ITS SIDE / PRIMARY ON THE ARM



At this Location: Insulator lying on its side. Primary on the arm.

Perform Minor Work: No

Write Third-Party Notification: No

Write EC Form: Yes

- FDA= Crossarm / Decayed/Rotten / Replace
- Priority "A", follow Emergency Process

**FLASHED INSULATOR ON
TRANSFORMER**


At this Location: Flashed insulator on transformer

Perform Minor Work: No

Write Third-Party Notification: No

Write EC Form: Yes

- FDA= Transformer / Flashed / Replace
- Priority "E", 3-12 months depending upon exposure

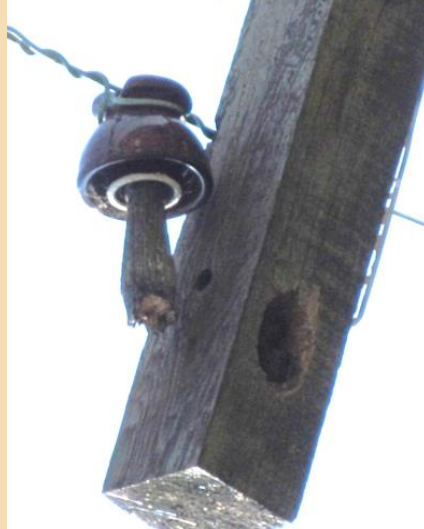BROKEN WOOD PIN ON PRIMARY

At this Location: Broken wood pin. Primary (High Voltage Sign). Conductor on arm. Replace all insulators and the crossarm with a composite arm.

Perform Minor Work: No

Write Third-Party Notification: No

Write EC Form: Yes

- FDA= Crossarm / Decayed/Rotten / Replace
FDA=Insulator / Squatter-(Primary) / Replace
- Priority "A", follow Emergency Process, (Conductor contacting crossarm)

FLASHED INSULATOR POTHEAD



At this Location: Flashed pothead


Perform Minor Work: No

Write Third-Party Notification: No

Write EC Form: Yes or COE (pin or energized)

- FDA=Riser/Pothead / Flashed / Replace
- At minimum – must write up as Priority "F-R", next inspection cycle; based on field condition and exposure, corrosion, etc.; prioritize as needed (A, B, E, or F)

BROKEN WOOD PIN ON SECONDARY

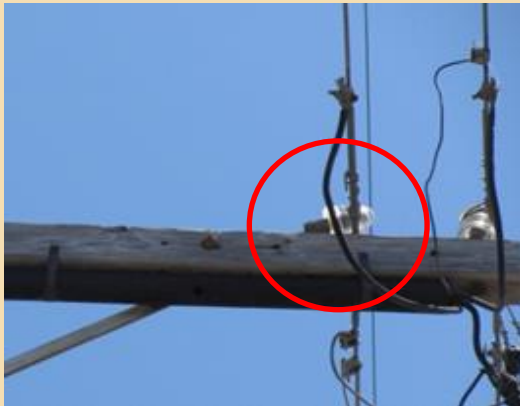

At this Location: Broken secondary wood pin. Conductor lying on the arm, tangent pole. (excluding urban wildfire areas, use risk priority matrix). Wood pin arm at end of life replace arm with composite arm

Perform Minor Work: Yes

Write Third-Party Notification: No

Write EC Form: Yes, if minor work not possible

- FDA= Crossarm / Decayed/Rotten / Replace
- FDA= Insulator / Squatter (Secondary) / Replace
- Priority "B", 0-3 months depending upon exposure

BROKEN SECONDARY INSULATOR



At this Location: Broken secondary insulator

Perform Minor Work: No

Write Third-Party Notification: No

Write EC Form: Yes

- FDA= Crossarm / Decayed/Rotten / Replace
- FDA= Insulator / Broken/ Damage / Replace

FLASHED INSULATOR MYLAR BALLOON

At this Location: Flashed insulator by Mylar balloon

Perform Minor Work: No

Write Third-Party Notification: No

Write EC Form: Yes

- FDA=Insulator / Flashed / Replace
- Priority "E", 3-12 months depending upon exposure

3. Squatters – Primary or Secondary

General Guidance: Are primary or secondary insulators squatting? If yes, create EC Notification.

Minor Work: No

EC Form: Yes

- FDA = Insulator / Primary Squatter / Replace - OR
- FDA = Insulator /Secondary Squatter / Replace
- Select the Priority and Due Date based upon compelling abnormal condition that may adversely impact public safety and/or service reliability in the next five (5) years

Note: Inspector should always consider replacing wood crossarm with composite crossarm.

Construction Note: If an insulator is damaged due to gunshot, replace with epoxy or polymer insulators.

Construction Note: Cannot mix insulator types, always replace full set of insulators.

Related Documents: 022088, Crossarm Evaluation TD-2305M-JA_07

PRIMARY SQUATTER



At this Location: 2 Primary Wood Pin Squatters; replace wood crossarm with composite crossarm.

Perform Minor Work: No

Write Third-Party Notification: No

Write EC Form: Yes

- FDA = Crossarm Decayed/Rotten / Replace
FDA = Insulator / Primary Squatter / Replace
- At minimum – must write up as Priority "E", based on field condition and exposure, corrosion, etc.; prioritize as needed (A, B, or E)

SECONDARY SQUATTER AND DECAYED CROSSARM



At this Location: Secondary Squatter and decayed crossarm.


Perform Minor Work: No

Write Third-Party Notification: No

Write EC Form: Yes

- FDA= Crossarm / Decayed/Rotten / Replace
- Priority "E", 3-12 months depending upon exposure
- Note: When replacing insulators, do NOT mismatch insulators.

PRIMARY SQUATTER AND BROKEN HIGH VOLTAGE SIGN

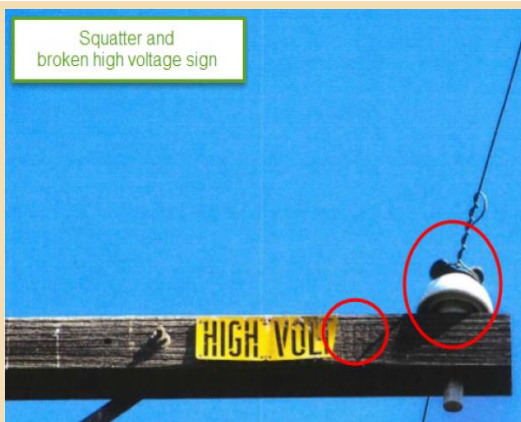

At this Location: Primary squatter and broken high voltage sign

Perform Minor Work: No

Write Third-Party Notification: No

Write EC Form: Yes

- FDA = Insulator / Primary Squatter / Replace
- FDA = High Sign / Broken / Replace
- Assign priority depending upon condition of asset/component, location, and public safety & exposure
- Note: Consider replacing wood crossarm with composite.

4. Flying Bells

General Guidance: Are flying bells broken or damaged? If yes, create EC notification.

Note: If flying bells were installed to de-energize idle facilities, assess vegetation around idle conductor; create EC notification to trim, as vegetation management does not perform trimming on idle facilities.

Example: Flying bells installed



Minor Work: No

EC Form: Yes

- Select the Priority and Due Date based upon compelling abnormal condition that may adversely impact public safety and/or service reliability in the next five (5) years

Lightning / Surge Arrestors

1. Broken or Flashed

General Guidance: Are arrestors broken, damaged, flashed, or is the ground lead disconnect activated? If yes, Create EC notification to replace lightning arrestor.

Example: Blown lightning arrestor



Example: Approved ABB-type surge arrestor



Minor Work: No

EC Form: Yes

- Select the Priority and Due Date based upon compelling abnormal condition that may adversely impact public safety and/or service reliability in the next five (5) years

Related Documents: 031822

Markings

1. High Voltage Sign Not Installed as Required

General Guidance: Inspectors are required to look for missing or broken high voltage signs during inspections. If inspectors find missing or broken signs, they should install new signs as minor work if they have the appropriate materials and equipment and can perform the work safely. If the inspector cannot install a sign as minor work, the inspector must create a Priority 'F' EC notification. Below is guidance on how to evaluate high voltage signage.

High Voltage Sign Requirements:

Poles that support line conductors or risers energized at **more than 750 volts** must be marked with high voltage signs.

IMPORTANT: If a pole is marked under **any of the options below**, it satisfies the high voltage marking requirement.


When installing **new** high voltage signs using one option, inspectors are not required to remove signs previously installed under different options.

Marking Options A B and C:

A. Sign the Pole Below the Lowest 750V+ Line Conductor (**Preferred Method**)

Marking requirements are satisfied under this option if:

1. There are two signs, attached to the surface of each side of the pole¹.
2. The top of each sign is no more than 40" below the lowest level line conductor that exceeds 750V.

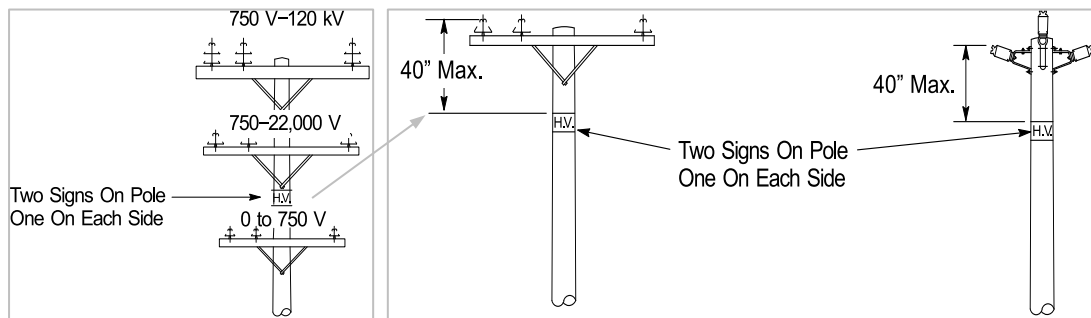


¹**Exception:** If an inspector finds only one high-voltage sign within 40" below the lowest 750V or greater conductor, the inspector **is not required to install a second sign**. However, when performing work at the lowest crossarm level, a second sign must be installed.

B. Sign the Pole Below Equipment

Marking requirements are satisfied under this option **if**:


1. There are two signs attached to the surface of each side of the pole.
2. The top of each sign is no more than 6" below the equipment.
3. The signs are above all 0-750V supply and communication line conductors.

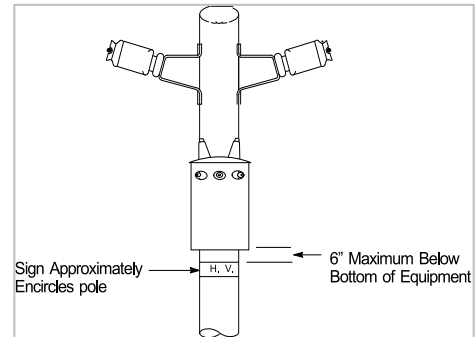

² **Exception:** If an inspector finds only one high-voltage sign installed within 6" below the equipment, the inspector **is not required to install a second sign**. However, when performing work at the equipment level, a second sign must be installed.

C. Sign Each Crossarm


Marking requirements are satisfied under this option **if each crossarm (line arm) supporting line conductors in excess of 750V are signed both front and back**. Signs are not required on the inside faces of double arms.

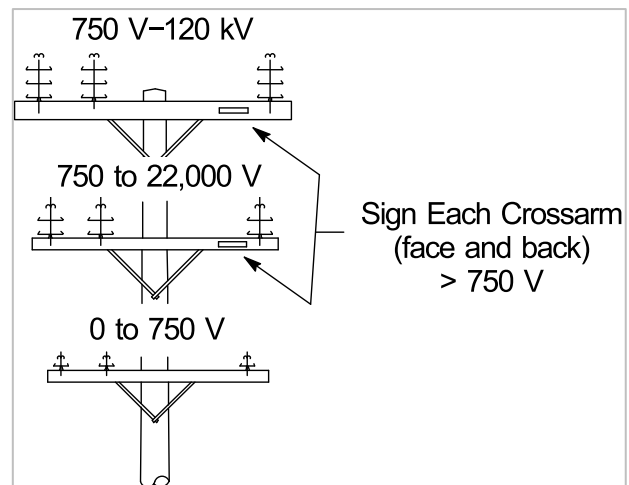

The exceptions in Sections A and B do not apply when, in the judgment of the inspector, the two high voltage signs should be installed so that they may be visible from all sides of the pole.

Typical examples are poles near water areas suitable for sailboats, near established boat ramps and associated rigging areas, adjacent to swimming pools, and in agricultural areas with moveable irrigation piping.

Examples: High Voltage Sign

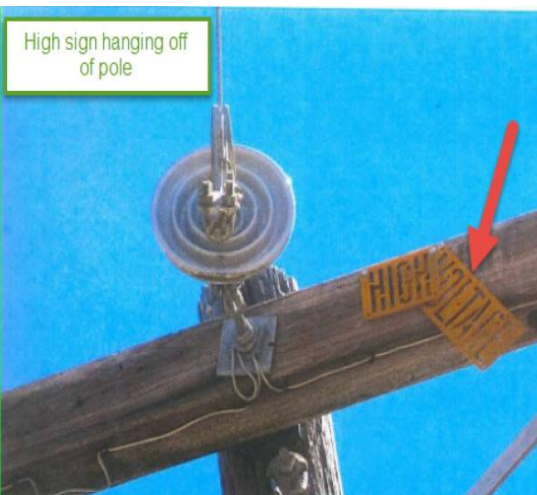

Minor Work: Yes

EC Form: Yes, if cannot be completed as minor work.

- Select the Priority and Due Date based upon compelling abnormal condition that may adversely impact public safety and/or service reliability in the next five (5) years

Related Documents: 022168

2. Operating Number Incorrect / Illegible/ Missing

General Guidance:

IF the operating number on the field equipment does **not** match the operating number printed on inspection map;

THEN (1) **contact the local Distribution Operation (DO)** to confirm the discrepancy and to get further instructions

(2) DO confirms the field equipment number is **correct**; then complete a **map correction**

(3) DO confirms the field equipment number is **not correct**; then **perform minor work to correct the operating numbers** on the field equipment

(4) DO **cannot confirm the operating number**; then get a PIN from DO and complete a **map correction** to get an operating number assigned

(5) DO confirms the field equipment number for equipment in the field that **does NOT** have a field equipment number installed; then **complete minor work to install the equipment number OR create an EC** to have M&C install the field equipment number

Note: Alpha characters may differ between divisions. Be sure to confirm the "number" with the local DO and PS&R Supervisor.

Operating number should be installed in the operating position; if missing, they should be installed on the operating position, not at the 6' level. Consider also adding the # at the 6' level for ease of identification for field EE's.

If operating number exists, is it legible (faded, etc.); if not legible replace them as minor work or create an EC notification.

If operating number is not installed in the field, but on the inspection map - call the DO to confirm the correct number before installing.

If confirmed that the field is wrong, correct as minor work or create an EC to have corrected.

If confirmed that the operating number is mapped but not installed in the field, install the operating number as minor work.

If operating number is not installed in the field, but on the inspection map and/or in GIS - call the team lead who will contact the DO to confirm the correct number before installing.

If confirmed that the number is mapped but not installed in the field, or the field is incorrect, correct as minor work if possible, or write EC notification.

Minor Work: Yes

Map Correction: Yes, if operating number needs to be corrected

EC Form: Yes, if you cannot perform minor work

- FDA: Marking / Broken/Damaged / Replace or Marking / Missing / Install
- Select the Priority and Due Date based upon compelling abnormal condition that may adversely impact public safety and/or service reliability in the next five (5) years

Related Documents: 057352

FADED OPERATING NUMBER



Before: Faded operating number



Close-up



After: Minor work completed, operating number applied below operating position.

At this Location: Operating number is faded

Perform Minor Work: Yes

Write Third-Party Notification: No

Write EC Form: Yes

- FDA=Marking / Broken/Damaged / Replace
- At minimum – must write up as Priority "F-R", next inspection cycle; based on field condition and exposure, corrosion, etc.; prioritize as needed (A, B, E, or F)

3. Damaged or Missing Visibility Strips on Poles/Guy Markers

General Guidance: Reflective visibility strips shall be installed on wood, fiberglass, or steel poles, streetlight poles, and guy markers as follows:

- A. On poles and guy markers installed on state highways.
- B. On poles and guy markers located within 15 feet from the paved surface or 15 feet from the edge of the traveled, unpaved portion of city or county roads (streets) where not protected by curbs.
- C. On poles and guy markers within 6 feet of an adjacent driveway, private roadway (street), turnaround, parking lot, or thoroughfare in rural district, capable of being traversed by vehicles, where these are not protected by curbs.

Notes:

Visibility strips are not required on poles or guy markers behind a curb, approximately 5-1/2" x 5-1/2" and 90 degrees to the surface.

Visibility strips should not be installed if there is no reasonable expectation of traffic. For example: Cross country poles, poles through waterways or wetlands, rear easements poles, poles behind guardrails, or poles on embankments that are well above or below the road.

Reminders:

- Do not install visibility strips on top of the old one. Inspectors must remove the old strip first.
- If the old strip is in good condition, but became loose, re-secure the strip to the structure.
- Do not install metal visibility strips over any vertical molding/riser.
- If any visibility strip work is required, bring the location up to the current visibility strip standard (all must be the same color – yellow)
- Install visibility strips on the side facing oncoming traffic when known.
- Do not install visibility strips within 1-1/2" of U-shaped molding
- If unable to install at time of inspection due to lack of material return and complete minor work if still in the area and can do so and document minor work or write up EC notification to correct.

Minor Work: Yes

EC Form: Yes, if cannot be completed as minor work.

- Select the Priority and Due Date based upon compelling abnormal condition that may adversely impact public safety and/or service reliability in the next five (5) years

Related Documents: 022168, GO 95 Rule 56.9 (1964, 1990, 1996 Change to Guy Marker)

ADHESIVE VISIBILITY STRIPS




At this Location: Acceptable application of plastic and adhesive visibility strips

CLEARANCE FROM GROUND



At this Location: Acceptable metal visibility strips attached 1 1/2" from ground.

INADEQUATE VISIBILITY STRIPS

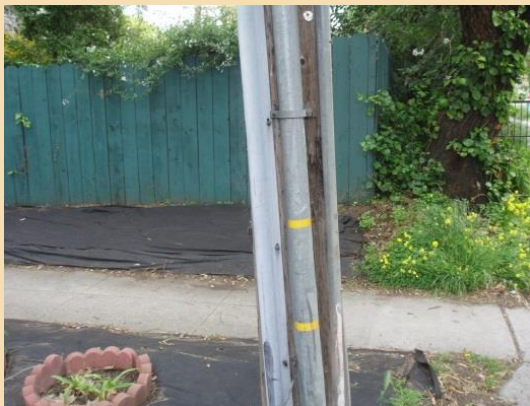

At this Location: Pole with vehicular exposure. Two small sections of yellow adhesive visibility strips.

Perform Minor Work:

Yes, apply 3 adhesive visibility strips on the pipe.

Yes, apply 3 adhesive visibility strips to the plastic molding.

Write Third-Party Notification: No

Write EC Form: No, perform minor work

VISIBILITY STRIPS PAINTED OVER NO LONGER REFLECTIVE



At this Location: Visibility strips painted brown (3rd visibility strip located above not shown in picture)

Perform Minor Work: Yes, remove old visibility strips and install new.

Write Third-Party Notification: No

Write EC Form: No, perform minor work

METAL OVER MOLDING



Before



After

At this Location: Metal visibility strips under wood molding and over wood molding with protruding edge.

Perform Minor Work: Yes, remove old metal visibility strips and apply new visibility strips; visibility strips on after photo are fiber, not metal (coded item)

Write Third-Party Notification: No

Write EC Form: No, perform minor work

OLD METHOD VISIBILITY STRIPS



At this Location: Aged visibility strips have lost reflectivity.

Perform Minor Work: Yes, replace with 3 yellow visibility strips

Write Third-Party Notification: No

Write EC Form: No, perform minor work

OLD AND NEW VISIBILITY STRIPS



At this Location: Yellow visibility strips mounted over old white visibility strips.

Perform Minor Work: Yes, remove old visibility strips

Write Third-Party Notification: No

Write EC Form: No, perform minor work

Oil-filled Equipment

1. Equipment Oil: Leaking/Weeping Stain

General Guidance: Refer to the EDPM Manual - Assessments and Notifications Section for additional information about addressing oil in the field.

IF you observe a **stain or leak**

THEN (1) Look for **exposure or contamination**

Refer to the **PCB Spill/Leak Category Response Matrix** to determine the appropriate action and priority.

PCB Spill/Leak Category Response Matrix
Overhead & Sub-surface Equipment

Indicator	PCB Equipment Manufactured Before July 1979		Non-PCB Equipment Manufactured July 1979 or later	
	EC Notification Priority	Standby at Site	EC Notification Priority	Standby at Site
Equipment has failed and insulating fluid has run off the surface of the equipment and is in contact with the soil, vegetation, or water.	A Replace	Yes	A Replace	Yes
Insulating fluid has run off the surface of the equipment and is in contact with the soil, vegetation, or water OR Insulating fluid is actively dripping.	A Replace	Yes	A Replace	Supervisor discusses with EFS to determine need to standby based on location and size of spill.
Insulating fluid is about to run off the surface of the equipment but has not made contact with the soil, vegetation, water, or structure.	A Replace	Yes	A Replace	Supervisor discusses with EFS to determine need to standby based on location and size of spill.


PCB Spill/Leak Category Response Matrix
Overhead & Sub-surface Equipment
(Continued)

Indicator	PCB Equipment Manufactured Before July 1979		Non-PCB Equipment Manufactured July 1979 or later	
	EC Notification Priority	Standby at Site	EC Notification Priority	Standby at Site
Insulating fluid is on the surface of the equipment and is not about to run off the surface and has sheen (Weeps or Seeps).	Supervisor discusses with EFS to determine EC notification category based on sensitivity of location and upcoming weather. IF no timely response from EFS within ½ hour, THEN assumed to be sensitive area.			
Sensitive Areas	A Replace	Not needed	B 3 month Recheck • Describe sheen in notification • Re-check in 3 months.	Not needed
Non-sensitive Areas	B 30 day Replace IF estimating cannot be completed in time to meet 30 day deadline, THEN replace with like.			
Residual stain is a mark on the equipment that appears dried. Examples: • Stain on side of overhead transformer • Stain on concrete	No further action needed	Not needed	No further action needed	Not needed

PCB Spill/Leak Category Response Matrix, continued

PCB Spill/Leak Category Response Matrix
Padmount Equipment

Indicator	PCB Equipment Manufactured Before July 1979 2		Non-PCB Equipment Manufactured July 1979 or later	
	EC Notification Priority	Standby at Site	EC Notification Priority	Standby at Site
Equipment has failed and insulating fluid has run off the surface of the equipment and is in contact with the soil, vegetation, or water.	A Replace	Yes	A Replace	Supervisor discusses with EFS to determine need to standby based on location and size of spill.
Insulating fluid is actively dripping either outside or inside the cabinet doors.	A Replace	Yes	A Contain & Clean Complete cleaning A, B, or E Replace	Supervisor discusses with EFS to determine need to standby based on location and size of spill.

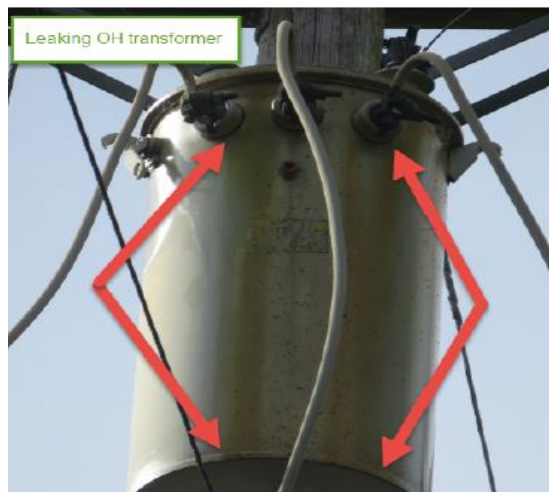Minor Work: No**Related Documents:** TD-2320P-01 Attachment 4**Examples:** Leaking OH Transformer

2. Corrosion

General Guidance: In many parts of PGE's service territory, facilities are exposed to conditions that both cause and accelerate corrosion of metal components.

During detailed inspections, examine facilities and assess their condition for corrosion. If corrosion is minor, repairs to the protective coatings that cover the metal surfaces on the equipment should be made. In addition, during the diagnostic testing for specific types of distribution line equipment, perform an examination for corrosion.

Minor Work: Yes

EC Form: Yes, if compelling

- Select the appropriate FDA
- Select the Priority and Due Date based upon compelling abnormal condition that may adversely impact public safety and/or service reliability in the next five (5) years

Related Documents: TD-2305M-JA_05 "Corrosion Evaluation Job Aid", G12020, TD-3322B-066-JA08

IF you observe corrosion:

THEN (1) Look for exposure

- (2) Refer to the below table for to determine the corrosion rating and the required actions to perform. Visual examples follow:

Description	Symptoms	Required Actions
Integrity is breached	Hole(s) in metal (public exposure to high voltage, cover not securable, significant oil leak or spill, etc.)	EC notification Priority A – replace immediately or make safe and issue Priority B – replace/repair
Metal is damaged	Separation, layering, bubbling	EC notification Priority E – replace/repair Not to exceed 12 months
Moderate to heavy corrosion	No sign of metal degradation	Inspect at next interval Pad-mounted equipment – clean and paint
Little or no corrosion	Discolored paint, staining	No action required

OH CORROSION EXAMPLES



At this Location: Corrosion Weakening Integrity of Tank

Metal is separating into layers

Corrosion will breach tank

Perform Minor Work: No

Write Third-Party Notification: No

Write EC Form:

- FDA=Transformer Leaks/Seeps/Weeps Replace
- Priority "E", 3-12 months depending upon exposure




At this Location: Transformer with moderate/heavy corrosion

Metal structure still sound (rust staining from attachments)

Perform Minor Work: No

Write Third-Party Notification: No

Write EC Form: No

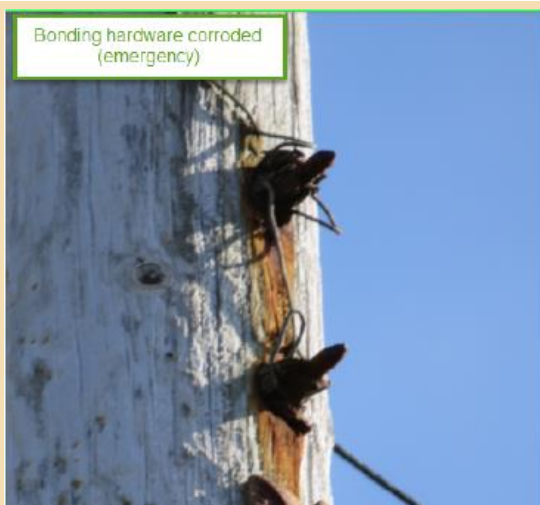

At this Location: Bonding hardware corroded

Perform Minor Work: No

Write Third-Party Notification: No

Write EC Form: Yes

- FDA=Transformer Leaks/Seeps/Weeps Replace

Priority "E", 3-12 months depending upon exposure

TRANSFORMER WITH STAINING, NO CORROSION



At this Location: Transformer with dirt and salt spray staining, no metal damage

Perform Minor Work: No

Write Third-Party Notification: No

Write EC Form: No

TRANSFORMER CASE WITH LITTLE OR NO CORROSION



At this Location: Transformer with little to no corrosion, no metal damage

Perform Minor Work: No

Write Third-Party Notification: No

Write EC Form: No

3. Transformer – Blue Sticker

Guidance: Use binoculars to confirm the presence or absence of a blue sticker.

Always determine if the transformer has a blue sticker or not.

Always determine if the transformer is a SP (self-protecting) transformer or not

Example: SP transformer



4. Transformer – Parallel

Is there an obvious paralleled transformer condition at this location? If yes, create EC notification to address parallel condition in the field.

Minor Work: No

2022 Checklist Equipment Section: Guidance: Use a combination of the mapping symbols shown on your Inspect App map, the actual field observations, the checklist options (shown below) to guide your checklist selection and the notification priority (B or E) when creating an EC Notification.

Equipment

Does this structure have PG&E equipment?

Yes No

Transformers

☒ Obvious paralleled transformer condition at this location

- 1 Conventional transformers in obvious parallel connection, no self-protected (SP) transformer present
- 2 Self-protected (SP) transformers in obvious parallel connection with conventional transformers
- 3 Self-protected (SP) transformers in obvious parallel connection, no conventional transformer present

4.1 Select this checklist option when you observed the following conditions:

In the field: You observed Conventional transformers in obvious parallel connection, with no self-protected (SP) transformer present.

Checklist: Select this checklist item

Create EC: FDA = Transformer / Parallel / Replace with Priority E

4.2 Select this checklist option when you observed the following conditions:

In the field: You observed Self-Protected (SP) transformers in obvious parallel connection, with conventional transformers present.

Checklist: Select this checklist item

Create EC: FDA = Transformer / Parallel / Replace with Priority B


4.3 Select this checklist option when you observed the following conditions:

In the field: You observed Self-Protected (SP) transformers in obvious parallel connection, with no conventional transformer present.


Checklist: Select this checklist item

Create EC: FDA = Transformer / Parallel / Replace with Priority B

Example: Banked transformers on separate poles should be identified as banked.

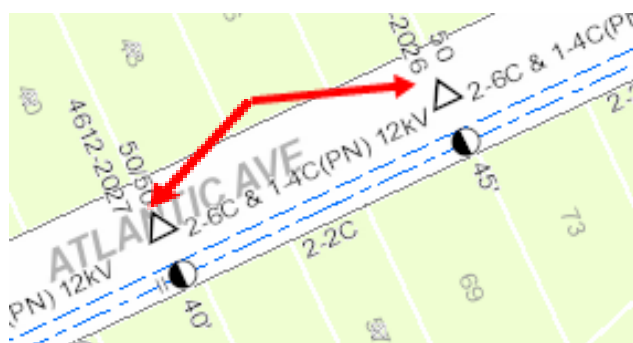

Example: OH Paralleled Transformers

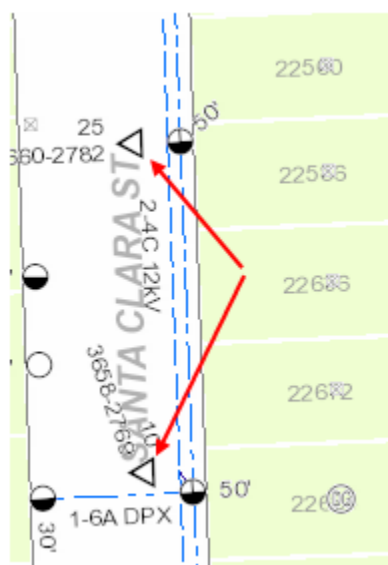

OH Transformers separated by bobs are ok



Related Documents: TD-2424B-001

Poles

1. Solely-Owned Poles with Third-Party Attachments

General Guidance: Identify all solely owned pole with third-party attachments (based on how it is mapped). Write EC Notification for Pole / Overloaded / Test, for Estimating to confirm pole loading.

Determine if additional clearing is needed for access to pole; if so - create EC Notification.

Minor Work: Yes, create an EC Notification to clear vegetation unless it can be addressed as minor work

Related Documents: EDPM Pole Inspection, Utility S2325

2. Broken, Deteriorated, Deformed Poles

General Guidance: Observations in the field may include the following types of pole damage:

1. Broken
2. Split
3. Decayed / Rotten
4. Woodpecker / Animal / Vehicle damage
5. Vandalized
6. Any pole deformity
7. Any condition that may impair conductor clearance
8. Cracked poles: assess for potential failure
9. Significant reduced circumference

Is pole damaged, broken, burnt, deformed, corroded, gunshot, or showing signs of cracking, or decay that needs to be addressed in the next 5 years? If yes, create EC notification.

Does the pole have woodpecker damage that needs to address in the next 5 years? Refer to EDPM Manual for how to assess woodpecker damage. If yes – create EC notification to repair, assess, or replace pole.

Does pole have significant reduced circumference? Guidance: For example, animal, vehicle, vandalism, burnt, shell rot, that has caused a pole circumference reduction that could cause the pole to be overloaded or deformed needs to be written up on an EC Notification, FDA = Pole Overloaded Test. If circumference is significant and needs to be addressed in the next 5 years, create EC notification to replace pole.



An 'N' tag indicates previously identified damaged pole.

Minor Work: No

Related Documents: EDPM Pole Inspection, TD-2325S, 066209

Related Document: TD-2325P-06

Composite Pole



Composite Pole



Pole with steel stub



Pole with wood stub



Example: Pole top extension



Example: "California" pole top extension



**POLE BROKEN AT THE
COMMUNICATION LEVEL**



At this Location: Pole broken at the communication level in HFTD area.
Complete Pole Inspection Test Report

Perform Minor Work: No

Write Third-Party Notification: No

Write EC Form: Yes

- FDA=Pole / Broken/Damaged / Replace
- Priority "A" address immediately

POLE BROKEN AT MIDDLE SECTION



At this Location: Broken pole. Complete Pole Inspection Test Report

Perform Minor Work: No

Write Third-Party Notification: No

Write EC Form: Yes

- FDA=Pole / Broken/Damaged / Replace
- Priority "B", 0-3 months depending upon exposure

BROKEN POLE



At this Location: Broken pole. Complete the Pole Inspection Test Report. Pole supported in four directions.

Perform Minor Work: No

Write Third-Party Notification: No

Write EC Form: Yes

- FDA=Pole / Broken/Damaged / Replace
- Priority "B", 0-3 months depending upon exposure

POLE SPLIT AT COMMUNICATION LEVEL



At this Location: Pole split at communication level. Complete the Pole Inspection Test Report.

Perform Minor Work: No

Write Third-Party Notification: No

Write EC Form: Yes

- FDA=Pole / Broken/Damaged/ Replace
- Priority "B", 0-3 months depending upon exposure

DAMAGE TO POLE FROM SPECIFIC EVENT

At this Location: Pole burnt

If pole has reduced circumference. Write EC notification for estimating to confirm pole loading.

Perform Minor Work: No

Write Third-Party Notification: No

Write EC Form: Yes, Write EC notification for estimating to confirm pole loading.

- FDA=Pole/Overloaded/Test
- Priority "E", 3-12 months depending on exposure.

DECAY OF POLE OVER TIME

At this Location: Pole top decayed. Entire pole failed pole test. Complete the Pole Inspection Test Report.

Perform Minor Work: No

Write Third-Party Notification: No

Write EC Form: Yes

- FDA=Pole Decayed/Rotten/Replace
- Priority "E", 3-12 months depending upon exposure

SAW CUT INTO POLE



At this Location: Vandalized pole. Chain saw cut into lower portion of pole. Half of pole circumference cut into.

Notify supervisor of possible vandalism. Supervisor will have to communicate to damage claims. Complete Poles Inspection Test Report.

Perform Minor Work: No

Write Third-Party Notification: No

Write EC Form: Yes

- FDA=Pole / Broken/Damaged/ Replace
- Priority "A" or "B", 0-3 months depending upon exposure



At this Location: Vandalized pole. Chain saw cut into lower portion of pole. More than half of pole circumference cut into.

Notify supervisor of possible vandalism. Supervisor will have to communicate to damage claims. Complete Poles Inspection Test Report.

Perform Minor Work: No

Write Third-Party Notification: No

Write EC Form: Yes

- FDA=Pole / Broken/Damaged / Replace
- Priority "A" or "B", 0-3 months depending upon exposure

POLE DAMAGED ON THE BOTTOM BUT OK

At this Location: Pole damaged by vehicle. Splint installed as temporary repair. Inspection shows adequate circumference/strength. Sharp ragged splinters. Curb is adequate protection – visibility strips not required.

If pole has reduced circumference write EC notification for estimating to confirm pole loading. If damage requires replacement, create an EC notification to replace the pole.

Perform Minor Work: Yes, Remove sharp edges, remove splint.

Write Third-Party Notification: No

Write EC Form: Yes.

- FDA= Pole / Overloaded / Test

If needs replaced:

- FDA=Pole / Broken/Damaged / Replace

DETERIORATION AROUND GROUND LINE

Before extraction



**After extraction showing
below ground deterioration**

At this Location: Deteriorated condition found during normal inspection. Complete Pole Inspection Test Report. If pole has reduced circumference. Write EC notification for estimating to confirm pole loading.


Perform Minor Work: No

Write Third-Party Notification: No

Write EC Form: Yes

- FDA=Pole / Decayed/Rotten / Replace
- Priority "A", follow Emergency Process


Examples: Poles with woodpecker damage – assess using woodpecker assessment guidelines.

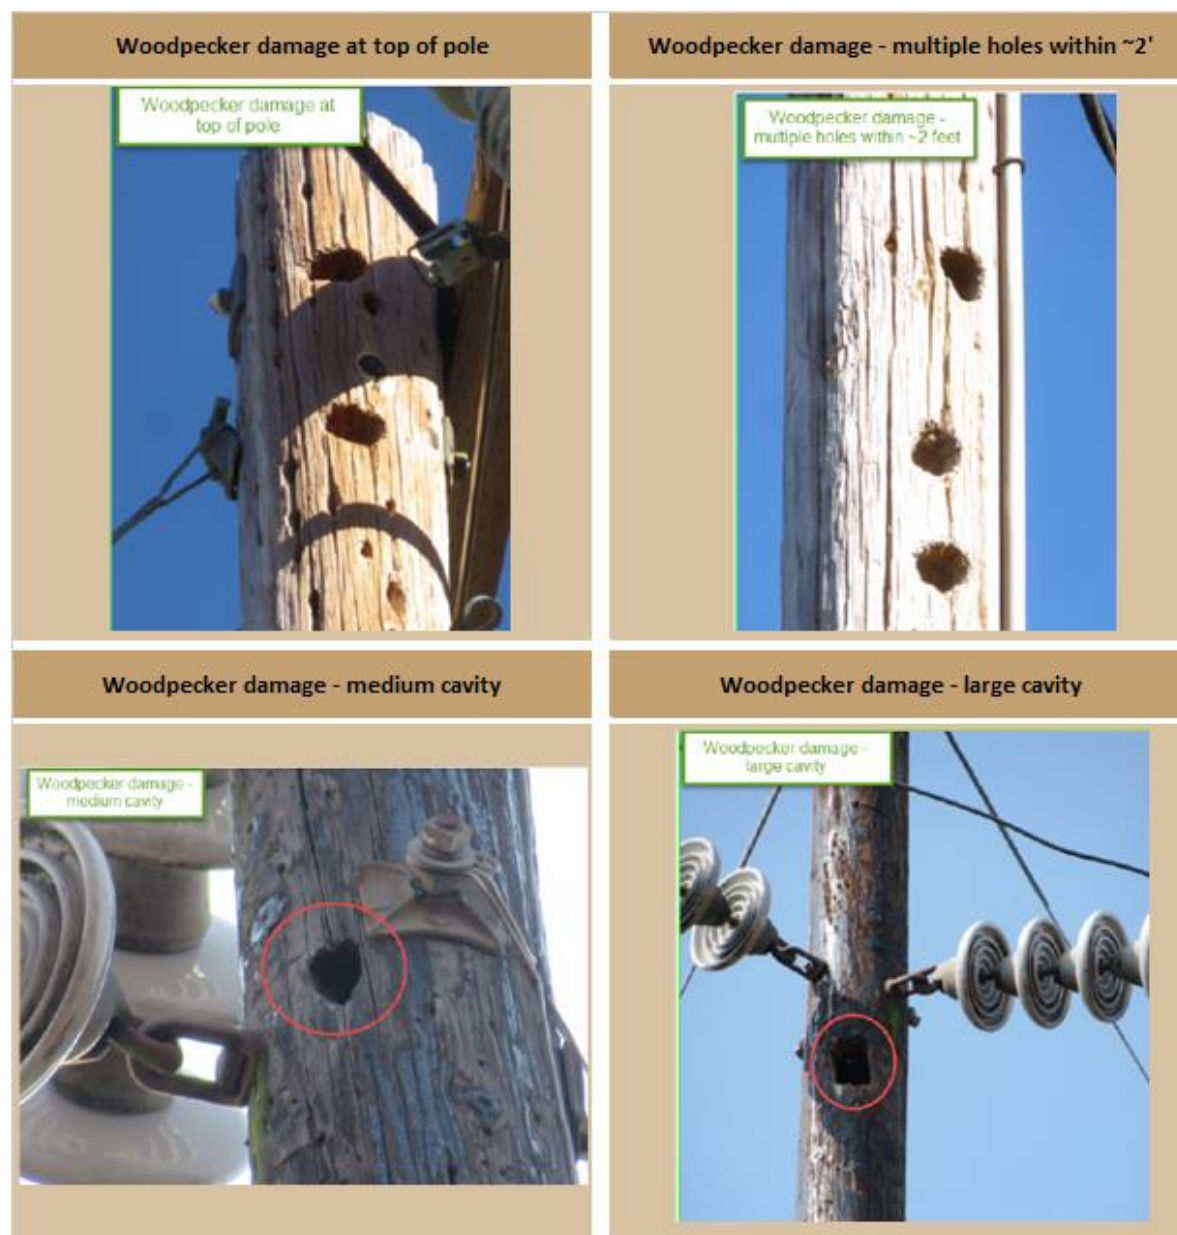

Examples: Significant reduced circumference



Repair of Woodpecker-Damaged Pole Tops

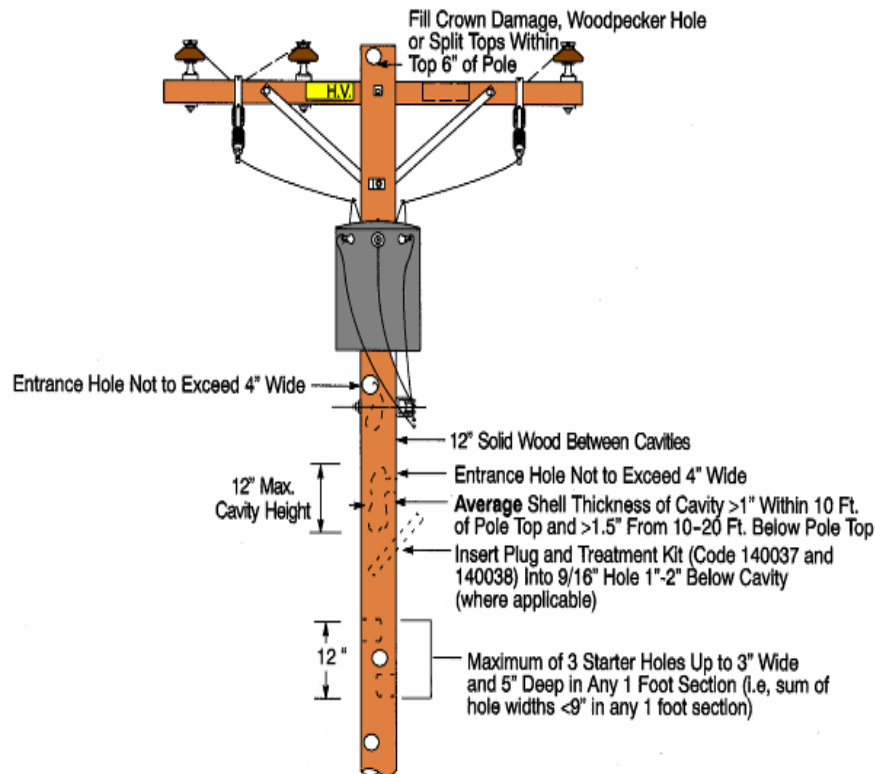

Assessing woodpecker damage

- The QCR should note the approximate location, number, and size of woodpecker holes on the "Pole Inspection/Test Report" (Exhibit A, Part 3).
- Determine whether identified above-ground or pole-top damage is suitable for restoration. Poles are suitable for restoration and can remain in service if they meet the criteria listed below:
 - There is 1 vertical inch of solid wood directly below any throughbolt to support existing or proposed attachments.
 - Nesting cavities or other open pockets have an outside hole diameter that is less than 4 inches wide.
 - Internal cavities are estimated to be less than 12 inches high and 7 inches in diameter.
 - The average shell thickness of the cavity is greater than 1 inch within the top 10 feet of the pole, and greater than 1½ inches between 10 feet and 20 feet from the top. See Exhibit B, Part 1, for shell thickness between 20 feet of the pole top and the groundline.
 - There is more than 12 inches of sound wood vertically between nesting cavities.
 - There are three or fewer starter holes less than 3 inches wide, 3 inches high, and 5 inches deep within any 1-foot vertical section of the pole. The maximum sum of the diameters of the holes must be less than 9 inches wide in a 1-foot vertical section.
 - The pole-top crown damage or split tops extend downward less than 6 inches from the pole top.

3. Leaning Pole

General Guidance: Consider the following when evaluating a leaning pole:

- Is the pole leaning/out of plumb by more than 10% of its height above the ground?
- Is the leaning pole causing excessive conductor sag or reduced clearance issues that could result in contact, fire risk, or public safety?
- Does the lean appear as if it will become worse or affect safety or reliability in the next 5 years (considering environmental and configuration factors -soil, wind, pole attachments, equipment, guying)?

If the answer is **yes** to any of these questions, at minimum **create an EC Notification (Pole /Overloaded /Test) and fill out Pole Test Data Sheet**. All poles need to be load calculated prior to straightening. Estimating will create an EC to straighten (Pole/Lean/Adjust) or replace (Pole/Lean/Replace). If Inspector determines that pole needs to be replaced, create EC notification to replace pole.

Note: If the Inspector suspects that a third-party attachment is causing the pole to lean, consider writing a Third-Party Utility notification in addition to an EC Notification.

Minor Work: No

EC Form: Yes

- Select the Priority and Due Date based upon compelling abnormal condition that may adversely impact public safety and/or service reliability in the next five (5) years

Related Documents: 023058, TD-2014S – Third Party Damage

LEANING POLE



At this Location: Leaning pole greater than 10% out of plumb. Pole is stable. No equipment in rural area. Causing reduced clearance.


Perform Minor Work: No

Write Third-Party Notification: No

Write EC Form: Yes

- FDA=Pole / Leaning / Replace
- Priority "E", 3-12 months depending upon exposure

LEANING SLACK SPAN

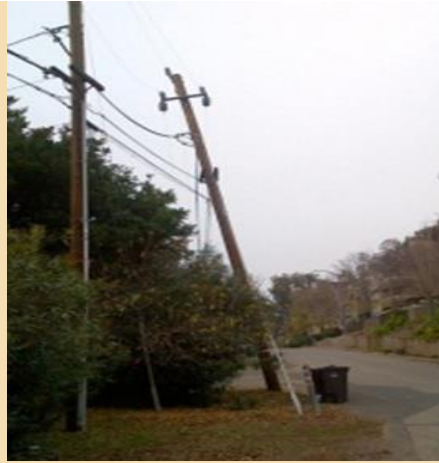

At this Location: Leaning pole more than 10% out of plumb. Pole test indicates that pole is solid below ground and can be straightened. Probability of equipment failure is moderate.

Perform Minor Work: No

Write Third-Party Notification: No

Write EC Form: Yes

- FDA=Pole / Leaning / Adjust
- Priority "E", 3-12 months depending upon exposure

STUBBED POLE LEANING TOWARDS SCHOOL



At this Location: Stubbed pole leaning towards school, supported by down guy. Pole Bands are loose due to additional deterioration of the pole. Pole test data sheet indicates that pole no longer meets stubbing criteria causing reduced clearance issues

Perform Minor Work: No

Write Third-Party Notification: No

Write EC Form: Yes

- FDA=Pole / Decay/Rotten / Replace
- Priority "E", 3-12 months depending upon exposure

POLE LEANING 3 POT TRANSFORMER IN BUCK POSITION



At this Location: Pole is leaning less than 10% out of plumb, leaning in direction of offset equipment. Pole inspection found pole stable.

Perform Minor Work: No

Write Third-Party Notification: No

Write EC Form: No

POLE LEANING NEAR RAILROAD TRACKS



At this Location: Severe lean being held up by the primary conductors. Low clearance over active railroad tracks. Pole located in a swamp area with standing water.

Perform Minor Work: No

Write Third-Party Notification: No

Write EC Form: Yes

- FDA=Pole / Decayed/Rotten/ Replace
- Priority "A", follow Emergency Process

4. Deformed Pole

General Guidance:

For deformed poles, write EC Notification for Pole / Overloaded / Test, for estimating to confirm pole loading.

If the deformity appears as if it will become worse or affect safety or reliability in the next 5 years (considering environmental and configuration factors - soil, wind, pole attachments, equipment, guying) - write EC notification to replace pole.

Common drivers for deformed poles: Improper/lack of guying, third party attachment.

Review clearances to verify no reduced clearance issues, all levels of clearance requirements that could result in contact, fire risk, or public safety.

Minor Work: No

EC Form: Yes

- Select the Priority and Due Date based upon compelling abnormal condition that may adversely impact public safety and/or service reliability in the next five (5) years

Related Documents: EDPM Pole Inspection

POLE BENT 4 FEET OUT OF LINE



At this Location: Pole bent 4 feet out of line, less than 10% lean

Perform Minor Work: No

Write Third-Party Notification: No

Write EC Form: Yes, only when the inspector decides that further assessment is required.

- FDA=Pole / Overloaded / Test
- Priority "E", 3-12 months depending upon exposure

INADEQUATE SUPPORT AT COMMUNICATIONS LEVEL



At this Location: Two guys stabilizing communication level.

Perform Minor Work: No

Write Third-Party Notification: No

Write EC Form: Yes, only when the inspector decides that further assessment is required.

- FDA=Pole / Overloaded / Test
- Priority "E", 3-12 months depending upon exposure

OVER STRESSED POLE



At this Location: Pole is twisted, cracked, due to communication.

Perform Minor Work: No

Write Third-Party Notification: No

Write EC Form: Yes

- FDA=Pole / Overloaded / Replace Pole Test Data Sheet is Required
- Priority "E", 3-12 months depending upon exposure; add in field comments "overloaded by communications."

UNBALANCED LOAD AT TOP



At this Location: Deformed pole with bowed top in line with conductor.

Perform Minor Work: No

Write Third-Party Notification: No

Write EC Form: Yes

- FDA=Pole / Overloaded / Test Pole Test Data Sheet is Required
- Priority "E", 3-12 months depending upon exposure.

5. Soil Excessively Eroded or Washed Away at Base of Pole

General Guidance: If the inspector notices that a large amount of soil was washed or eroded away at the base of a pole, consider writing an EC notification to investigate whether the pole still meets its designed set depth.

Minor Work: No

EC Form: Yes

- FDA = Pole / Overloaded / Test
- Select the Priority and Due Date based upon compelling abnormal condition that may adversely impact public safety and/or service reliability in the next five (5) years

Related Documents: 015203, page 2, table 1

Example: Soil eroded at base of pole



6. Pole Steps

General Guidance: Remove any pole steps less than 8 feet 6 inches above the ground or any other accessible surface; this allows for grading, landscaping, etc.

Minor Work: Yes

EC Form: Yes, if cannot be completed as minor work.

- Select the Priority and Due Date based upon compelling abnormal condition that may adversely impact public safety and/or service reliability in the next five (5) years

Related Documents: 022616 page 2, section 5

7. Mud sill

General Guidance: Repair/replace deteriorated mud sill.

Minor Work: No

Related Documents: 030109

8. Transmission Poles


General Guidance: At minimum, when performing GO 165 patrols or inspections, Inspectors should perform a “patrol” of the transmission assets in the area being patrolled or inspected in order to identify any **obvious structural problems or hazards** that need to be addressed by the Transmission Organization. Review clearances to verify no reduced clearance issues, all levels of clearance requirements that could result in contact, fire risk, or public safety.

Examples of the types of issues that could be identified:

- Damaged or broken poles
- Broken or decayed crossarms
- Broken insulators
- Damaged tie wire
- Vegetation issues

If you identify an obvious structural problem or hazard in the field that is NOT an emergency:

- Assign a location # of your map
- Take a photo of the pole # on the pole; example:

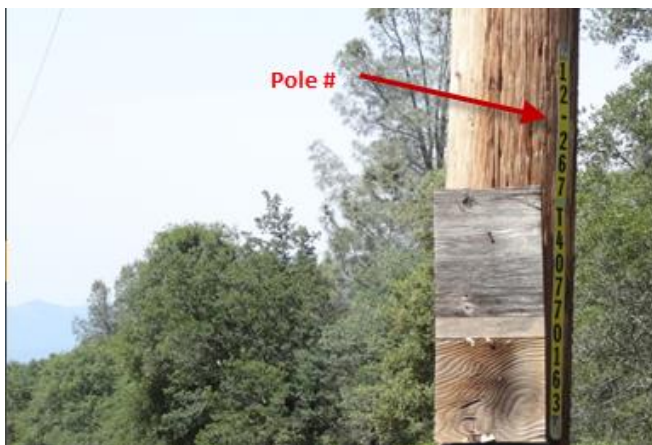

- Take a **minimum** of one photo to document the issue at the location
- Refer to the Transmission key contact map to identify the **T-Line contact** for that area
- Contact the appropriate **Transmission Supervisor** (leave a VM if not available)
- In the comments section of your log entry, note the following:
 - The issue identified (i.e., bad pole, broken crossarm, etc.)
 - The transmission pole #
 - The date, name and phone number of the T-Line employee that you contacted
 - The digital photo number(s) associated with the location

When in doubt call your Supervisor or PG&E Lead

Minor Work: No

9. Transmission Pole with Distribution Underbuild

Inspect App: Use the Inspect App to document adverse field conditions as follows:

Structure Section: Select Transmission with Distribution Underbuild

Example 1a:

Checklist item: Distribution riser on structure

Guidance: Structure must be steel Transmission Structure with Distribution Underbuild with **external** riser present. If observed, yes, create EC notification to relocate riser.

EC Form: Yes

- FDA = Riser/Pothead / Installed in Error / Relocate
- Priority "E", 3-12 months depending upon exposure



Example 1b:

Checklist item: Distribution riser on structure

Guidance: Structure must be steel Transmission Structure with Distribution Underbuild with **internal** riser within steel pole. If observed, yes, create EC notification to relocate riser.

EC Form: Yes

- FDA = Riser/Pothead / Installed in Error / Relocate
- Priority "E", 3-12 months depending upon exposure



Example 2:

Checklist item: Distribution transformer serving an external customer installed without a common neutral present

Guidance: If observed, yes, create EC notification to relocate the transformer.

EC Form: Yes

- Select the Priority and Due Date based upon compelling abnormal condition. Defaults to E Priority.
- Use FDA Transformer / No Common Neutral / Relocate

Related Documents: 068177

Example: Distribution transformer on steel transmission pole without common neutral.



Example 3:

Checklist item: Missing or broken distribution bridging or bonding

Guidance: If observed, yes, create EC notification to repair or install missing bridging.

EC Form: Yes

- Select the Priority and Due Date based upon compelling abnormal condition. Defaults to E Priority.
- Use FDA Trasn_Dist Pole / Bonding Broken / Repair
- Use FDA Trasn_Dist Pole / Bonding Missing / Install

Related Documents: TD-2305M-B009

Example: Wood Crossarm on Transmission with Distribution Underbuild that requires bridging



Riser Molding

1. Broken/Missing Riser Ground

General Guidance:

See 'Ground / Ground Molding' in this job Aid

Minor Work: None

Related Documents: 027742

2. U-Shape Riser Molding Broken/Damaged or Unsecured

General Guidance – Existing Molding:

Ensure bottom section of ground molding is flush against the pole

IF molding is NOT firmly attached to pole

THEN Perform Minor Work to secure molding to pole by attaching all lags **OR** Create EC Notification

Address any gaps identified via minor work or create an EC notification

General Guidance if Installing New Molding or Repairing Existing Molding:

Below 8 feet: Both sides of the molding must be secured to the pole at least every 18 inches

Above 8 feet: Both sides of the molding must be secured to the pole at least every 36 inches

Examples



Minor Work: Yes

Related Documents: 021924

SmartMeter/SCADA Equipment/Other Equipment on Poles

1. Broken/Damaged SmartMeter Relay/Access Point/Data Collector Unit or SCADA Equipment

General Guidance: If, through visual inspection, an inspector sees broken or damaged SmartMeter antenna, DCU, or SCADA equipment, create EC notification. Be sure to check the SmartMeter box on the EC Form. If visible, note the operating number and/or serial number of the equipment.

Supervisors will contact SmartMeter Operations to notify them of the issue.

Minor Work: No

Related Documents: 072145, 072150, 068190, SMRT-9000WBT, 054421

EXAMPLES OF SMARTMETER ON POLE



Streetlights

1. Broken or Damaged Streetlight Pole

General Guidance: Test for out of plumb, then create EC notification.

Minor Work: No

Related Documents: TD-2309S, TD-2307M

MISSING STREET LIGHT



At this Location: Cone indicates location of missing decorative street light and pole. Exposed wire is de-energized. Include picture of similar street light for replacement.

Perform Minor Work: Yes, make safe.

Write Third-Party Notification: No

Write EC Form: Yes

- FDA=Streetlight / Missing / Install
- Priority "B", 30 days for regular streetlights, add in field comment section if pole is missing.
- Priority "E", 6 months for decorative streetlights, add in field comment section – describe if pole is missing.

LEANING AGGREGATE POLE



At this Location: Leaning aggregate pole more than 10% out of plumb. Pole is broken at base and not stable. Light still working.

Perform Minor Work: No

Write Third-Party Notification: No

Write EC Form: Yes

- FDA=Pole / Broken/Damaged / Replace
- Priority "B", 0-3 months depending upon exposure

2. Day Burner

General Guidance: Do not create an EC Notification for a day burner. Call a clerk to contact Restoration Dispatch to get a T-Man to respond. This is to ensure correct accounting for streetlight work (depending on the rate that the customer is one, etc.).

Minor Work: Yes; if you have the materials on your truck

Related Documents: Utility S2309

3. Missing Streetlight

General Guidance: If the inspector notices that a missing streetlight, first, make safe then create EC notification to install a missing streetlight.

Minor Work: No

Related Documents: Utility S2309

Trees

1. Trees within 4 Feet of a Primary Line

General Guidance: If you have any questions about the integrity of tree that could impact electric facilities, (causing damage to our facilities, dead or dying, causing conductor height issue, could fall into line etc.), write a Vegetation Notification to remove dead/dying tree.

Broken Limb on Conductor: Remove the limb as minor work with a hot stick if it is safe to do so.

Vegetation Touching Bare Conductor or Signs of Burning or Arcing: Create an emergency Priority "A" Vegetation Management Tag and call vegetation management for assistance. Wait at the location until relieved by Vegetation Management personnel.

Vegetation Not Touching Bare Conductor and No Signs of Burning or Arcing: Create a Vegetation Management notification.

Minor Work: Yes

Related Documents: None

2. Tree Attachments

General Guidance: If you have any questions about the integrity of the tree, (causing damage to our facilities, dead or dying, causing conductor height issue, etc.), create an EC Notification to install a clearance pole.

Minor Work: No

Related Documents: TD-2999B-044

3. Trees Causing Strain or Abrasion to a Secondary Conductor or Service

General Guidance:

If vegetation is:

A. Causing damage to the conductor insulation due to friction (Note: scuffing and polishing is NOT damaged) or

B. Causing strain on the conductor that is adversely affecting other supply facilities.

Note: The inspector should clear the vegetation or move the conductor as minor work if possible. Inspectors should leave the trimmings at the location; use door hanger to notify customer.

If the inspector cannot clear the vegetation or move the conductor:

- For service drops: Create an EC notification
- For secondary conductor spans serving 2 or more customers: Write a Vegetation Management notification with priority based on severity.

Note: Vegetation Management considers secondary as conductor that feeds more than one physical address (per Rule 16); i.e., multiple "service" conductors feeding the **same customer/property are considered service**, not secondary; Inspector will need to **create an EC** in this scenario.

If the inspector sees a hazardous vegetation issue on communication facilities, create a third- party notification.

Minor Work: Yes

Related Documents: None

PHONE TREE CONDITION




At this Location: Tree putting strain on the pole, due to communication line

Perform Minor Work: No

Write Third-Party Notification: Yes

Write EC Form: No

SECONDARY HARD AGAINST TREE

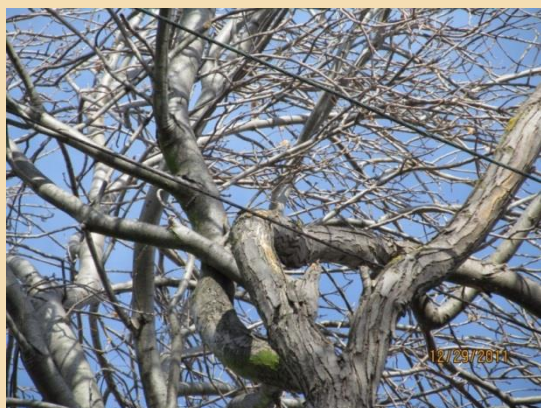

SECONDARY OVERGROWN REDUCING CONDUCTOR CLEARANCES



At this Location: Secondary conductor resting on tree/vegetation

Perform Minor Work: No

Write Third-Party Notification: No

Write EC Form: Yes

- FDA=Tree / Overgrown / Trim
- FDA= Conductor / Clearance / Adjust
- Priority "E", 3-12 months depending upon exposure

Wildlife Protection

1. Existing Migratory Bird Protection Damaged

General Guidance: Evaluate locations where animal mitigation has previously been installed to assess if it is sufficient or is missing or broken. If not sufficient or needs repair, create EC notification to replace.

Note: If there is a nest at the location, write EC Notification to install animal mitigation if nest is already abandoned.

Example: Bird nest on transformer



Minor Work: No



Related Documents: Utility S2321, 061149

2. Existing Wildlife Protection Damaged

General Guidance: Inspector should create EC notification to repair/replace existing wildlife protection installed in the field (cow guards, etc.)

Note where there are signs of animal activity/nesting/debris. Write EC Notification to install animal mitigation if nest is already abandoned.

Examples: Broken bird guard

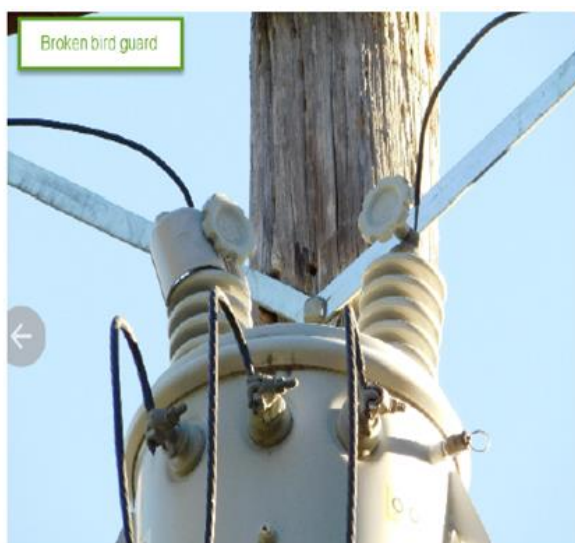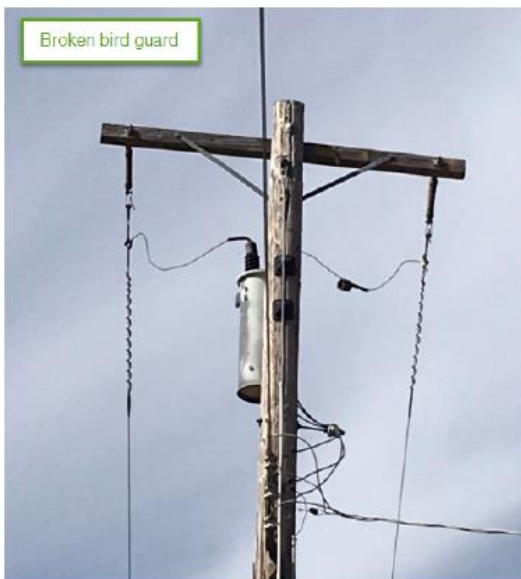

Minor Work: No

Related Documents: 061149

Clearance Evaluation Job Aid



Overhead Clearance Evaluation

TD-2305M-JA12

Publication Date: 3/2013 Rev: 1

Guidance Document References:

TD-2305M – EDPM 2011 Manual


Engineering Document 022158 – Clearance Tables CPUC
General Order 95

Level of Use:

- ☐ Information
- ☒ Reference
- ☐ Continuous

General Information

This job aid contains reference material to help compliance inspectors evaluate conductor clearance issues they visually identify in the field.

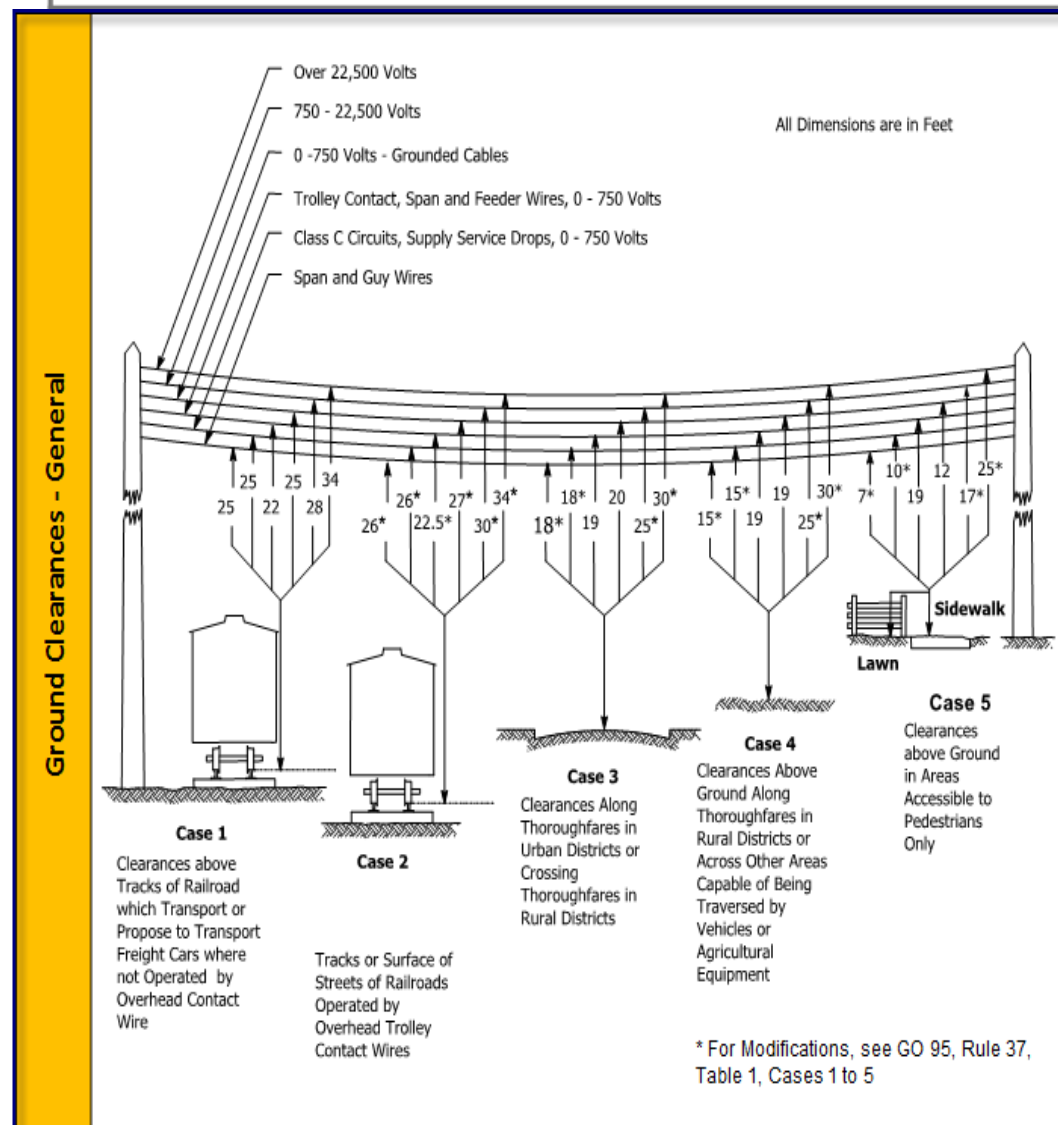




Overhead Conductor Clearances

TD-2305M-JA12


Publication Date: 3/2013 Rev: 1

0-750V Service Drops - Residential

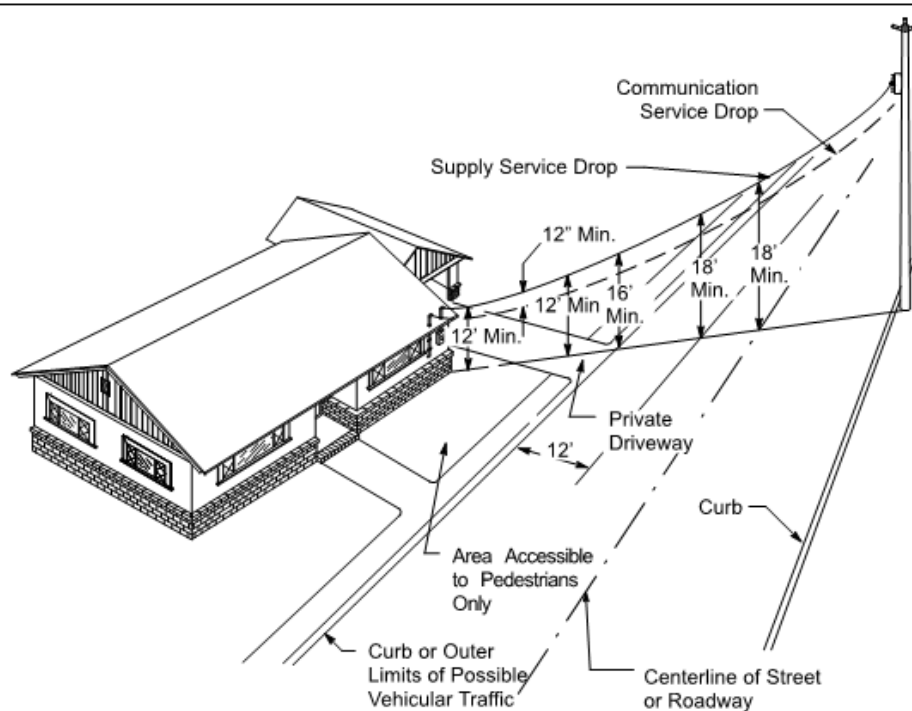

Overhead Clearance Requirements Job Aid

0-750V Service Drops - Industrial & Commercial

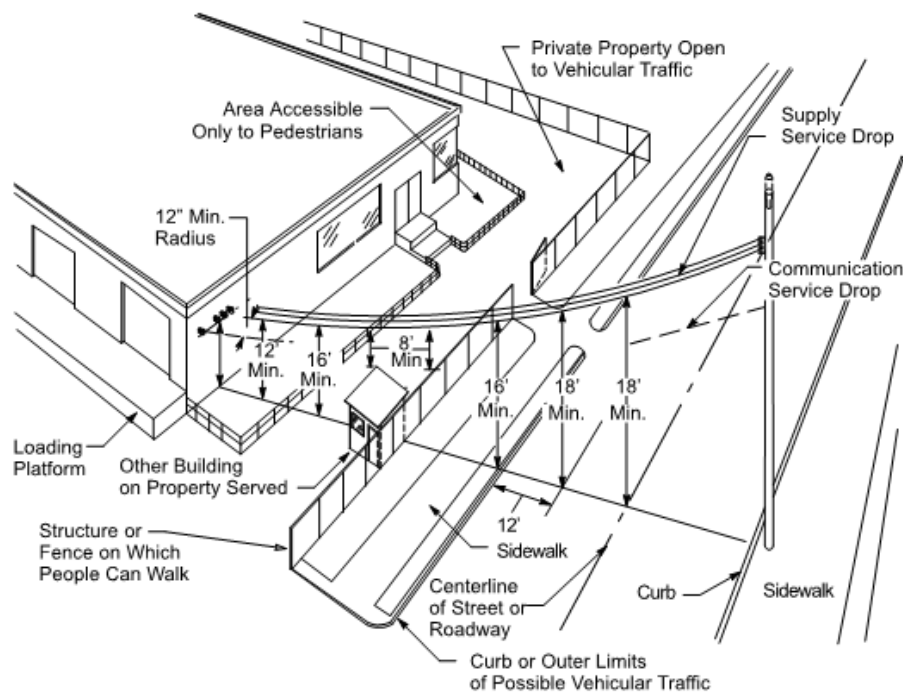




Overhead Conductor Clearances

TD-2305M-JA12

Publication Date: 3/2013 Rev: 1


Conductor to Conductor Clearances - Crossings

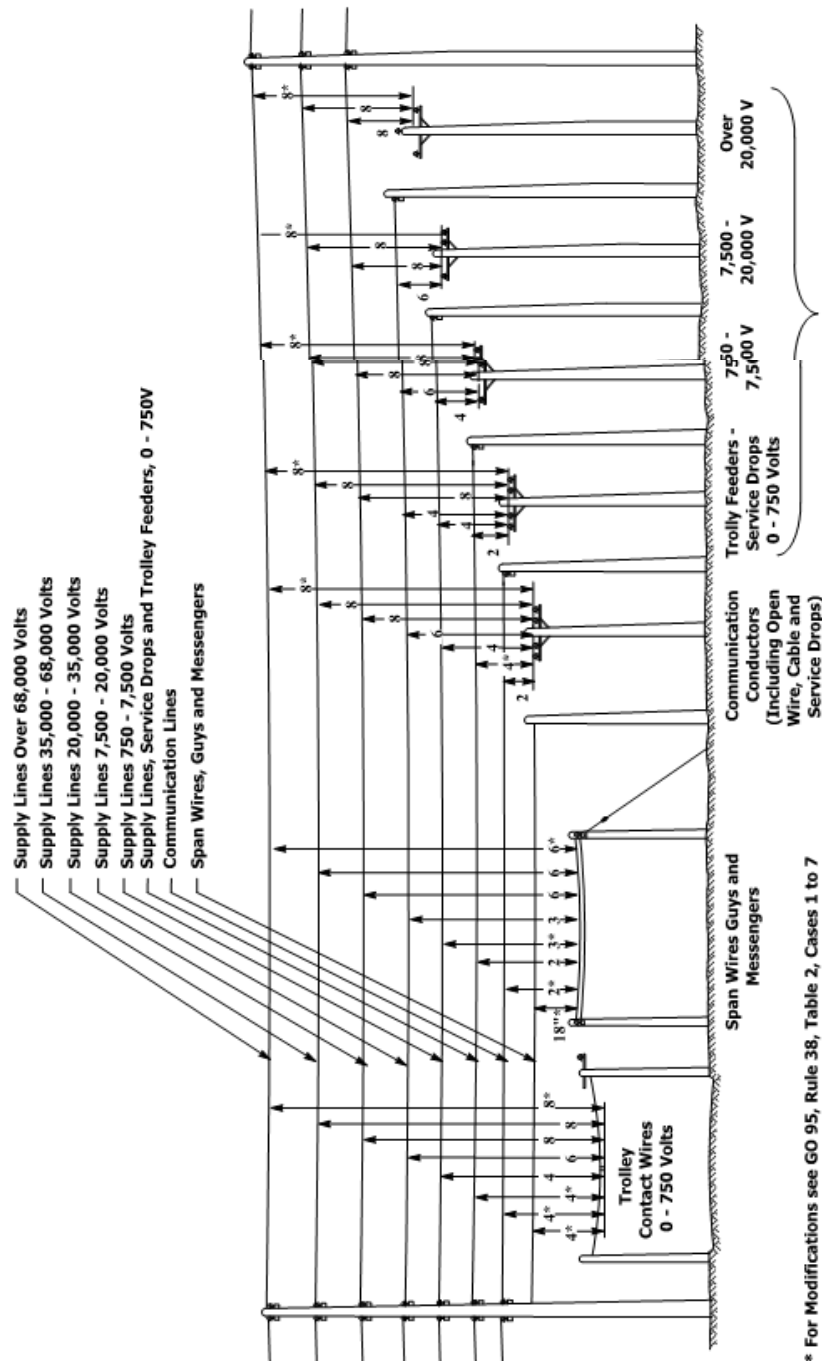

* For Modifications see GO 95, Rule 38, Table 2, Cases 1 to 7

All Dimensions are in Feet Unless Otherwise Noted

Overhead Clearance Requirements Job Aid

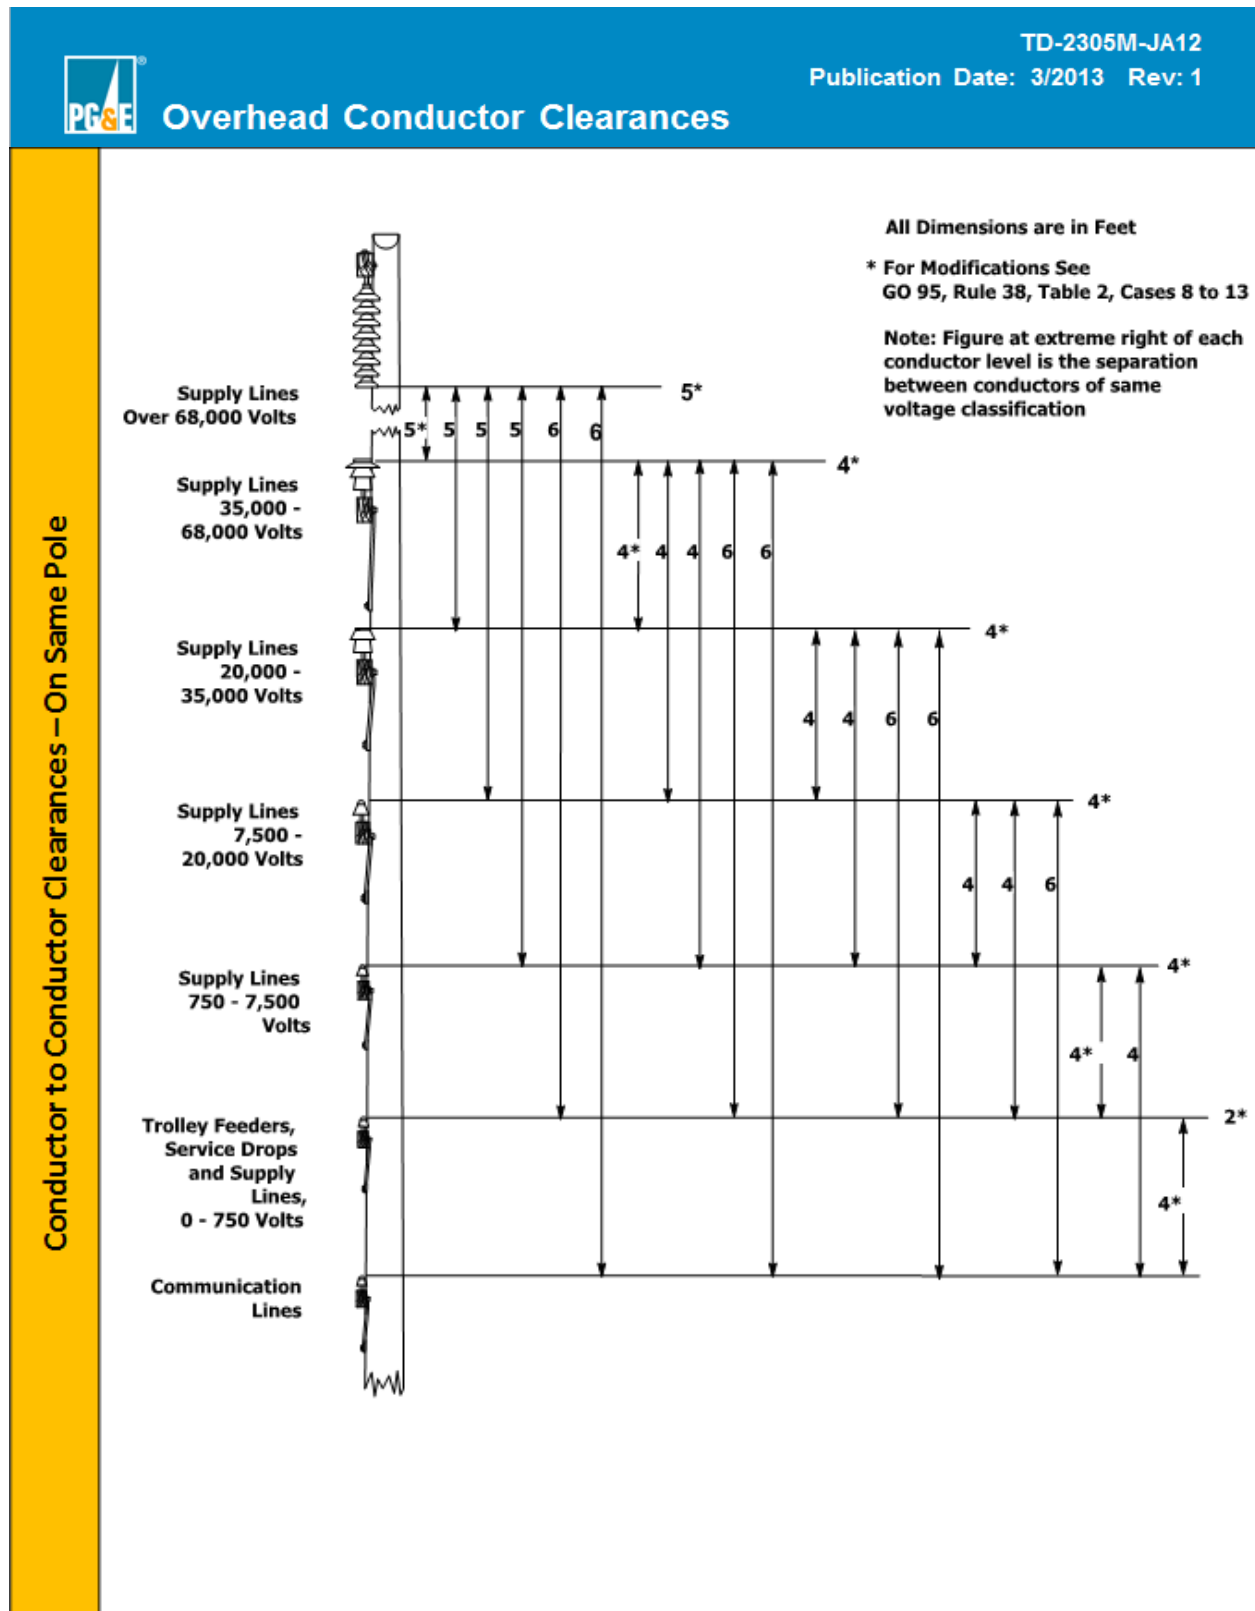




Overhead Conductor Clearances

TD-2305M-JA12

Publication Date: 3/2013 Rev: 1

Conductor to Building Clearances

Conductors Cannot Be in the Shaded Areas

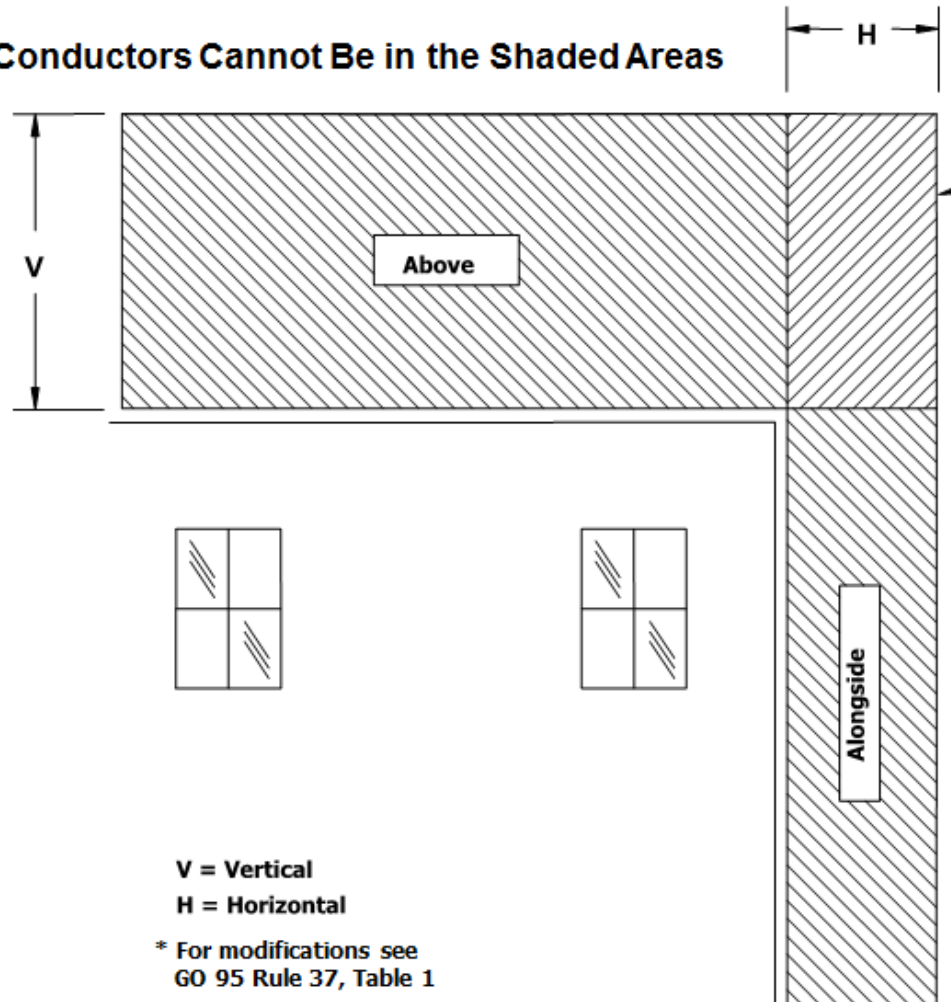

	Conductor Type					
	Guys	Service Drops (not Attached)	0-750 V Spans	750V-22.5kV	22.5 – 300kV	300-550kV
V (Walkable Surface)	8 ft. *	8 ft. *	8 ft.	12 ft.	12 ft.	20 ft. *
V (Non-Walkable Surfaces: Handrails, Chimneys, Patio Covers, etc.)	2 ft.	8 ft. *	8 ft. *	8 ft.	8 ft.	20 ft.
H		3 ft. *	3 ft. *	6 ft.	6 ft. *	15 ft. *

TD-2305M-JA12

Publication Date: 3/2013 Rev: 1

Overhead Conductor Clearances

G.O. 95 Table 1 – Vertical Clearances

		Wire or Conductor Concerned						
Case	Nature of Clearance	A Span Wires (Other than Trolley Span Wires) Overhead Guys and Messengers	B Communication Conductors (Including Open Wire, Cables and Service Drops), Supply Service Drops of 0 - 750 Volts	C Trolley Contact, Feeder and Span Wires, 0 - 5,000 Volts	D Supply Conductors of 0 - 750 Volts and Supply Cables Treated as in Rule 57.8	E Supply Conductors and Supply Cables, 750 - 22,500 Volts	F Supply Conductors and Supply Cables, 22.5 - 300 kV	G Supply Conductors and Supply Cables, 300 - 550 kV
1	Crossing above tracks of railroads which transport or propose to transport freight cars (maximum height 15 feet, 6 inches) where not operated by overhead contact wires. (a) (b) (c) (d)	25 Feet	25 Feet	22.5 Feet	25 Feet	28 Feet	34 Feet	34 Feet (kk)
2	Crossing or paralleling above tracks of railroads operated by overhead trolleys. (b) (c) (d)	26 Feet (e)	26 Feet (e) (f) (g)	22.5 Feet (h) (i) (see)	20 Feet (f)	25 Feet (o) (f)	30 Feet (o) (ii)	30 Feet (o) (i) (kk)
3	Crossing or along thoroughfares in urban districts or crossing thoroughfares in rural districts. (c) (d)	18 Feet (j) (k) (l)	18 Feet (j) (l) (m) (n) (aa)	19 Feet (hh) (see)	20 Feet (f)	25 Feet (o) (f)	30 Feet (o) (ii)	30 Feet (o) (i) (kk)
4	Above ground along thoroughfares in rural districts or across other areas capable of being traversed by vehicles or agricultural equipment.	15 Feet (k)	15 Feet (m) (n) (p)	19 Feet (see)	19 Feet	25 Feet (p)	30 Feet (p) (p)	30 Feet (o) (kk)
5	Above ground in areas accessible to pedestrians only	8 Feet	10 Feet (m) (q)	19 Feet (see)	12 Feet	17 Feet	25 Feet (o)	25 Feet (o) (kk)
6	Vertical clearance above walkable surfaces on buildings, (except generating plants or substations) bridges or other structures which do not ordinarily support conductors, whether attached or unattached.	8 Feet (r)	8 Feet (r)	8 Feet	8 Feet	12 Feet	12 Feet	20 Feet (ll)
6a	Vertical clearance above non-walkable surfaces on buildings, (except generating plants or substations) bridges or other structures, which do not ordinarily support conductors, whether attached or unattached.	2 Feet	8 Feet (yy)	8 Feet	8 Feet (zz)	8 Feet	8 Feet	20 Feet
7	Horizontal clearance of conductor at rest from buildings (except generating plants and substations), bridges or other structures (upon which men may work) where such conductor is not attached thereto(s) (t)	-	3 Feet (u)	3 Feet	3 Feet (u) (v)	6 Feet (v)	6 Feet (v)	15 Feet (v)

G.O. 95 Table 1 – Vertical Clearances (cont'd)									
Wire or Conductor Concerned									
Case	Nature of Clearance	A	B	C	D	E	F	G	
		Span Wires (Other than Trolley Span Wires) Overhead Guys and Messengers	Communication Conductors (Including Open Wire, Cables and Service Drops), Supply Service Drops of 0 - 750 Volts	Trolley Contact, Feeder and Span Wires, 0 - 5,000 Volts	Supply Conductors of 0 - 750 Volts and Supply Cables Treated as in Rule 37.8	Supply Conductors and Supply Cables, 750 - 22,500 Volts	Supply Conductors and Supply Cables, 22.5 - 300 kV	Supply Conductors and Supply Cables, 300 - 550 kV	
8	Distance of conductor from center line of pole, whether attached or unattached (w)(x)(y)	-	15 inches (s)(aa)	15 inches (aa)(bb)(cc)	15 inches (o)(aa)(dd)	15 or 18 inches (o)(dd)(ee)(j)	18 inches (dd)(ee)	Not Applicable	
9	Distance of conductor from center line of pole, whether attached or unattached (w)(x)(y)	-	3 inches (aa)(ff)	3 inches (aa)(gg)	3 inches (aa)(dd)(gg)	3 inches (dd)(gg)(j)	1/4 Pin Spacing Shown in Table 2 Case 15 (dd)	1/2 Pin Spacing Shown in Table 2 Case 15 (dd)	
10	Radial centerline clearance of conductor or cable (unattached) from non-dimtable street lighting or traffic signal poles or standards, including mastarms, brackets and lighting fixtures, and from antennas that are not part of the overhead line system.	-	Foot (u)(rr)(ss)	15 inches (bb)(cc)	3 Feet (oo)	6 Feet (pp)	10 Feet (qq)	10 Feet (t)	
11	Water areas not suitable for sailboating (tt)(uu)(vv)(xx)	15 Feet	15 Feet	-	15 Feet	17 Feet	25 Feet	25 Feet (kk)	
12	Water areas suitable for sailboating, surface area of (tt)(vv)(ww)(xx)								
	(A) Less than 20 acres	18 Feet	18 Feet	-	18 Feet	20 Feet	27 Feet	27 Feet (kk)	
	(B) 20 to 200 acres	26 Feet	26 Feet	-	26 Feet	28 Feet	35 Feet	35 Feet (kk)	
	(C) Over 200 to 2,000 acres	32 Feet	32 Feet	-	32 Feet	34 Feet	41 Feet	41 Feet (kk)	
	(D) Over 2,000 acres	38 Feet	38 Feet	-	38 Feet	40 Feet	47 Feet	47 Feet (kk)	
13	Radial clearance of bare line conductors from tree branches or foliage (aaa)(ddd)	-	-	18 inches (bbb)	-	18 inches (bbb)	1/4 pin spacing shown in table 2, Case 15(bbb)(ccc)	1/2 pin spacing shown in table 2, Case 15	

Note: A letter next to a measurement indicates there may be an exception. Refer to G.O. 95 to research.



Overhead Conductor Clearances

TD-2305M-JA12

Publication Date: 3/2013 Rev: 1

G.O. 95 Table 2 – Conductor to Conductor Clearances

Case No.	Nature of Clearance and Class and Voltage of Wire, Cable or Conductor Concerned	Other Wire, Cable or Conductor Concerned Supply Conductors (Including Supply Cables)										
		A	B	C	D	E	F	G	H	I	J	K (kk)
		Span Wires, Guys and Messengers	Trolley Contact Conductors 0 - 750 Volts	Comm. Conductors (Including Open Wire, Cables and Service Drops)	0 - 750 Volts (Including Service Drops) and Trolley Feeders (a)	750 - 7,500 Volts	7,500 - 20,000 Volts	20,000 - 35,000 Volts	35,000 - 75,000 Volts	75,000 - 150,000 Volts	150,000 - 300,000 Volts	300,000 - 550,000 Volts
	Clearance between wires, cables and conductors not supported on the same poles, vertically at crossings in spans and radially where colinear or approaching crossings											
1	Span wires, guys and messengers (b)	18 (c)	48 (d, e)	24 (e)	24 (e)	36 (f)	36	72	72	78	78 (gg)	138 (hh)
2	Trolley contact conductors, 0 - 750 volts	48 (d, e)	-	48 (d)	48 (d, h)	48	72	96	96	96	96 (gg)	158 (hh)
3	Communication conductors	24 (e)	48 (d)	24	48 (i)	48 (dd)	72	96	96	96	96 (gg)	156 (hh)
4	Supply conductors, service drops and trolley feeders, 0 - 750 volts (qq)	24 (e)	48 (d, h)	48 (i)	24	48	48	96 (oo)	96	96	96 (gg)	156 (hh)
5	Supply conductors, 750 - 7,500 volts (qq)	36 (f)	48	48 (dd)	48	48 (h)	72	96 (oo)	96	96	96 (gg)	158 (hh)
6	Supply conductors, 7,500 - 20,000 volts (qq)	36	72	72	48	72	72	96 (oo)	96	96	96 (gg)	156 (hh)
7	Supply conductors, more than 20,000 volts (qq)	72 (g)	96 (g)	96 (g)	96 (g, oo)	96 (g, oo)	96 (g, oo)	96 (g, oo)	96 (g)	96	96 (gg)	156 (hh)
	Vertical separation between conductors and/or cables, on separate crossarms or other supports at different levels (excepting on related line and buck arms) on the same pole and in adjoining midspans											
8	Communication Conductors and Service Drops	-	-	12 (j, n)	48 (k, l, m, n, pp)	48 (k)	72 (m, n)	72 (m)	72	78	87 (gg)	147 (hh)
9	Supply Conductors Service Drops and Trolley Feeders, 0 - 750 Volts	-	-	48 (k, l, m, n, pp)	24 (h, k, m, o)	48 (k, m, p)	48 (k, m, p)	72 (m, nn)	72	78	87 (gg)	147 (hh)
10	Supply conductors, 750 - 7,500 volts	-	-	48 (k)	48 (k, m, p)	48 (m, o, i, ee)	48 (m, q)	48 (m, q)	48 (q)	60 (ff)	90 (gg)	150 (hh)

Note: A letter next to a measurement indicates there may be an exception. Refer to G.O. 95 to research.

TD-2305M-JA12

Publication Date: 3/2013 Rev: 1

Overhead Conductor Clearances

G.O. 95 Table 2 – Conductor to Conductor Clearances (Cont'd)

Case No.	Nature of Clearance and Class and Voltage of Wire, Cable or Conductor Concerned	Other Wire, Cable or Conductor Concerned Supply Conductors (Including Supply Cables)										
		A	B	C	D	E	F	G	H	I	J	K (kk)
		Span Wires, Guys and Messengers	Trolley Contact Conductors 0 – 750 Volts	Comm. Conductors (Including Open Wire, Service Cables and Drops)	0 – 750 Volts (Including Service Drops) and Trolley Feeders (a)	750 – 7,500 Volts	7,500 – 20,000 Volts	20,000 – 35,000 Volts	35,000 – 75,000 Volts	75,000 – 150,000 Volts	150,000 – 300,000 Volts	300,000 – 550,000 Volts
Vertical clearance between conductors on related line arms and buck arms												
14	Line arms above or below related buck arms (s, f)	-	-	6	12 (u)	18 (u)	18 (u)	24	48	60 (ff)	90 (gg)	150 (hh)
Horizontal separation of conductors on same crossarm												
15	Pin spacing of longitudinal conductors vertical conductors and service drops (v, w)	-	-	3 (x)	11½ (h, x)	11½ (x)	17½ (x)	24 (x)	48	60 (ff)	90 (gg)	150 (hh)
Radial separation of conductors on same crossarm, pole or structure—incidental pole wiring												
16	Conductors, taps or lead wires of different circuits (v, y, s)	-	-	3 (x)	11½ (h, x)	11½ (x)	17½ (x)	24 (x)	48	60 (ff)	90 (gg)	150 (hh)
16a	Uncovered, grounded, non-dielectric fiber optic cables on metallic structures, in transition (ss)	-	15	15	15	18	18	18	18	24	36	120
17	Conductors, taps or lead wires of the same circuit (v, s, aa)	-	-	3	3	6	6	12	24	60 (ff)	90 (gg)	150 (hh)
Radial separation between guys and conductors												
18	Guys passing conductors supported on other poles, or guys approximately parallel to conductors supported on the same poles	-	-	3	11½	11½	17½	24	36	36 (ff)	78 (gg)	138 (hh)

Note: A letter next to a measurement indicates there may be an exception. Refer to G.O. 95 to research.

Crossarm Evaluation Job Aid

General Information:

Environmental conditions throughout the service territory expose support structures to a variety of conditions that can cause or accelerate deterioration of wood components. This section provides guidelines for assessing wood crossarms. Engineering requirements are identified in the Electric Wood Crossarm Assessment Utility guideline TD-2301P-01-JA01.

Guidance: During detailed inspections, examine wood crossarms and assess their condition: Is primary or secondary crossarm damaged, broken, burnt, decayed, rotten, loose, missing hardware or showing signs of bent bolts or brackets, gun shots, insect damage or woodpecker damage, or splitting that compromises the integrity of the crossarm? If yes, create EC notification to replace crossarm; always consider replacing wood crossarms with composite.

Additional Guidance:

Identify conditions such as crossarm configuration, number of phases, location (e.g., urban, rural, forest, inaccessible, traffic, etc.), loading (e.g., double/triple arms, dead ends, alley arms, proximity to trees, angles/conductor size, heavy loading, damaged wood pins, etc.) and the likelihood of these conditions contributing to further deterioration or failure of the crossarm or attached components.







Often cross arms experience significant decay on the top of the arm without exhibiting clues that are visible from the ground¹. For this reason, arms that exhibit two or more of the following characteristics are more likely to decay on the top and should be considered for a more detailed aerial/climbing inspection:

- Arms that appear to be greater than 50 years old²(based on age of pole, presence of wood pins, brown/glass insulators, or other indicators).
- Arms mounted on poles where the pole top is showing signs of decay or crowning.
- Severely weathered arms or arms rounded or apparently decayed ends.
- Damaged wood pins or elongated pinholes.
- Active moss/vegetation growth.
- Presence of woodpecker holes (greater than one inch diameter) on the arm
- Arms in areas of higher rainfall/moisture and reduced sunlight such as those in many coast and mountain areas.
- Wood pins on arms located in agricultural areas or orchards contaminated by aerial spraying and dirt, which contributes to tracking and arm or pin deterioration.

¹ Examples of top and bottom views of crossarm conditions are shown in table 2

² Many, but not all, arms prior to 1955 were untreated.

Crossarm Evaluation Job aid – photo examples

Table 2 – Crossarm Grading Aid	
BOTTOM VIEW	TOP VIEW
<p>Evidence of decay near hole</p> 	<p>Evidence of Significant Decay</p> 
<p>Enlarged hole, minor moss/discoloration/splits near pin hole</p> 	<p>Enlarged hole, minor moss/discoloration/splits near pin hole</p> 
<p>Evidence of tracking/burning near brace and pin holes</p> 	<p>Evidence of burning near brace and pin holes</p> 

BROKEN CROSSARM

Crossarm is completely broken/fractured



Emergency - make safe immediately

SPLIT CROSSARM

Primary Squatter (wood pin). Crossarm split within 2" of pinhole.



Replace in the next 3 months.

TOP OF CROSSARM DECAYED

Evidence of pole top decay and face of crossarm decay; may need additional assessment of crossarm.



Replace 3-12 months

DETERIORATED CROSSARM

Significant deterioration, both arms are broken/split. Evidence of previous temporary repair.



Replace 3-12 months

BROKEN SECONDARY CROSSARM

Secondary arm broken; split/fractured within 2" of bolt holes in heavy tree area.



Replace 3-12 months