




AC Disconnect and Variance Logic Standard NEM

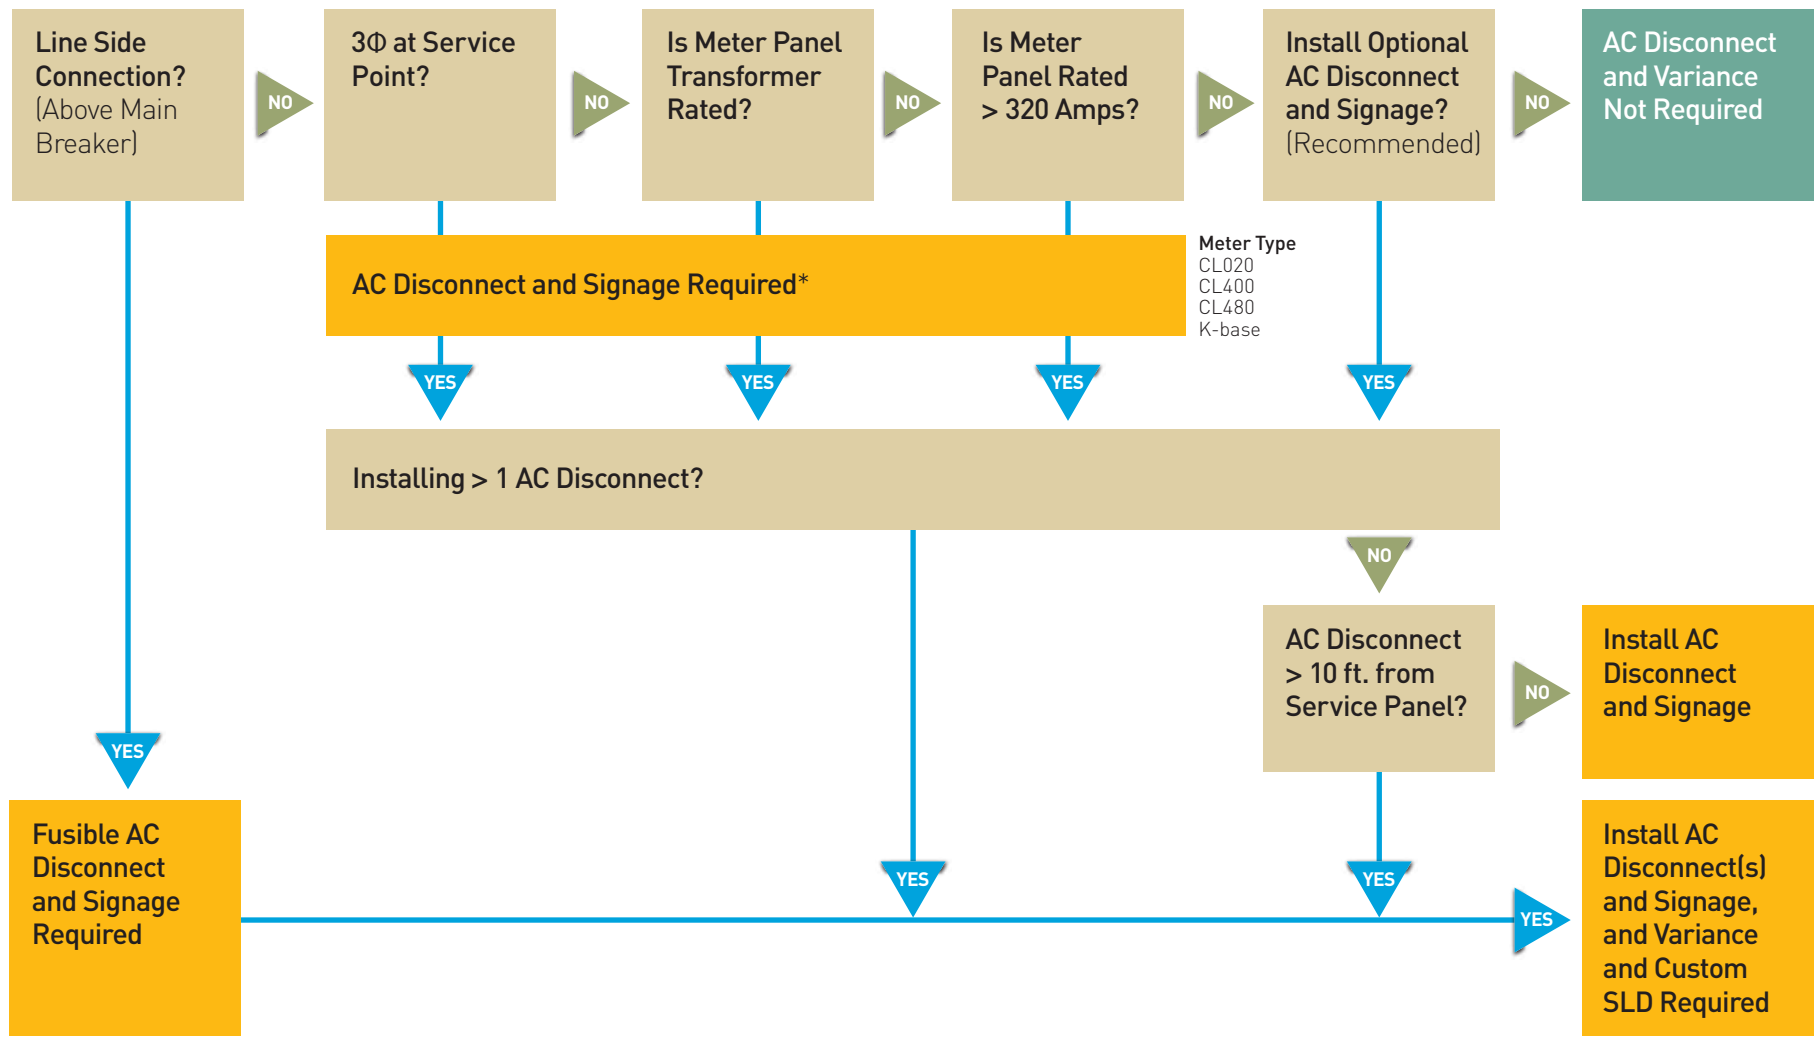

*AC Disconnect and Signage is required on all non-inverter-based generators.

Please note: AC Disconnect is required when removing meter not sufficient to make system safe for crews to work; Diagram is intended to make it easy for everyone to understand the complete requirements.